Chandler • Arizona
Where Values Make The Difference

MEMORANDUM **Case # 15-07**

DATE: July 1, 2015

TO: MAG Specifications and Details Committee Members

FROM: Warren White, City of Chandler Representative

SUBJECT: Revisions to Concrete Paver Stds for Non-Traveled Surface

Case update:

1. Interlocking Concrete Pavement Institute (icpi) Tech Spec 2 Construction of Interlocking Concrete Pavements. Other guidelines and tech papers available here: http://www.icpi.org/view/documents/search?type=ipaper

2. Revision to C-225 Concrete Paver Detail to depict pavers on ABC for raised medians or other non-traveled areas:
    - Revised paver callout notes, header callout, added note no 6 for 60mm allowance, and revised thickness dimension for paver and sand (80mm vs 60 mm)
    - Revised detail title to "INTERLOCKING CONCRETE PAVERS" industry standard.

3. Revision to MAG Section 342 Decorative Pavement Concrete Paving Stone
    - Revised title to "INTERLOCKING CONCRETE PAVEMENTS". Industry standard and purpose of this spec. Other minor revisions for consistency.

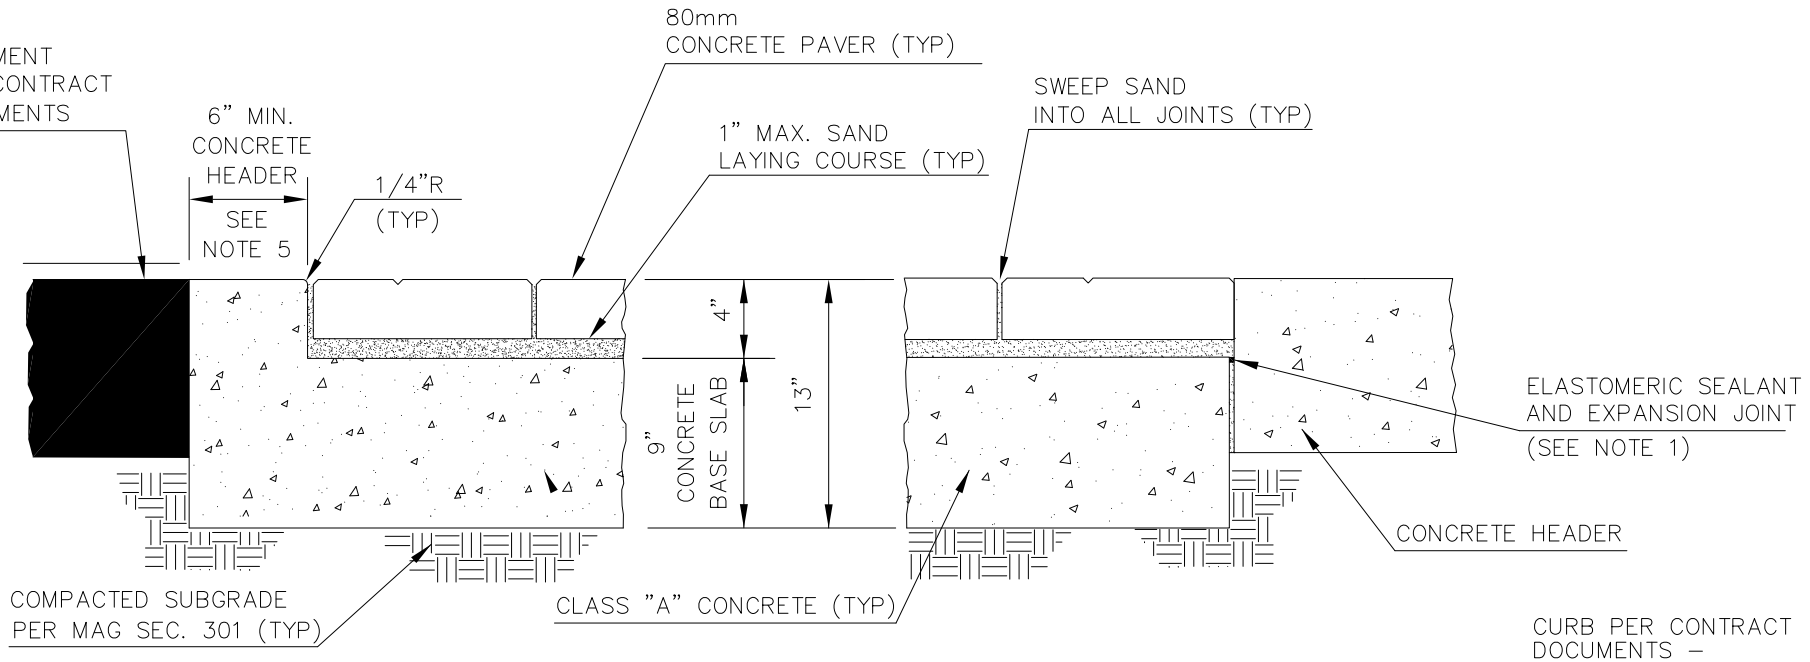

TYPICAL SECTION
(AGAINST PAVEMENT)

TYPICAL AT END OR ALTERNATE SECTION
(AGAINST CONCRETE)

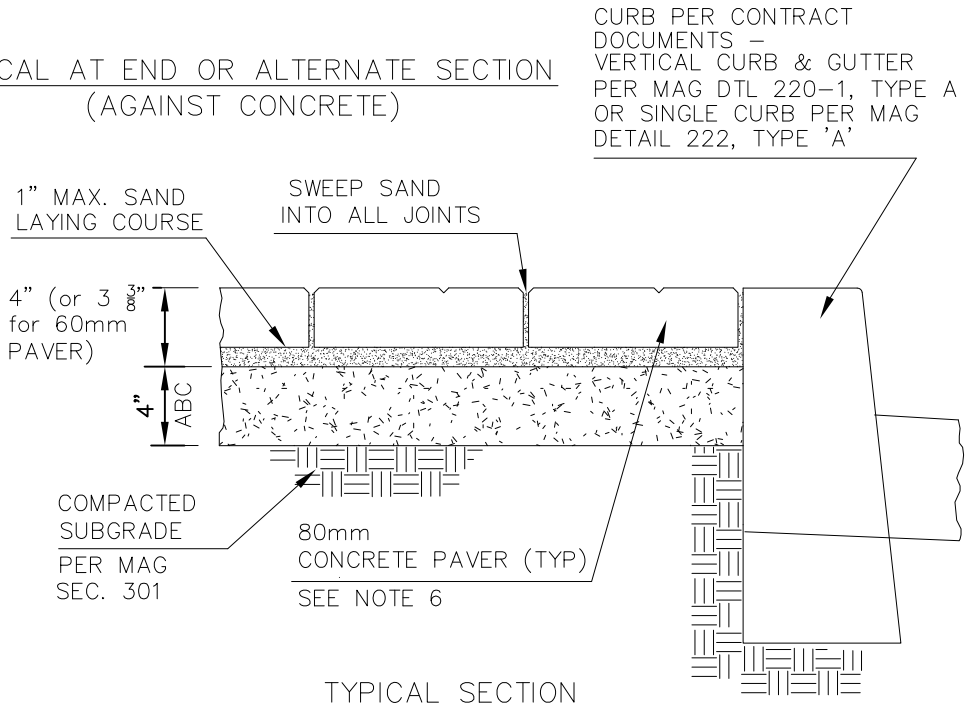

TYPICAL SECTION
(RAISED MEDIAN)

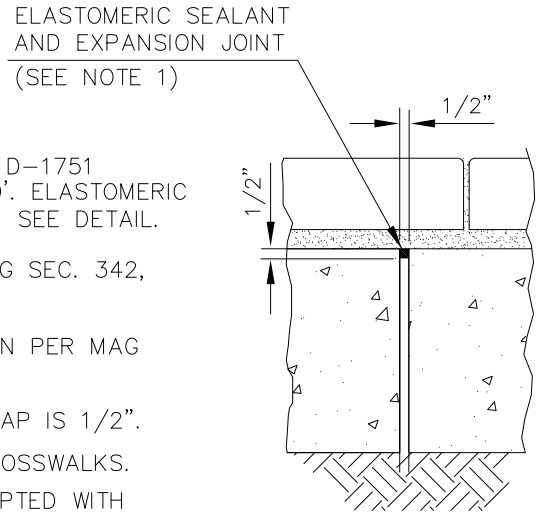

EXPANSION JOINT
DETAIL

NOTES:

1. 1/2" EXPANSION JOINT, ASTM D-1751 PER MAG SEC. 729, EVERY 50'. ELASTOMERIC SEALANT PER MAG SEC. 342. SEE DETAIL.
2. CONTRACTION JOINTS PER MAG SEC. 342, EVERY 10'.
3. MATERIALS AND CONSTRUCTION PER MAG SEC. 342.
4. MAXIMUM ALLOWABLE JOINT GAP IS 1/2".
5. HEADER SHALL BE 12" AT CROSSWALKS.
6. 60mm PAVERS MAY BE ACCEPTED WITH AGENCY APPROVAL IN NON TRAFFIC AREAS ONLY.

DETAIL NO.				REVISED	DETAIL NO.
225	MARICOPA ASSOCIATION of GOVERNMENTS — STANDARD DETAIL ENGLISH		INTERLOCKING CONCRETE PAVERS	01-01-2016	225

SECTION 342
~~DECORATIVE PAVEMENT~~
~~CONCRETE PAVING STONE~~INTERLOCKING CONCRETE PAVEMENTS

342.1 GENERAL:

The Contractor shall furnish all necessary labor, material, tools and equipment to complete the proper installation of ~~decorative~~ interlocking concrete pavers used in medians, crosswalks, intersections or as otherwise noted in the Contract Documents. This includes furnishing a 10-foot straightedge to accomplish the level test when required by this specification.

The decorative pavement shall be true in line and grade and installed to coincide and align with the adjacent work elevation. All edges shall be retained to secure the pavers and sand laying course.

The Contractor shall construct a sample panel 10-feet by 10-feet for inspection and approval by the Engineer, prior to the actual installation for the project. Once approved, the panel shall be used as a standard for the remainder of the work. The panel shall remain undisturbed throughout the construction of the pavers and final approval by the Engineer.

342.2 MATERIALS:

342.2.1 Aggregate Base Course: Aggregate Base Course shall be per Table 702-1.

342.2.2 Portland Cement Concrete: When the pavers are subject to vehicular traffic, Portland Cement Concrete shall be Class A per Section 725. All other locations, the Portland Cement Concrete shall be a minimum of Class B per Section 725.

342.2.3 Sand: Sand used for laying course shall conform to ASTM C33 except for the gradation. The gradation shall comply with Table 342-1.

TABLE 342-1
SAND GRADATION

Sieve Size	3/8 inch	No. 4	No. 8	No. 16	No.30	No. 50	No. 100	No. 200
Percent Passing	100	95-100	85-100	15-85	25-60	10-30	2-10	0-1

342.2.4 Concrete Pavers: Pavers shall have a minimum of thickness of 80 mm (3.15) when installed in traffic bearing areas and 60 mm (2.36 in.) ~~When~~ when installed in ~~non~~ non-traffic bearings areas. Pavers shall be of an interlocking design conforming to ASTM C936-82. Pavers shall be sound and free of defects that would interfere with the proper placing of the unit or impair the strength or permanence of the construction. The Contractor shall submit two samples of each type of pavers used on the project for review and approval by the Engineer prior to any work. The pavers and materials used in their manufacture shall conform to the following:

(A) Compressive Strength: Pavers shall have a minimum compressive strength of 8,000 psi in accordance with ASTM C140.

(B) Absorption: The average absorption shall not be greater than 5 percent, with no individual unit absorption greater than 7 percent.

(C) Portland Cement: Cement shall comply with Section 725.2, Type II.

(D) Aggregates: Aggregates shall conform to ASTM C33 (washed, graded sand and rock, no expanded shale or lightweight aggregates).

(E) Other Constituents: Coloring pigments shall be applied integrally to the concrete. Air entraining admixtures, coloring pigments, integral water repellents, and finely ground silica shall be previously established as suitable for use in concrete and either shall conform to ASTM standards where applicable, or shall be shown by test or experience not to be detrimental to the concrete.

(F) Physical Properties: The size, shape, design and color of the pavers shall be as noted in the Contract Documents.

342.2.5 Expansion Joint: Expansion joint filler material shall be 1/2-inch premolded and comply with Section 729 and ASTM D1751.

342.3 CONSTRUCTION PROCEDURES:

342.3.1 Subgrade: The subgrade shall be constructed true to grades and lines shown on the plans and compacted to a minimum dry density of 95% as specified in MAG Section 301.

342.3.2 Aggregate Base Course: When aggregate base course is specified per Detail 225, the aggregate base course shall be constructed true to grades and lines shown on the plans and compacted to a minimum dry density of 100% per Section 301 with the surface of the aggregate base course not varying by more than +1/8-inch in 10-feet.

342.3.3 Concrete Header and Base Slab: Forms shall be thoroughly cleaned each time they are used, and shall be coated with a light oil, or other releasing agent of a type which will not discolor the Portland Cement concrete.

The Portland Cement concrete shall be thoroughly spaded away from the forms so that there will be no rock pockets next to the forms. Compacted by mechanical vibrators may be used when approved by the Engineer. Tamping or vibrating shall continue until the mortar flushes to the surface, and the coarse aggregate has been tamped below the surface.

All edges shall be shaped with a suitable tool to form a rounded edge of radius as directed in Detail 225.

The Portland Cement concrete header face form shall not be removed before the concrete has taken the initial set and has sufficient strength to carry its own weight. The concrete header outer form shall not be removed until the concrete has hardened sufficiently to prevent any damage to the concrete. Any porting of concrete damaged while stripping forms shall be repaired or if the damage is severe, replaced at no additional cost to the Contracting Agency. The face and top of the concrete header shall be tested with a 10-foot straightedge or curve template, longitudinally along the surface. Any deviation in excess of 1/4-inch in 10-feet shall be corrected at no additional cost to the Contracting Agency.

Any section of the work deficient in depth or not conforming to the plans or specifications shall be removed and replaced by the Contractor at no additional cost to the Contracting Agency.

Finishing and curing of the concrete shall be done in the manner specified in Section 340.

342.3.4 Expansion Joints: Expansion joints shall be constructed to the full depth and width of the concrete with the top of the material one-half inch below the top surface as depicted in Detail 225 unless otherwise specified. After the concrete is cured, the top one-half inch shall be filled to the surface of the concrete with a premium-grade, high-performance, moisture-cured, single-component, polyurethane-based, non-sag elastomeric sealant, ASTM C920, Type S, Grade NS, Class 25, Sikaflex-lA or equal.

Joints shall be constructed in a straight line and vertical place perpendicular to the longitudinal line of the concrete header, except in cases of curved alignment when they will be constructed along the radial lines of the header. In the case of base slabs, pavers shall be placed continuously over the expansion joints.

342.3.5 Contraction Joints: Contraction joints shall be constructed in a straight line and vertical plane perpendicular to the longitudinal line of the concrete header, except in cases of curved alignment when they will be constructed along the radial lines of the header. They shall be constructed to a depth of one inch with rounded edges and placed at 10-foot intervals. Contraction Joints shall be filled to the surface of the surrounding concrete with elastomeric sealant specified in 342.3.3.

342.3.6 Sand Laying Course: The maximum thickness of the sand course shall be one-inch. Screeding boards shall be used to ensure a uniform thickness. The sand shall not be compacted, walked on or wet down.

342.3.7 Concrete ~~Paving Stones~~Pavers: The concrete pavers shall be clean and free of foreign materials before installation. Paving work shall be plumb, level and true to line and grade and shall be installed to properly coincide and align with adjacent work and elevations. All edges must be retained to secure the perimeter pavers and the sand laying course. The pavers shall be laid in such a manner that the desired pattern is maintained and joints between the pavers are as tight as possible.

The Contractor shall lay the pavers starting from the longest straight line and from a true 90-degree corner. The pavers shall be installed hand-tight and level on the undisturbed sand course in a manner that eliminates gaps between the ~~stones~~ pavers and the edge retention header. String lines shall be used to hold all pattern lines true. The gaps at the edge of the paver surface shall be filled with pavers cut to fit. Cutting shall be accomplished to leave a clean edge to the traffic (vehicular or pedestrian) surface using a masonry saw cut.

After the pavers are in place, they shall be vibrated into the sand laying course using a vibrator capable of 3,000 to 5,000 pounds compaction force. This will require two passes at 90 degrees to each other. After vibration, approximately 1/4-inch of clean masonry sand containing at least 30 percent of 1/8-inch particles shall be placed over the paver surface, allowed to dry, and vibrated into the joints with additional vibrator passes and brushing so as to completely fill joints. Excess sand shall be swept from the surface.

The finished paver surface shall be tested longitudinally and transverse to the concrete header or curb with a 10-foot straightedge along the surface. Any deviation in excess of 1/8-inch shall be corrected at no additional cost to the Contracting Agency.

Any broken or damaged pavers shall be removed and replaced. Replacement pavers shall be tamped into place and the joints filled with masonry sand as specified herein. The completed installation shall be cleaned of all debris, surplus material and equipment.

342.4 MEASUREMENT AND PAYMENT:

Measurement will be the square foot. Payment will be made at the unit bid price per square foot. This payment shall be full compensation for all labor, materials, tools and equipment required to complete the work.

- End of Section -

Tech Spec 2

icpi
Interlocking Concrete Pavement Institute

Construction of Interlocking Concrete Pavements

Purpose

This technical bulletin gives construction guidelines to design professionals and contractors of interlocking concrete pavements. The bulletin reviews the steps in constructing an aggregate base, bedding sand and concrete pavers. This pavement structure is commonly used for pedestrian and vehicular applications. Pedestrian areas, driveways, and areas subject to limited vehicular use are paved with units $2^3/_8$ in. (60 mm) thick. Streets and industrial pavements should be paved with units at least $3^1/_8$ in. (80 mm) thick.

It is recommended that ICPI Certified Installers be utilized for the construction of interlocking concrete pavement. These individuals have attended training and have demonstrated their knowledge of the guidelines, materials and techniques specific to interlocking concrete pavement. ICPI maintains a list of Certified Installers on www.icpi.org .

Aggregate bases stabilized with asphalt or cement are recommended under very heavy loads, and over weak or saturated soil subgrades. These are sometimes used when adequate aggregates are not available or when a stabilized base is more economical than unstabilized aggregate. Refer to *Tech Spec 4–Structural Design of Interlocking Concrete Pavement for Roads and Parking Lots* when looking for additional information regarding the structural design of the base and subbase. *Tech Spec 4* is based on the design methods detailed in ASCE 58-10 *Structural Design of Interlocking Concrete Pavements for Municipal Streets and Roadways*.

Concrete pavers made in the U.S. should meet the requirements established in the American Society for Testing and Materials (ASTM) C 936, *Standard Specification for Solid Interlocking Concrete Paving Units.* Requirements of this standard include a minimum average compressive strength of 8,000 psi (55 MPa), average absorption no greater than 5%, resistance to at least 50 freeze-thaw cycles with average material loss not exceeding 1%, and conformance to abrasion resistance tests.

Concrete pavers made in Canada are required to meet requirements set forth by the Canadian Standards Association CSA-A231.2 *Precast Concrete Pavers*. This standard requires a minimum average cube compressive strength of 7,250 psi (50 MPa) or 5,800 psi (40 MPa) at delivery. There should be no greater than 500 g/m^2 of material lost after 50 freeze thaw test cycles while immersed in water with a 3% saline solution.

Installation steps include job planning, layout, excavating and compacting the soil subgrade, applying geotextiles (optional), spreading and compacting the sub-base and/or base aggregates, constructing edge restraints, placing and screeding the bedding sand, and placing concrete pavers. For larger installations mechanical placement of pavers may be more economical. Refer to *Tech Spec 11 –Mechanical Installation of Interlocking Concrete Pavements* for additional information.

Figure 1. Excavation of the soil subgrade and placing grade stakes.

Figure 2. Compacting the soil subgrade.

Figure 3. Application of the geotextile under aggregate base.

Job Planning

Prior to excavating, check with the local utility companies to ensure that digging does not damage underground pipes or wires. Many localities have one telephone number to call at least two days before excavation for marking utility line locations. Overhead clearances should be checked so that equipment does not interfere with wires. Site access by vehicles and equipment should be established so that the job can be built without delays.

Layout

In preparing for excavation, the area to be removed should be marked with stakes. See Figure 1. The stakes should be a slight distance away from the area to be removed so that they are not removed during excavation. The stakes should be marked to establish grades, or have string lines pulled and tied to them. Slopes should be a minimum of 1.5%. In the case of roads, the minimum longitudinal slope should be 1% with a minimum cross slope of 2%. Grade stakes should be checked periodically during the job to be sure that they have not been disturbed.

Excavating, Drainage and Compacting the Soil Subgrade

During and after excavation, the soil should be inspected for organic materials or large rocks. If organic materials, roots, debris, or rocks remain, they should be removed and replaced with clean, compacted backfill material. Free-standing water saturating the soil should be removed. After it is removed, low, wet areas can be stabilized with a layer of crushed stone and/or cement.

Typical 4 in. (100 mm) diameter perforated drainage pipes surrounded with minimum 3 in. (75 mm) of No. 57 or similar open-graded stone is wrapped in woven or non-woven geotextile as specified by the designer. The surface of the stone is even with the top of the compacted soil subgrade. The stone and geotextile pipe assembly is placed along the pavement perimeter to remove excess water in the subgrade soil and base. The perforated pipe should be sloped and directed to outlets at the sides or ends of the pavement. The pipe outlets should be covered with screens to prevent animal ingress. Drain pipes are recommended in clay soils or other slow draining soils subject to vehicular traffic. Soil subgrade drainage extends pavement performance to the extent that the small additional investment is returned many times in additional pavement service years.

Compaction of the soil subgrade is critical to the performance of interlocking concrete pavements. See Figure 2. Adequate compaction will minimize settlement. Compaction should be at least 98% of standard Proctor density as specified in ASTM D 698. However, modified Proctor density (ASTM D 1557) is

Table 1. Guide to the Application of Compaction Equipment to Various Soils *(Courtesy of Vibromax 2000 Co.)*

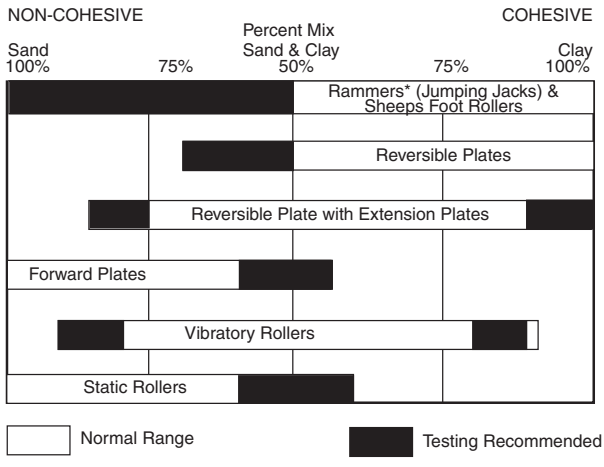

*Rammers work very well in sand if confined, as around abutments, foundations, etc.

Table 2. Geotextile Requirements for Separation

Geotextile Class		Class I [a]		Class II [a]		Class III [a]	
Elongation	**ASTM D 4632**	**< 50%**	**> 50%**	**< 50%**	**> 50%**	**< 50%**	**> 50%**
Grab Strength [b]	ASTM D 4632	315 lb [1400 N]	202 lb [900 N]	247 lb [1100 N]	157 lb [700 N]	180 lb [800 N]	112 lb [500 N]
Sewn Seam Strength [b,c]	ASTM D 4632	283 lb [1260 N]	182 lb [810 N]	223 lb [990 N]	142 lb [630 N]	162 lb [720 N]	101 lb [450 N]
Tear Strength [b]	ASTM D 4533	112 lb [500 N]	79 lb [350 N]	90 lb [400 N] [d]	56 lb [250 N]	67 lb [300 N]	40 lb [180 N]
Puncture Strength [b]	ASTM D 6241	618 lb [2750 N]	433 lb [1925 N]	495 lb [2200 N]	309 lb [1375 N]	371 lb [1650 N]	223 lb [990 N]
Permittivity [b,e]	ASTM D 4491	0.02 sec^{-1}					
Apparent Opening Size	ASTM D 4751	0.024 in [0.60 mm] maximum average roll value					
Ultraviolet Stability	ASTM D 4355	> 50% after 500 hr exposure					

[a] The severity of the installation conditions generally dictates the required geotextile class. Class I is the most severe and Class III is the least severe.
[b] All numeric values represent MARV in the weaker principal direction.
[c] When sewn seams are required.
[d] The required tear strength for woven monofiliment geotextiles if 250 N.
[e] Default Value. Permittivity of the geotextile should be greater than the soil.

preferred, especially for areas under constant vehicular traffic. This compaction standard may not be achievable in extremely saturated or very fine soils. Stabilization of the soil subgrade may be necessary in these situations.

Compaction equipment varies with the type of subgrade soil. Manufacturers of compaction equipment can provide guidance on which machines should be applied to various types of soil. Table 1 gives general guidance on applying the right machines to various soil types.

Monitoring soil moisture content is important to reaching the compaction levels described above. Soil moisture and density measurements should be taken to control and verify the degree of compaction. The moisture content and compacted density of the subgrade soil should be checked for compliance to specifications before installing geotextiles.

Applying Geotextiles (Optional)

Geotextile fabric may be used in areas where soil remains saturated part of the year, where there is freeze and thaw, or over clay and moist silty subgrade soils. See Figure 3. As a separation layer, geotextiles prevent the migration of soil into the aggregate base under loads, especially when saturated, thereby reducing the likelihood of rutting. When geotextiles are used they preserve the load bearing capacity of the base over a greater length of time than placement without them. Woven or non-woven fabric may be used under the base with a maximum apparent opening size of 0.60mm as testing using ASTM D 4751. Table 2 lists minumum requirements of geotextiles for soil separation. These requirements are from AASHTO M 288-06 *Standard Specification for Geotextile Specification for Highway Applications*. The minimum down slope overlap should be at least 12 in. (300 mm). Overlap requirements for low strength subgrades are detailed in Table 3.

Table 3. Geotextile Overlap Requirements

Soil CBR	Overlap
> 3.0	1.0 ft [0.3 m] to 1.5 ft [0.45 m]
1.0 to 3.0	2.0 ft [0.6 m] to 3.0 ft [1.0 m]
0.5 to 1.0	3.0 ft [1.0 m] or sewn
< 0.5	Sewn
All roll ends	3.0 ft [1.0 m]

Table 4. Grading Reqirements for Dense Graded Material

Sieve Size (Square Openings)	Design Range[(a)] % Passing		Job Mix Tolerance % Passing	
	Bases	**Subbases**	**Bases**	**Subbases**
2 in. (50 mm)	100	100	–2	–3
1½ in. (37.5 mm)	95-100	90-100	±5	±5
¾ in. (19 mm)	70-92	—	±8	—
⅜ in. (9.5 mm)	50-70	—	±8	—
No. 4 (4.75 mm)	35-55	30-60	±8	±10
No. 30 (600 µm)	12-25	—	±5	—
No. 200 (75 µm)	0-8[(b)]	0-12[(b)]	±3	±5

(a) Job mix formula should be selected with due regard to availability of materials in the area of the project. Job mix tolerances may permit acceptance of test results outside the design range.

(b) Determine by wet sieving. Where frost and free moisture are indicative of site conditions, a lower percentage passing the No. 200 (75 µm) sieve shall be specified.

Note: ASTM D 2940 corresponds closely to this National Stone Association developed specification. While local or state highway specifications may be substituted for the design ranges above, the fraction finer than the No. 200 (75 µm) sieve should be maintained.

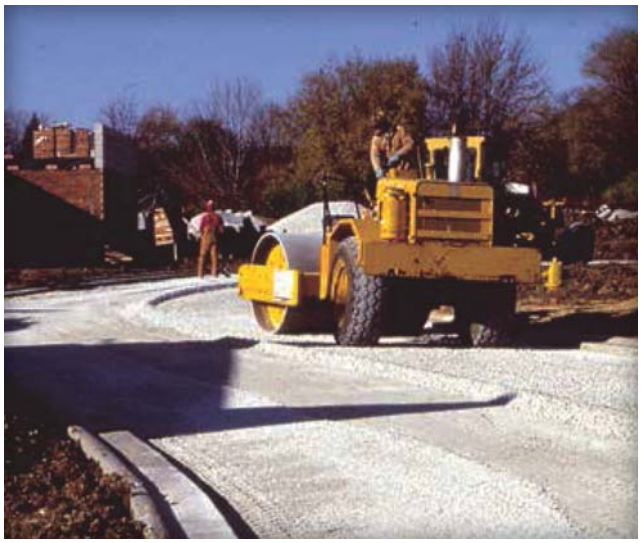

Figure 4. Base compaction with a vibratory roller.

When the fabric is placed in the excavated area, it should be turned up along the sides of the opening, covering the sides of the base layer. There should be no wrinkles on the bottom. When the aggregate is dumped on the fabric, the tires from trucks should be kept off the fabric to prevent wrinkling.

Spreading and Compacting the Subbase and/or Base Aggregates

Specifications typically used by cities, states, or provinces for aggregate base materials under flexible asphalt pavements are adequate for interlocking concrete pavements. If no specifications are available use the recommended grading for the aggregate base shown in Table 4. Spread and compact the base in 4 to 6 in. (l00 to 150 mm) lifts. High force compaction equipment can compact thicker lifts. Consult with compaction equipment manufacturer for guidance. Frozen base material should not be installed, nor should material be placed over a frozen soil subgrade.

The thickness of the base is determined by traffic, soil type, subgrade soil drainage and moisture, and climate. Sidewalks, patios and pedestrian areas should have a minimum base thickness (after compaction) of 4 in. (100 mm) over well-drained soils. Residential driveways on well-drained soils should be at least 6 in. (150 mm) thick. In colder climates, continually wet or weak soils will require that bases be at least 2 to 4 in. (50 to 100 mm) thicker.

Local, state or provincial engineering standards for base thickness can be applied to streets constructed with interlocking concrete pavers. Non freeze-thaw areas with well-drained soils should have at least a 6 in. (150 mm) thick base. Minimum base thicknesses for residential streets are 8 to 10 in. (200 to 250 mm). Greater thicknesses are often used in regions with numerous freeze-thaw cycles, expansive soils, or very cold climates. A qualified civil engineer familiar with local soils and traffic conditions should be consulted to determine the appropriate base thickness for streets and heavy-duty, industrial pavements.

Many localities determine base thickness with the 1993 *Guide for the Design of Pavement Structures* published by the American Association of State Highway and Transportation Officials (AASHTO). The AASHTO procedure calculates the structural number (SN) of the strength coefficients of each base and pavement layer. The SN is determined by assessing the traffic loads, soils, and environmental factors (e.g., drainage, freeze-thaw). The layer coefficient recommended for $3^1/_8$ in. (80 mm) thick pavers on 1 in. (25 mm) bedding sand is 0.44 per inch (25 mm), i.e., the SN = $4^1/_8$ x 0.44 = 1.82. Base thicknesses can be readily determined by using the charts in *ICPI Tech Spec 4, Structural Design of Interlocking Concrete Pavement for Roads and Parking Lots* or ICPI Structural Design Software.

Like compaction of the soil subgrade, adequate compaction of the base is critical to minimizing settlement of interlocking concrete pavements. See Figure 4. Special attention should be given to achieving compaction standards adjacent to edge restraints, catch basins and utility structures. When spread

Figure 5. Density testing of the aggregate base with a nuclear density gauge.

Figure 6a & 6b. Screeding the bedding sand.

and compacted, the aggregate base should be at its optimum moisture. Bases for pedestrian areas and residential driveways should be compacted a minimum 98% of standard Proctor density. For vehicular areas, compaction should be at least 98% of modified Proctor density as determined by ASTM D 1557, or AASHTO T180. While the highest percentage compaction (100%) is preferred, it may not be achievable on weak or saturated soils. Density measurements of the compacted base should be made with a nuclear density gauge or other methods approved by the local, state or provincial transportation department. See Figure 5. Unless otherwise specified, the compacted thickness of individual lifts should be $+^{3}/_{4}$ in. to $-^{1}/_{2}$ in. (+19 mm to –13 mm). Maintaining consistent lift thickness during compaction will help achieve consistent density. Variation in final base surface elevations should not exceed $\pm^{3}/_{8}$ in. (± 10 mm) when tested with a 10 ft. (3 m) straightedge.

The finished surface of a compacted aggregate base should not allow bedding sand to migrate into it. If the surface will allow ingress of bedding sand, a choke course of fine material can be spread and compacted into the surface, or a bitumen tack coat can be applied. The surface of the base course and its perimeter around the edge restraints should be inspected for areas that might allow sand to migrate after installation. Such locations can be joints in curbs, around utility structures or catch basins. These areas should be covered with a geotextile fabric to prevent loss of the bedding sand.

Constructing Edge Restraints

Edge restraints are a key part of interlocking concrete pavements. By providing lateral resistance to loads, they maintain continuity and interlock among the paving units. Aluminum, steel, plastic, or concrete are typical edge restraints. Consult *ICPI Tech Spec 3* on edge restraints for recommendations on applications and construction.

Figure 7. Placing the concrete pavers.

Figure 8. Saw cutting pavers.

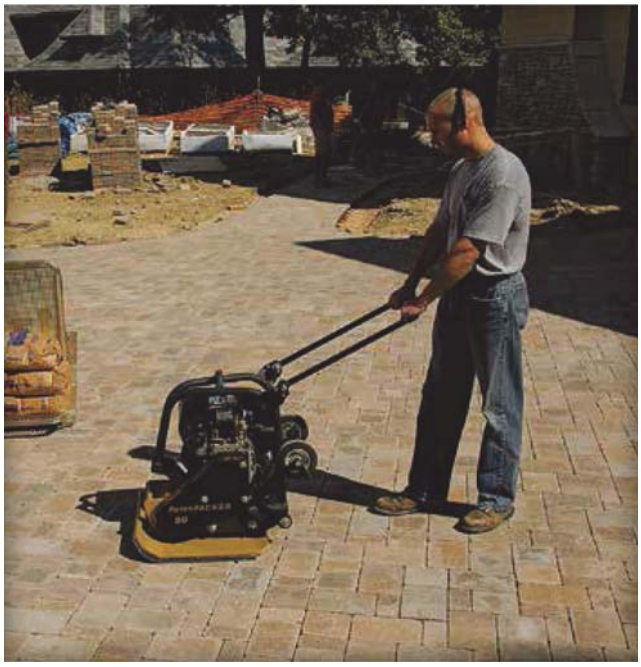

Figure 9. Compacting the pavers and bedding sand.

Figure 10. Spreading and sweeping joint sand.

Edge restraints must be set at the correct level, especially if the tops of the restraints are used for screeding the bedding sand. Their elevations should be checked prior to placing the sand and pavers. Edge restraints are typically installed before the bedding sand and pavers are laid. However, some restraints can be secured into the base as the laying progresses.

Placing and Screeding the Bedding Sand

Bedding sand under concrete pavers should conform to ASTM C 33 or CSA A23.1. This material is often called concrete sand. Masonry sand for mortar should never be used for bedding, nor should limestone screenings or stone dust. The bedding sand should have symmetrical particles, generally sharp, washed, with no foreign material. Waste screenings or stone dust should not be used, as they often do not compact uniformly and can inhibit lateral drainage of moisture in the bedding layer. *ICPI Tech Spec 17—Bedding Sand Selection for Interlocking Concrete Pavements in Vehicular Applications* provides additional guidance on selecting bedding sand.

Bedding sand should be spread and screeded to an uncompacted nominal 1 in. (25 mm) thickness. Frozen or saturated sand should not be installed. If there is an uneven base (due to inconsistent compaction or improper grading), the bedding sand should not be used to compensate for it. Over time, unevenness in the bedding sand will reflect through to the surface. Uneven areas on the base surface must be made even prior to placing the bedding sand.

Once the base is complete, screed pipes or rails are placed on it and the bedding sand spread over them. The sand is screeded or smoothed across the pipes with a straight and true strike board. See Figure 6. Screed pipes are removed and the resulting void filled with bedding sand. After the sand is screeded it should not be disturbed. Sufficient sand is placed and screeded to stay ahead of the placed pavers. Powered screeding machines that roll on rails and asphalt spreading machines adapted for screeding sand have been successfully used on larger installations to increase productivity.

Placing the Concrete Pavers

Concrete pavers can be placed in many patterns depending on the shapes. Herringbone patterns (45 or 90 degree) are recommended in all street applications, as these interlocking patterns provide the maximum load bearing support, and resist creep from starting, braking and turning tires. See Figure 7. Chalk lines snapped on the bedding sand or string lines pulled across the surface of the pavers are used as a guide to maintain straight joint lines. Buildings, concrete collars, inlets, etc., are generally not straight and should not be used for establishing straight joint lines.

Joint widths between the pavers should be consistent and be between $^{1}/_{16}$ and $^{3}/_{16}$ in. (2 and 5 mm). Some pavers are made with spacer bars on their sides. These maintain a minimum joint width, allowing the sand to enter between each unit. Pavers without spacers are generally not placed snug against each other since string lines guide consistent joint spacing.

Cut pavers should be used to fill gaps along the edge of

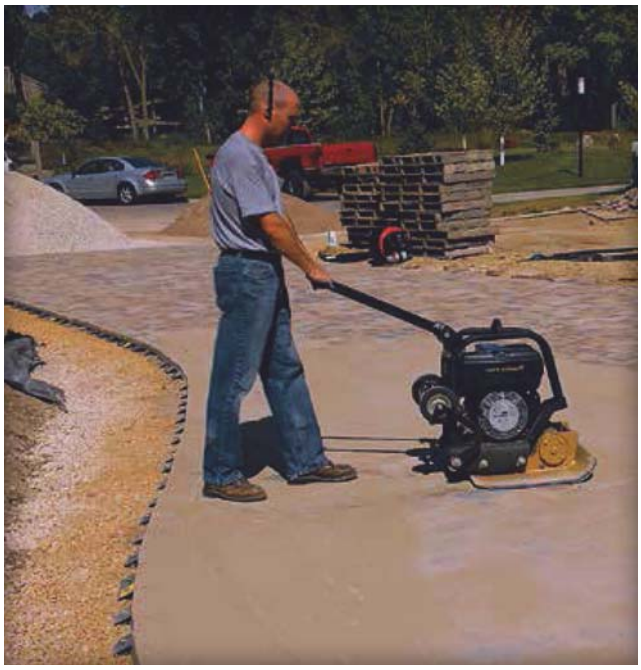

Figure 11. Vibrating sand into the joints.

the pavement. Pavers are cut with a double bladed splitter or a masonry saw. See Figure 8. A saw gives a smooth cut. Gaps greater than 3/8 in. (10 mm) should be filled with cut pavers. For street applications do not cut pavers to less than 1/3 their original size. Instead fill voids with two cut pavers.

After an area of pavers is placed, it should be compacted with a vibrating plate compactor, which should be capable of exerting a minimum of 5,000 lbs. (22 kN) of centrifugal compaction force and operate at 75-90 hertz. See Figure 9. At least two passes should be made across the pavers to seat the pavers in the bedding sand and force it into the joints at the bottom of the pavers.

Dry joint sand is swept into the joints and the pavers compacted again until the joints are full. See Figures 10 and 11. This may require two or three passes of the plate compactor. If the sand is wet, it should be spread to dry on the pavers before being swept and compacted into the joints. Joint sand may be finer than the bedding sand to facilitate filling of the joints. Bedding sand also can be used to fill the joints, but it may require extra effort in sweeping and compacting. Compaction should be within 6 ft (2 m) of an unrestrained edge or laying face. All pavers within 6 ft (2 m) of the laying face should have the joints filled and be compacted at the end of each day. Excess sand is then removed. See Figure 12. The remaining uncompacted edge can be covered with a waterproof covering if there is a threat of rain. This will prevent saturation of the bedding sand, minimizing removal and replacement of the bedding sand and pavers.

Final surface elevations should not vary more than ±3/8 in. (±10 mm) under a 10 ft (3 m) straightedge, unless otherwise specified. Bond or joint lines should not vary ±1/2 in. (13 mm) over 50 ft (15 m) from taut string lines. The top of the pavers should be 1/8 to 3/8 in. (3 to 10 mm) above adjacent catch basins, utility covers, or drain channels, with the exception of areas required to meet ADA design guideline tolerances. The top of the installed pavers may be 1/8 to 1/4 in. (3 to 6 mm) above the final elevations to compensate for possible minor settling. A small amount of settling is typical of all flexible pavements. Optional sealers or joint sand stabilizers may be applied. See *ICPI Tech Spec 5–Cleaning, Sealing and Joint Sand Stabilization*

Figure 12. Excess sand swept from the finished surface will make the pavement ready for traffic.

Figure 13. The completed paved area from Figure 12 receives tank traffic at the U.S. Army Proving Grounds in Aberdeen, Maryland.

of Interlocking Concrete Pavement for further guidance.

ICPI Tech Spec 9–A Guide Specification for the Construction of Interlocking Concrete Pavement helps translate construction methods and procedures described here into a construction document. *Tech Spec 9* provides a template for developing project-specific materials and installation specifications for the bedding and joint sand, plus the concrete pavers. Additional guide specifications and detail drawings for varioius applications are available at www.icpi.org as well as ICPI Tech Specs. Other ICPI Tech Specs and technical manuals should be referenced for information on design, detailing, construction and maintenance.

References

American Association of State Highway and Transportation Officials, *Standard Specification for Geotextile Specification for Highway Applications M288-06*, Washington, D.C., 2006

Interlocking Concrete Pavement Institute, *Concrete Paver Installer Course Handbook* Eighth Edition, Washington D.C., October 2011.

National Stone Association, *Flexible Pavement Design Guide for Roads and Streets.* Fourth Edition, Washington, D.C., January 1985.

National Stone Association, *Stone Base Construction Handbook,* Second Edition, Washington, D.C., September 1988.

Figures 1,2, 6, 7, 9, 10, 12 are courtesy of the Waterways Experiment Station, U.S. Army Corps of Engineers. Figure 5 is courtesy of the Portland Cement Association.

icpi
Interlocking Concrete Pavement Institute

14801 Murdock Street
Suite 230
Chantilly, VA 20151

In Canada:
P.O. Box 1150
Uxbridge, ON L9P 1N4
Canada

Tel: 703.657.6900
Fax: 703.657.6901
E-mail: icpi@icpi.org
www.icpi.org