

**UNIFORM STANDARD
DETAILS**

for

**PUBLIC WORKS
CONSTRUCTION**

**SPONSORED and DISTRIBUTED
by the**



2012 EDITION

ARIZONA

~~AWC~~ Includes ~~GF~~4 revisions)

100 SERIES: GENERAL INFORMATION

Detail	Revised	Title
101	2011	GENERAL INFORMATION
110-1	2011	PLAN SYMBOLS (SYMBOLS)
110-2	2011	PLAN SYMBOLS (LINE TYPES)
112	1998	DIMENSIONING FOR ROAD IMPROVEMENT PLANS
120	2014 *	SURVEY MARKER
122	2011	PAVEMENT MARKER FOR FIRE HYDRANTS
130	2003	BARRICADES
131	1998	STREET SIGN BASE
140	2009	BOLLARD
141	2009	HAZARD MARKER
145	2011	SAFETY RAIL
150	1998	PRECAST SAFETY CURB
160	2013	6' CHAIN LINK FENCE AND GATE

200 SERIES: STREET INFORMATION

Detail	Revised	Title
200-1	2010	BACKFILL, PAVEMENT AND SURFACE REPLACEMENT
200-2	2010	BACKFILL, PAVEMENT AND SURFACE REPLACEMENT
201	2014 *	ASPHALT PAVEMENT EDGE DETAILS
202	1998	ALLEY DETAILS (PAVED AND UNPAVED)
203	1998	SCUPPERS
204	1998	EQUIPMENT CROSSING
205	2006	PAVED TURNOUTS
206-1	2007	CONCRETE SCUPPER
206-2	2007	CONCRETE SCUPPER
206-3	2007	CONCRETE SCUPPER (ISOMETRIC VIEW)
210	2012	RESIDENTIAL SPEED HUMP
211	1998	STANDARD TRENCH PLATING DETAIL
212	2012	UTILITY POTHOLE REPAIR
220-1	2007	CURB AND GUTTER TYPES A, B, C AND D
220-2	2007	CURB AND GUTTER TYPES E AND E
221	2014 *	CURB AND GUTTER TRANSITION TYPE A TO TYPE C, INTEGRAL ROLL CURB, GUTTER AND SIDEWALK
222	2008	SINGLE CURB - TYPES A, B AND TERMINATION
223	1998	MEDIAN NOSE TRANSITION
224	1998	JOINT FOR DRAINAGE INLETS AND MANHOLE COVERS
225	2005	CONCRETE PAVERS
230	2014 *	SIDEWALKS
234	2012	CURB MODIFICATION AT DETECTABLE WARNING
235-1	2012	CURB RAMPS (TYPE A)
235-2	2012	CURB RAMPS (TYPE B)
235-3	2012	CURB RAMPS (TYPE C)
235-4	2011	CURB RAMPS (TYPE D)
235-5	2011	CURB RAMPS (TYPE E)

200 SERIES: STREET INFORMATION (CONTINUED)

Detail	Revised	Title
240	2010	VALLEY GUTTER
250-1	2014 *	DRIVEWAY ENTRANCES WITH DETACHED SIDEWALK
250-2	2013	DRIVEWAY ENTRANCES WITH SIDEWALK ATTACHED TO CURB
251	2003	RETURN TYPE DRIVEWAYS
252	2005	BUS BAYS
260	2013	ALLEY ENTRANCE (WITH VERTICAL CURB AND GUTTER)
262	2012	WING TYPE ALLEY ENTRANCE (WITH COMBINED CURB AND GUTTER)
263	2002	WING TYPE ALLEY ENTRANCE (WITH ROLL TYPE CURB AND GUTTER)
270	2014 *	FRAME AND COVER (AND GRADE ADJUSTMENTS)

300 SERIES: WATER INFORMATION

Detail	Revised	Title
301	1998	BLOCKING FOR WATER GATE AND BUTTERFLY VALVES
302-1	1998	JOINT RESTRAINT WITH TIE RODS (DRAWING)
302-2	1998	JOINT RESTRAINT WITH TIE RODS (NOTES)
303-1	1998	JOINT RESTRAINT FOR DUCTILE IRON AND POLYETHYLENE WRAPPED DUCTILE IRON WATER PIPES (DRAWING)
303-2	1998	JOINT RESTRAINT FOR DUCTILE IRON AND POLYETHYLENE WRAPPED DUCTILE IRON WATER PIPES (TABLES)
310	1998	CAST IRON WATER METER BOX COVER NO. 1
311	1998	CAST IRON WATER METER BOX COVER NO. 2
312	1998	CAST IRON WATER METER BOX COVER NO. 3
313	1998	CAST IRON WATER METER BOX COVER NO. 4
314	1998	CAST IRON WATER METER BOX COVER NO. 5
320	1998	CONCRETE WATER METER BOXES
321	1998	STANDARD WATER METER VAULT
340	2002	INSTALLING TAPPING SLEEVES AND VALVES
342	1998	CONCRETE PRESSURE PIPE TAPPING SLEEVE
345-1	1998	3", 4", 6" WATER METER
345-2	1998	4", 6" WATER METER WITH ON-SITE HYDRANTS
346	1998	FIRE LINE DETECTOR CHECK VAULT
360-1	2013	DRY BARREL FIRE HYDRANT INSTALLATION
360-2	2013	WET BARREL FIRE HYDRANT INSTALLATION
360-3	2013	FIRE HYDRANT INSTALLATION DETAILS
362	1999	LOCATIONS FOR NEW FIRE HYDRANTS
370	1998	VERTICAL REALIGNMENT OF WATER MAINS
380	1998	THRUST BLOCKS FOR WATER LINES
381	1998	ANCHOR BLOCKS FOR VERTICAL BENDS
389	2001	CURB STOP WITH VALVE BOX AND COVER
390	1998	CURB STOP WITH FLUSHING PIPE
391-1	2014 *	VALVE BOX INSTALLATION AND GRADE ADJUSTMENT
391-2	2001	VALVE BOX INSTALLATION AND GRADE ADJUSTMENT
392	2001	DEBRIS CAP INSTALLATION

* NEWLY REVISED.

400 SERIES: SEWER INFORMATION

Detail	Revised	Title
403-1	1998	PIPE SUPPORT ACROSS TRENCHES
403-2	1998	PIPE SUPPORT ACROSS TRENCHES
403-3	1998	ALTERNATIVE TO PIPE SUPPORT
404-1	2006	WATER AND SANITARY SEWER SEPARATION/PROTECTION
404-2	2006	WATER AND SANITARY SEWER SEPARATION/PROTECTION
404-3	2006	WATER AND SANITARY SEWER SEPARATION/PROTECTION
405	1998	BROKEN SEWER LINE REPLACEMENT
420-1	2004	PRE-CAST CONCRETE SEWER MANHOLE
420-2	2001	PRE-CAST CONCRETE SEWER MANHOLE
421	2012	OFFSET MANHOLE 8" TO 30" PIPE
422	2012	BRICK SEWER MANHOLE AND COVER FRAME ADJUSTMENT
423-1	2012	24" CAST IRON MANHOLE FRAME AND COVER
423-2	2012	30" CAST IRON MANHOLE FRAME AND COVER
424-1	2012	24" CAST IRON WATERTIGHT MANHOLE FRAME AND COVER
424-2	2012	30" CAST IRON WATERTIGHT MANHOLE FRAME AND COVER
425	1998	24" ALUMINUM MANHOLE FRAME AND COVER
426	2007	DROP SEWER CONNECTIONS
427	1998	STUB OUT AND PLUGS
428	1998	MANHOLE STEPS
429	1998	INDUSTRIAL WASTE CONTROL VAULT WITH MANHOLE
440-1	2007	TYPE 'A' SEWER BUILDING CONNECTION - ELECTRONIC BALL MARKERS (STANDARD)
440-2	2007	TYPE 'B' SEWER BUILDING CONNECTION - TWO-WAY CLEANOUT AND METER BOX AT R/W
440-3	2007	TYPE 'C' SEWER BUILDING CONNECTION - ONE-WAY CLEANOUT AND METER BOX
440-4	2006	SEWER SERVICE CURB CROSSING STAMP DETAIL
441	2001	SEWER CLEANOUT


500 SERIES: IRRIGATION AND STORM DRAIN INFORMATION

Detail	Revised	Title
501-1	2012	HEADWALL
501-2	2012	HEADWALL
501-3	1998	HEADWALL 42" TO 84" PIPE
501-4	1998	HEADWALL IRRIGATION 18" TO 60" PIPE
501-5	2014 *	HEADWALL DROP INLET
502-1	1998	TRASH RACK
502-2	2004	TRASH RACK
503	1998	IRRIGATION STANDPIPE
504	1998	CONCRETE BLOCK JUNCTION BOX
505	1998	CONCRETE PIPE COLLAR
506	1998	IRRIGATION VALVE INSTALLATION
507	1998	ENCASED CONCRETE PIPE (FOR SHALLOW INSTALLATION)
510	1998	CORRUGATED METAL PIPE AND INSTALLATION


500 SERIES: IRRIGATION AND STORM DRAIN INFORMATION (CONTINUED)

Detail	Revised	Title
520	1998	STORM DRAIN MANHOLE BASE (48" AND SMALLER)
521	1998	STORM DRAIN MANHOLE BASE (51" OR LARGER)
522	1998	STORM DRAIN MANHOLE SHAFT
523-1	1998	PRESSURE MANHOLE
523-2	1998	PRESSURE MANHOLE
524	1998	STORM DRAIN LATERAL PIPE CONNECTIONS
530	1998	3'-6" CURB OPENING CATCH BASIN - TYPE 'A'
531	1998	5'-6" CURB OPENING CATCH BASIN - TYPE 'B'
532	1998	8'-0" CURB OPENING CATCH BASIN - TYPE 'C'
533-1	1998	CATCH BASIN TYPE 'D'
533-2	1999	APRON FOR TYPE 'D' CATCH BASIN
533-3	2007	FRAME AND GRATE FOR TYPE 'D' CATCH BASIN
533-4	2007	7'-0" CURB OPENING CATCH BASIN TYPE 'D' - GRATE DETAILS
534-1	1998	CATCH BASIN TYPE 'E'
534-2	1998	CATCH BASIN TYPE 'E' (DETAILS)
534-3	1998	CATCH BASIN TYPE 'E' (DETAILS)
534-4	1998	CATCH BASIN TYPE 'E' (DETAILS)
534-5	1998	ALTERNATE GRATE STYLES, SUMP LOCATION
535	2009	CATCH BASIN TYPE 'F' (FOR USE WITHOUT CURB)
536-1	1999	COMMON DETAILS AND SECTIONS FOR CURB OPENING CATCH BASINS
536-2	1998	ALTERNATIVE COVER FOR CURB OPENING CATCH BASINS
537	2002	CATCH BASIN TYPE 'G'
538	1998	CATCH BASIN TYPE 'H'
539	1998	GRATES FOR CATCH BASINS, TYPE G AND H
540-1	1998	CATCH BASIN GRATES
540-2	1998	CATCH BASIN GRATES
541	2005	CATCH BASIN SUBGRADE DRAIN
545	1998	END SECTION - REINFORCED CONCRETE PIPE
550	1998	SPILLWAY INLET AND OUTLET
552	2009	CONCRETE CUT-OFF WALLS
555	2010	EROSION PROTECTION/GABIONS

* NEWLY REVISED.

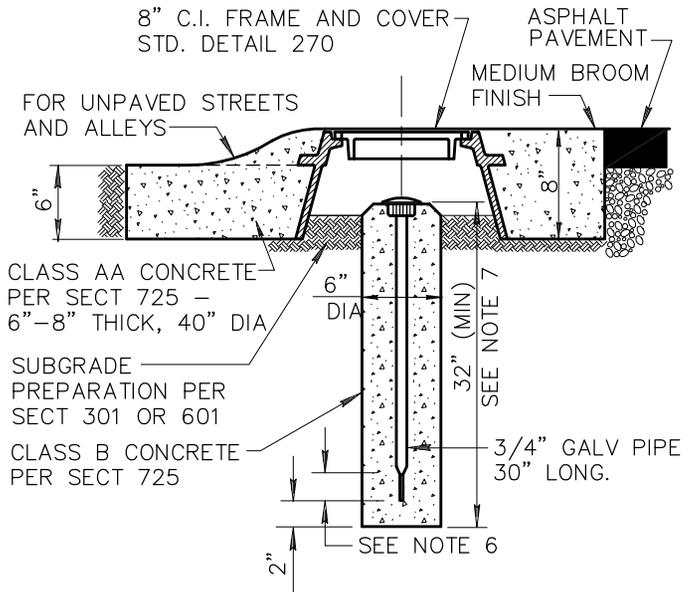

TYPE 'A'
(WITH FRAME)

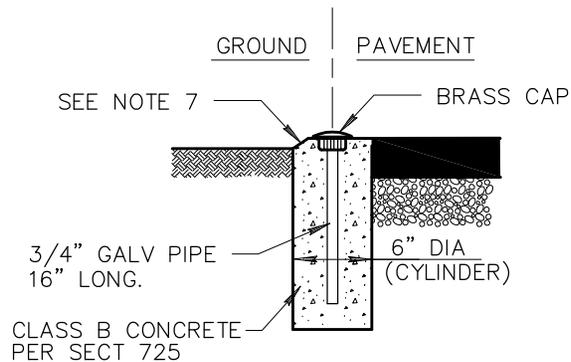


TYPE 'B'
(WITHOUT FRAME)


NOTES:

1. TYPE 'A' TO BE USED AT INTERSECTIONS OF MAJOR STREETS & COLLECTOR STREETS, SECTION CORNERS, SECTION 1/4 CORNERS, CENTER OF SECTIONS, AND AT OTHER POINTS AS SHOWN ON PLANS.
2. TYPE 'B' TO BE USED (EXCEPT WHERE TYPE 'A' IS SPECIFIED) AT INTERSECTION OF STREET CENTERLINES, PC'S, PT'S AND PI'S OF CURVES, SECTION 1/16 CORNERS, SUBDIVISION CORNERS, CHANGE IN ALIGNMENT OF SUBDIVISION BOUNDARIES, AND AT OTHER POINTS AS SHOWN ON PLANS.
3. TYPE 'C' TO BE USED AT CORNERS OF AND CHANGE IN ALIGNMENT OF SUBDIVISION BOUNDARIES WHERE CORNERS OR CHANGES IN ALIGNMENT FALL OUTSIDE OF PAVED AREAS OR UNPAVED ALLEYS AND STREETS.
4. CAP TO BE CONSTRUCTED OF RED BRASS OR BRONZE.
5. LETTERS TO BE APPROX. 1/32" WIDE & 1/32" DEEP.
6. FLATTENING THE BOTTOM 2" OF THE GALVANIZED PIPE IS OPTIONAL.
7. TOP OF CONCRETE POST IS CHAMFERED 3/4" EXCEPT WHEN SET FLUSH WITH PAVEMENT.
8. THE CAP SHALL SHOW THE POINT SURVEYED BY A PUNCH MARK OR SCRIBED CROSS AND THE CAP SHALL BE STAMPED WITH THE YEAR AND THE REGISTERED LAND SURVEYOR'S (RLS) REGISTRATION NUMBER.
9. WHEN APPLICABLE, THE CAP SHALL BE STAMPED WITH THE APPROPRIATE PUBLIC LAND MARKING PER CURRENT MANUAL OF INSTRUCTIONS FOR THE SURVEY OF PUBLIC LANDS OF THE UNITED STATES, PREPARED BY THE BUREAU OF LAND MANAGEMENT.
10. SUBMIT TO THE ENGINEER A COPY OF THE RECORDED CORNER RECORD OR RESULTS OF SURVEY TO DOCUMENT COMPLIANCE WITH THE ARIZONA BOARD OF TECHNICAL REGISTRATION REQUIREMENTS.




1/16" BORDER FROM EDGE OF CAP TO TOP OF 1/4" LETTERING.

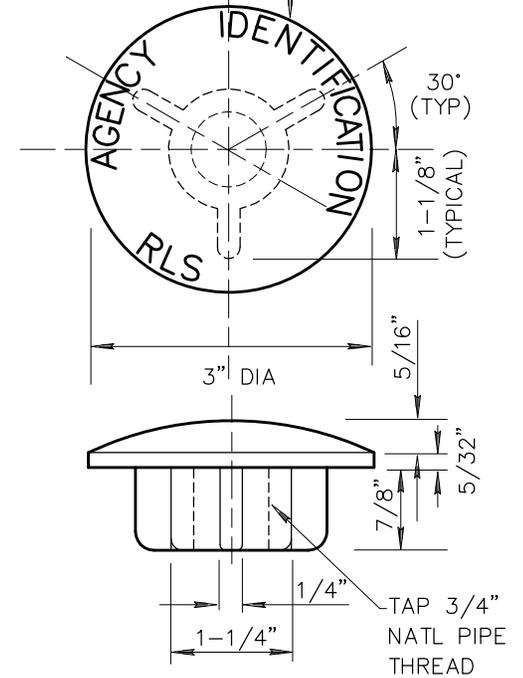

CAP DETAIL

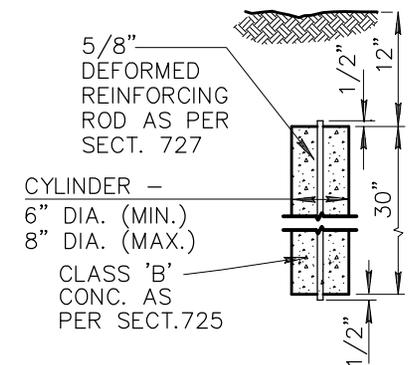

TYPE 'C'

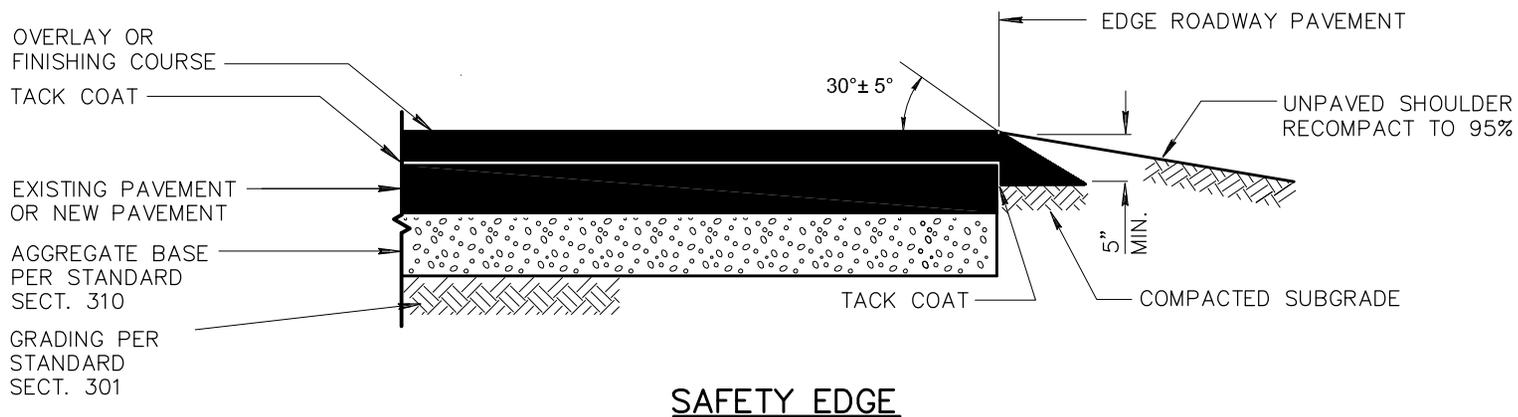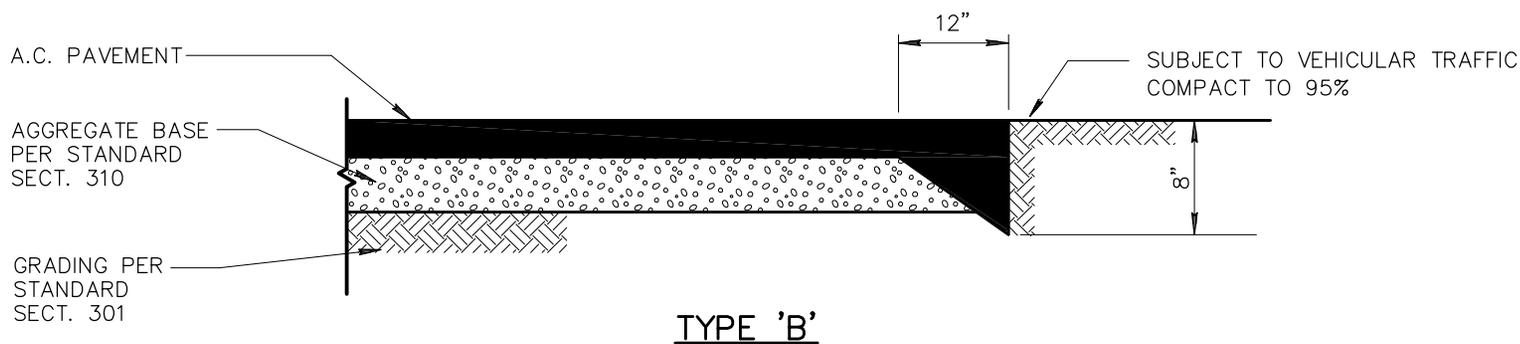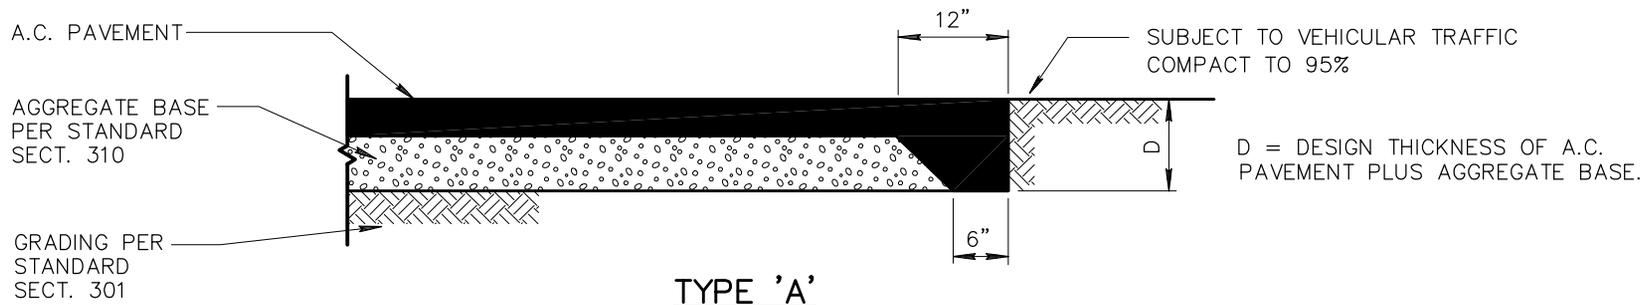

DETAIL NO.

201



STANDARD DETAIL
ENGLISH

ASPHALT PAVEMENT EDGE DETAILS


DATE

01-01-2014


DETAIL NO.

201

CURB TRANSITION TYPE 'A' TO TYPE 'C'

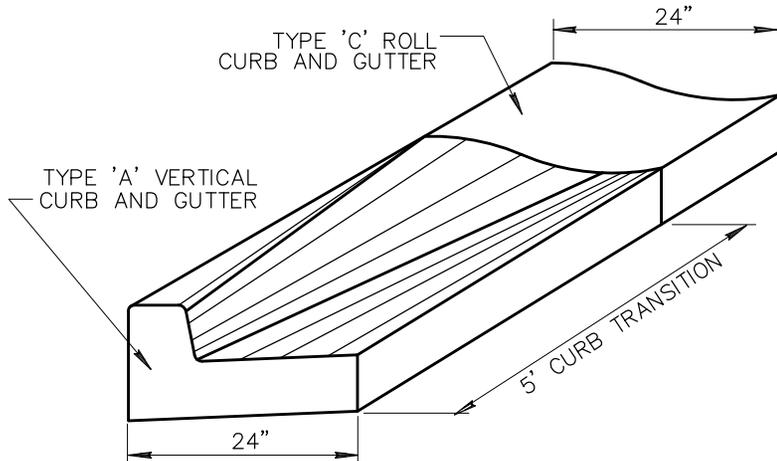


CURB AND GUTTER TRANSITION

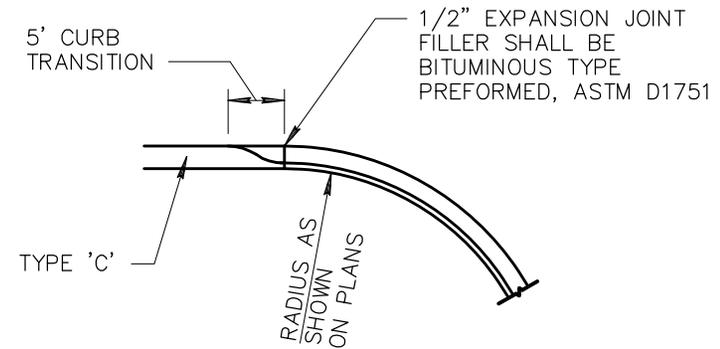

NOTES: (CURB AND GUTTER TRANSITIONS)

1. TRANSITIONS WILL BE PAID FOR AS THE PREDOMINANT TYPE OF CURB AND GUTTER BEING TRANSITIONED. WHEN TYPE 'A' CURB AND GUTTER ARE USED AT CURB RETURNS AND TYPE 'C' CURB AND GUTTER IS PREDOMINANTLY USED ELSEWHERE, THE TYPE 'A' TO TYPE 'C' TRANSITIONS SHALL BE MEASURED AND PAID FOR AS TYPE 'C' CURB AND GUTTER.
2. WHERE PROPOSED CONSTRUCTION IS TO BE CONNECTED TO EXISTING CURB AND GUTTER, THE TRANSITION SHALL BE INDICATED ON PLANS.
3. CLASS 'B' CONCRETE PER SECTION 725.
4. TRANSITION BETWEEN TYPICAL SECTIONS SHALL BE ACCOMPLISHED BY THE USE OF DIRECT STRAIGHT LINE TRANSITIONS OF THE FLOW LINE AND OTHER SURFACE FEATURES.

INTEGRAL ROLL CURB, GUTTER AND SIDEWALK

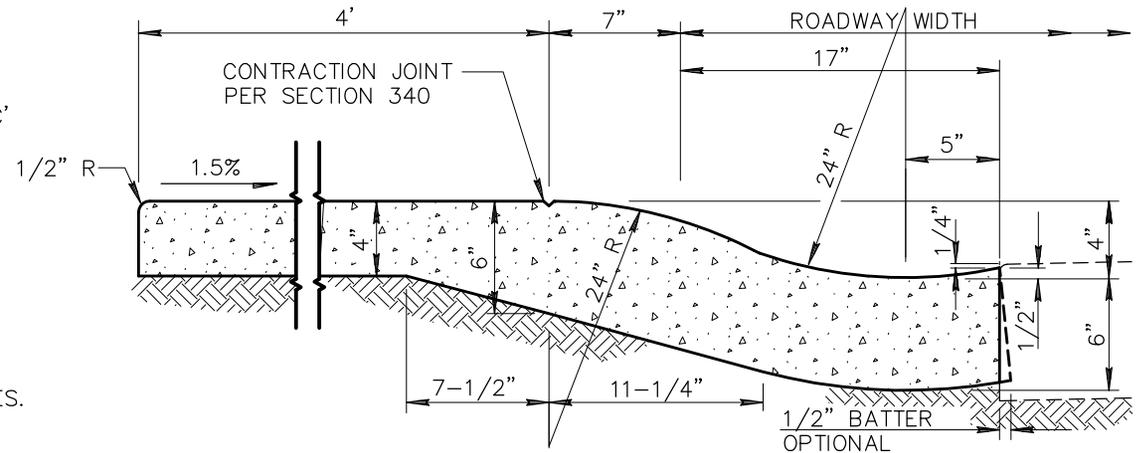

NOTES: (INTEGRAL ROLL CURB, GUTTER AND SIDEWALK)

1. CONCRETE TO BE MONOLITHIC POUR. EXPOSED SURFACE FINISH AS PER SIDEWALK AND GUTTER DETAIL.
2. CONTRACTION JOINT SPACING 5' MAXIMUM.
3. EXPANSION JOINTS PER SECTION 340.
4. CLASS 'B' CONCRETE PER SECTION 725.

DETAIL NO.

221



STANDARD DETAIL
ENGLISH



CURB AND GUTTER TRANSITION TYPE A TO TYPE C
INTEGRAL ROLL CURB, GUTTER AND SIDEWALK

REVISED

01-01-2014


DETAIL NO.

221

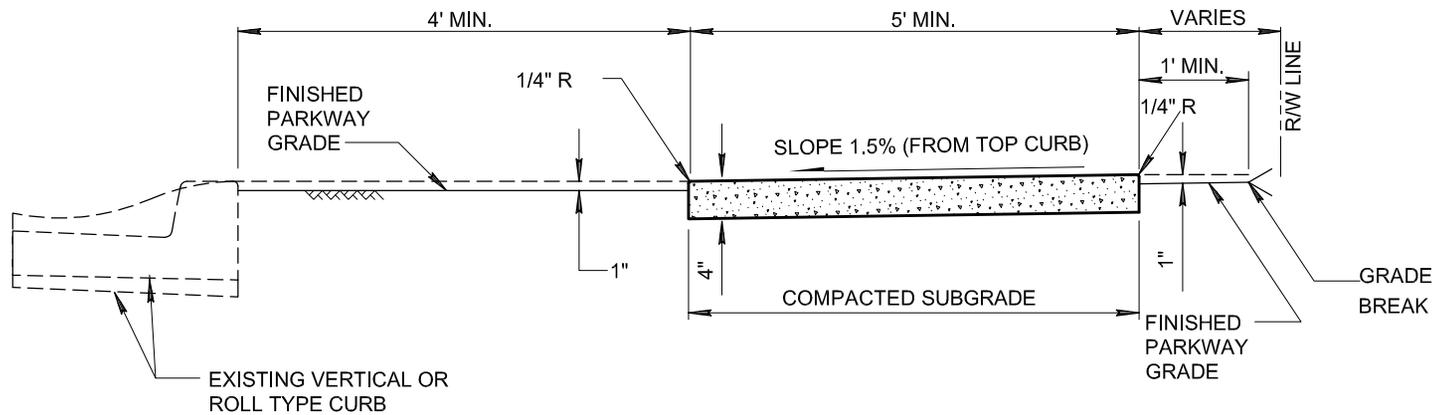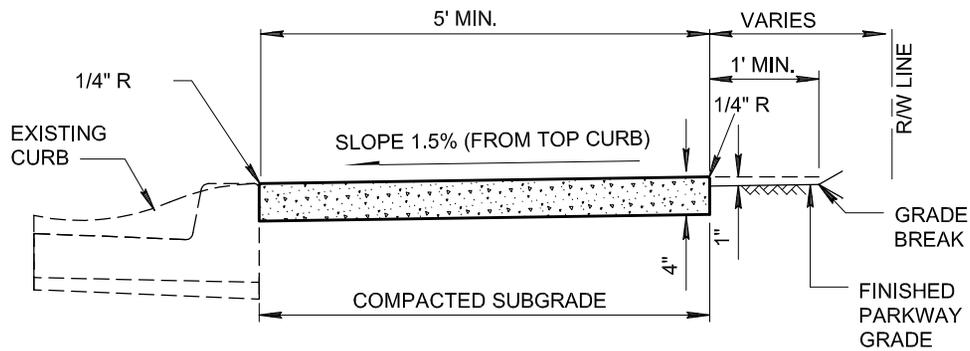


NOTES:

1. SIDEWALK CONSTRUCTION SHALL CONFORM TO SECTION 340.
2. EXPANSION JOINTS SHALL BE 1/2" BITUMINOUS TYPE PREFORMED EXPANSION JOINT FILLER, PER SECTION 729.
3. LARGE AGGREGATE, IN CONTRACTION JOINT SHALL BE SEPARATED TO A DEPTH OF 1", FINISH DEPTH SHALL BE A MINIMUM OF 3/4".
4. EXPANSION JOINTS SHALL CONFORM TO SECTION 340, BE INSTALLED PRIOR TO CONCRETE PLACEMENT, AND AT A MAXIMUM SPACING OF 50'.
5. CONCRETE SHALL BE CLASS 'B' PER SECTION 725.
6. WHEN SIDEWALK AND ADJACENT CURB ARE CONSTRUCTED MONOLITHICALLY, ALL EXPANSION AND CONTRACTION JOINTS SHALL EXTEND ACROSS THE CURB.

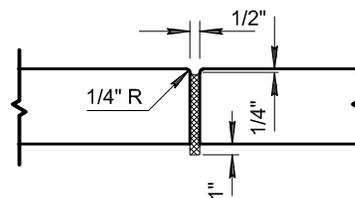

EXPANSION JOINT

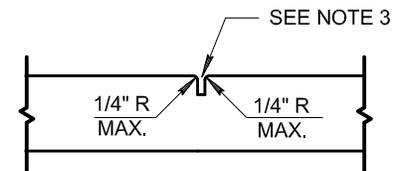

CONTRACTION JOINT

DETAIL NO.

230



STANDARD DETAIL
ENGLISH


SIDEWALKS

REVISED

01-01-2014

DETAIL NO.



230

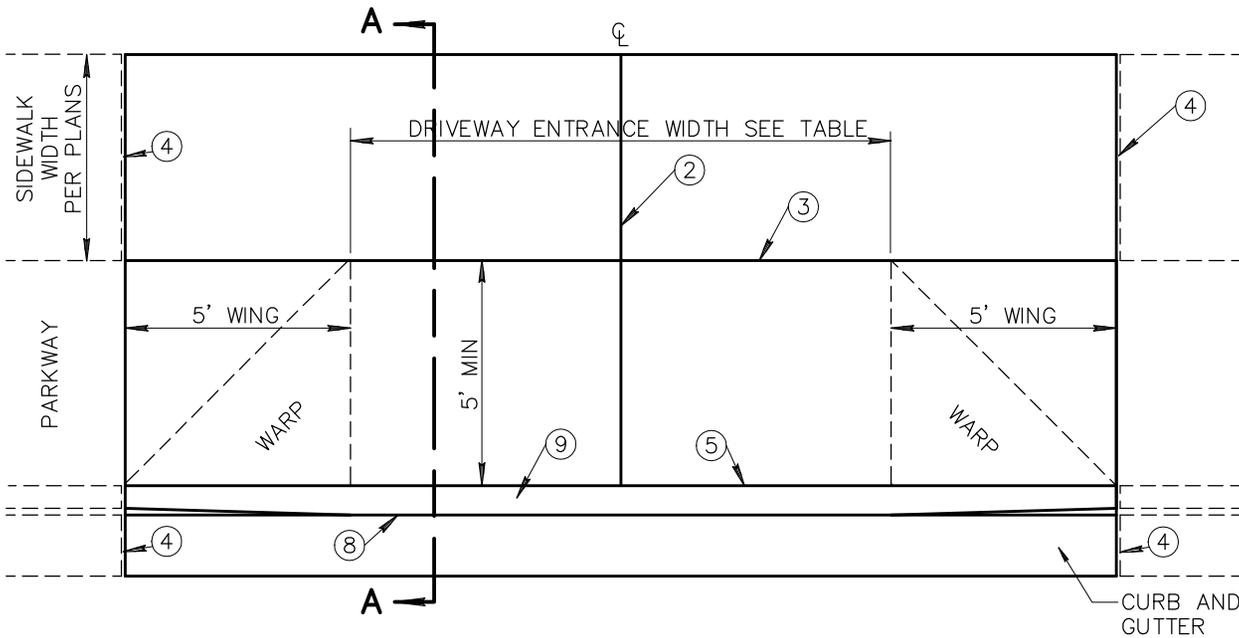

DRIVEWAY WITH DETACHED SIDEWALK

NOTES:

1. DEPRESSED CURB SHALL BE PAID FOR AT THE CONTRACT UNIT PRICE FOR THE TYPE OF CURB USED AT THAT LOCATION.
2. CONTRACTION JOINT ON D/W CENTERLINE.
3. CONTRACTION JOINT.
4. 1/2-INCH EXPANSION JOINTS SHALL COMPLY WITH SECTION 340.
5. BACK OF CURB – CONSTRUCTION JOINT.
6. CONCRETE CLASS AS NOTED IN TABLE. CONCRETE PER SECTION 725.
7. SUBGRADE PREPARATION, SECT. 301.
8. FLOW LINE OF GUTTER.
9. DEPRESSED CURB.
10. SECT. A-A AND ELEVATION: D/W SHOWN WITH VERTICAL CURB AND GUTTER, ROLL TYPE CURB AND GUTTER TREATED SIMILARLY.
11. ROUGH BROOM FINISH FULL WIDTH OF RAMP AND WINGS.
12. TROWEL AND USE LIGHT HAIR BROOM FINISH FOR WALKWAY AREA.
13. 'DRIVEWAY ENTRANCE WIDTH' IS THE DRIVEWAY WIDTH PLUS ADDITIONAL WIDENING REQUIRED BY THE LOCAL JURISDICTION.
14. ELEVATION AT TOP OF DRIVEWAY RAMP SHALL BE EQUAL TO OR HIGHER THAN NORMAL CURB ELEVATION.

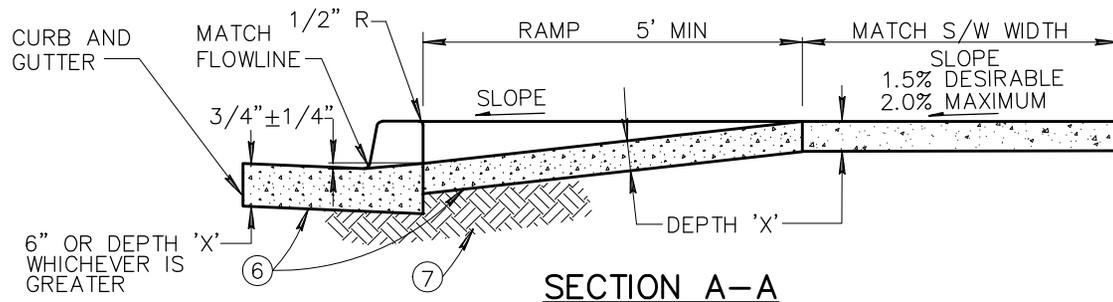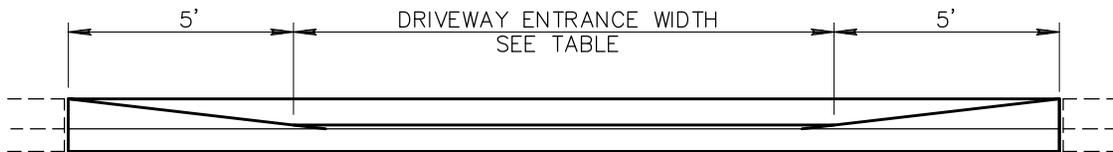

SECTION A-A

COMMERCIAL AND INDUSTRIAL				
DRIVEWAY ENTRANCE WIDTH	MIN.	MAX.	CLASS	DEPTH 'X'
COMMERCIAL	* 16'	40'	A	9"
INDUSTRIAL	* 16'	40'	A	9"
* 24' MIN. FOR TWO WAY TRAFFIC				
RESIDENTIAL				
DRIVEWAY ENTRANCE WIDTH	MIN.	MAX.	CLASS	DEPTH 'X'
MAJOR STREET	16'	30'	B	5"
COLLECTOR STREET	* 12'	30'	B	5"
LOCAL STREET	12'	30'	B	5"
* 16' DESIRABLE				

DETAIL NO.
250-1





STANDARD DETAIL
ENGLISH



**DRIVEWAY ENTRANCES WITH
DETACHED SIDEWALK**

REVISED
01-01-2014

DETAIL NO.
250-1

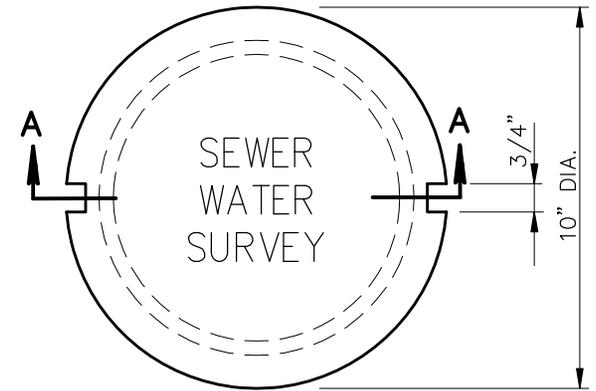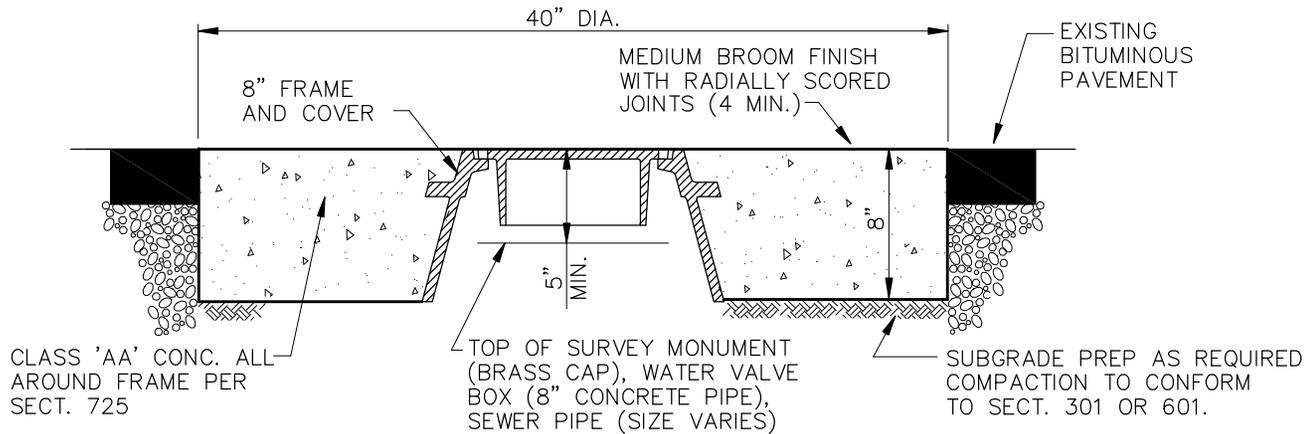

**CLEAN OUT FRAME & GRADE ADJUSTMENT
WATER VALVE, SURVEY MONUMENT, OR SEWER**

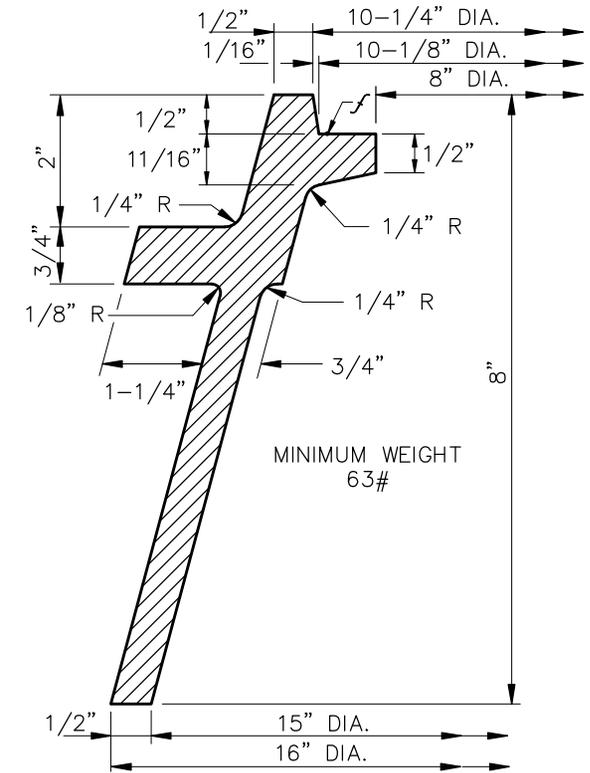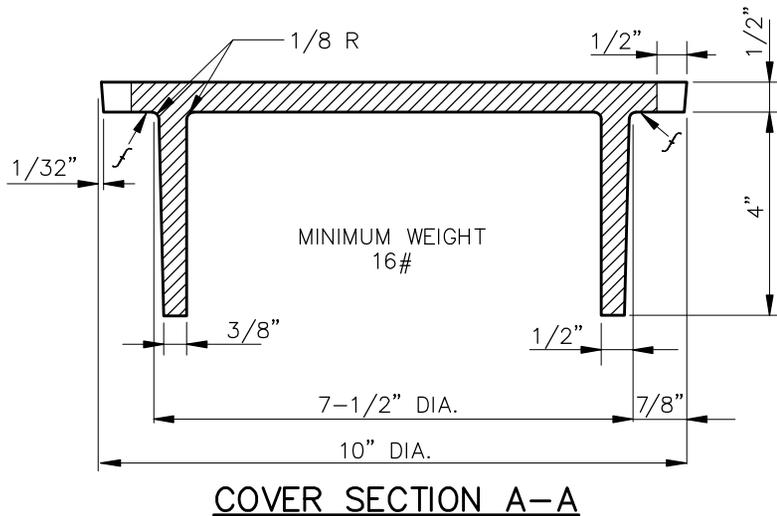

8" C.I. FRAME AND COVER

NOTES:

1. CASTING TO CONFORM TO SECT. 787.
2. LETTERS ON COVER TO BE AS FOLLOWS:
"SEWER", "WATER", OR "SURVEY" AS DIRECTED TOTAL WIDTH OF WORD "SEWER" OR "WATER" 3-3/4". TOTAL WIDTH OF WORD "SURVEY" 4-1/2". LETTER SIZE 5/8" x 3/4", RAISED 1/16" ABOVE LEVEL OF COVER, TYPE OF LETTERS TO BE SUBMITTED FOR APPROVAL.
3. /s/ INDICATES MACHINE FINISHED SURFACE.

DETAIL NO.

270



STANDARD DETAIL
ENGLISH


FRAME AND COVER

REVISED

01-01-2014

DETAIL NO.

270

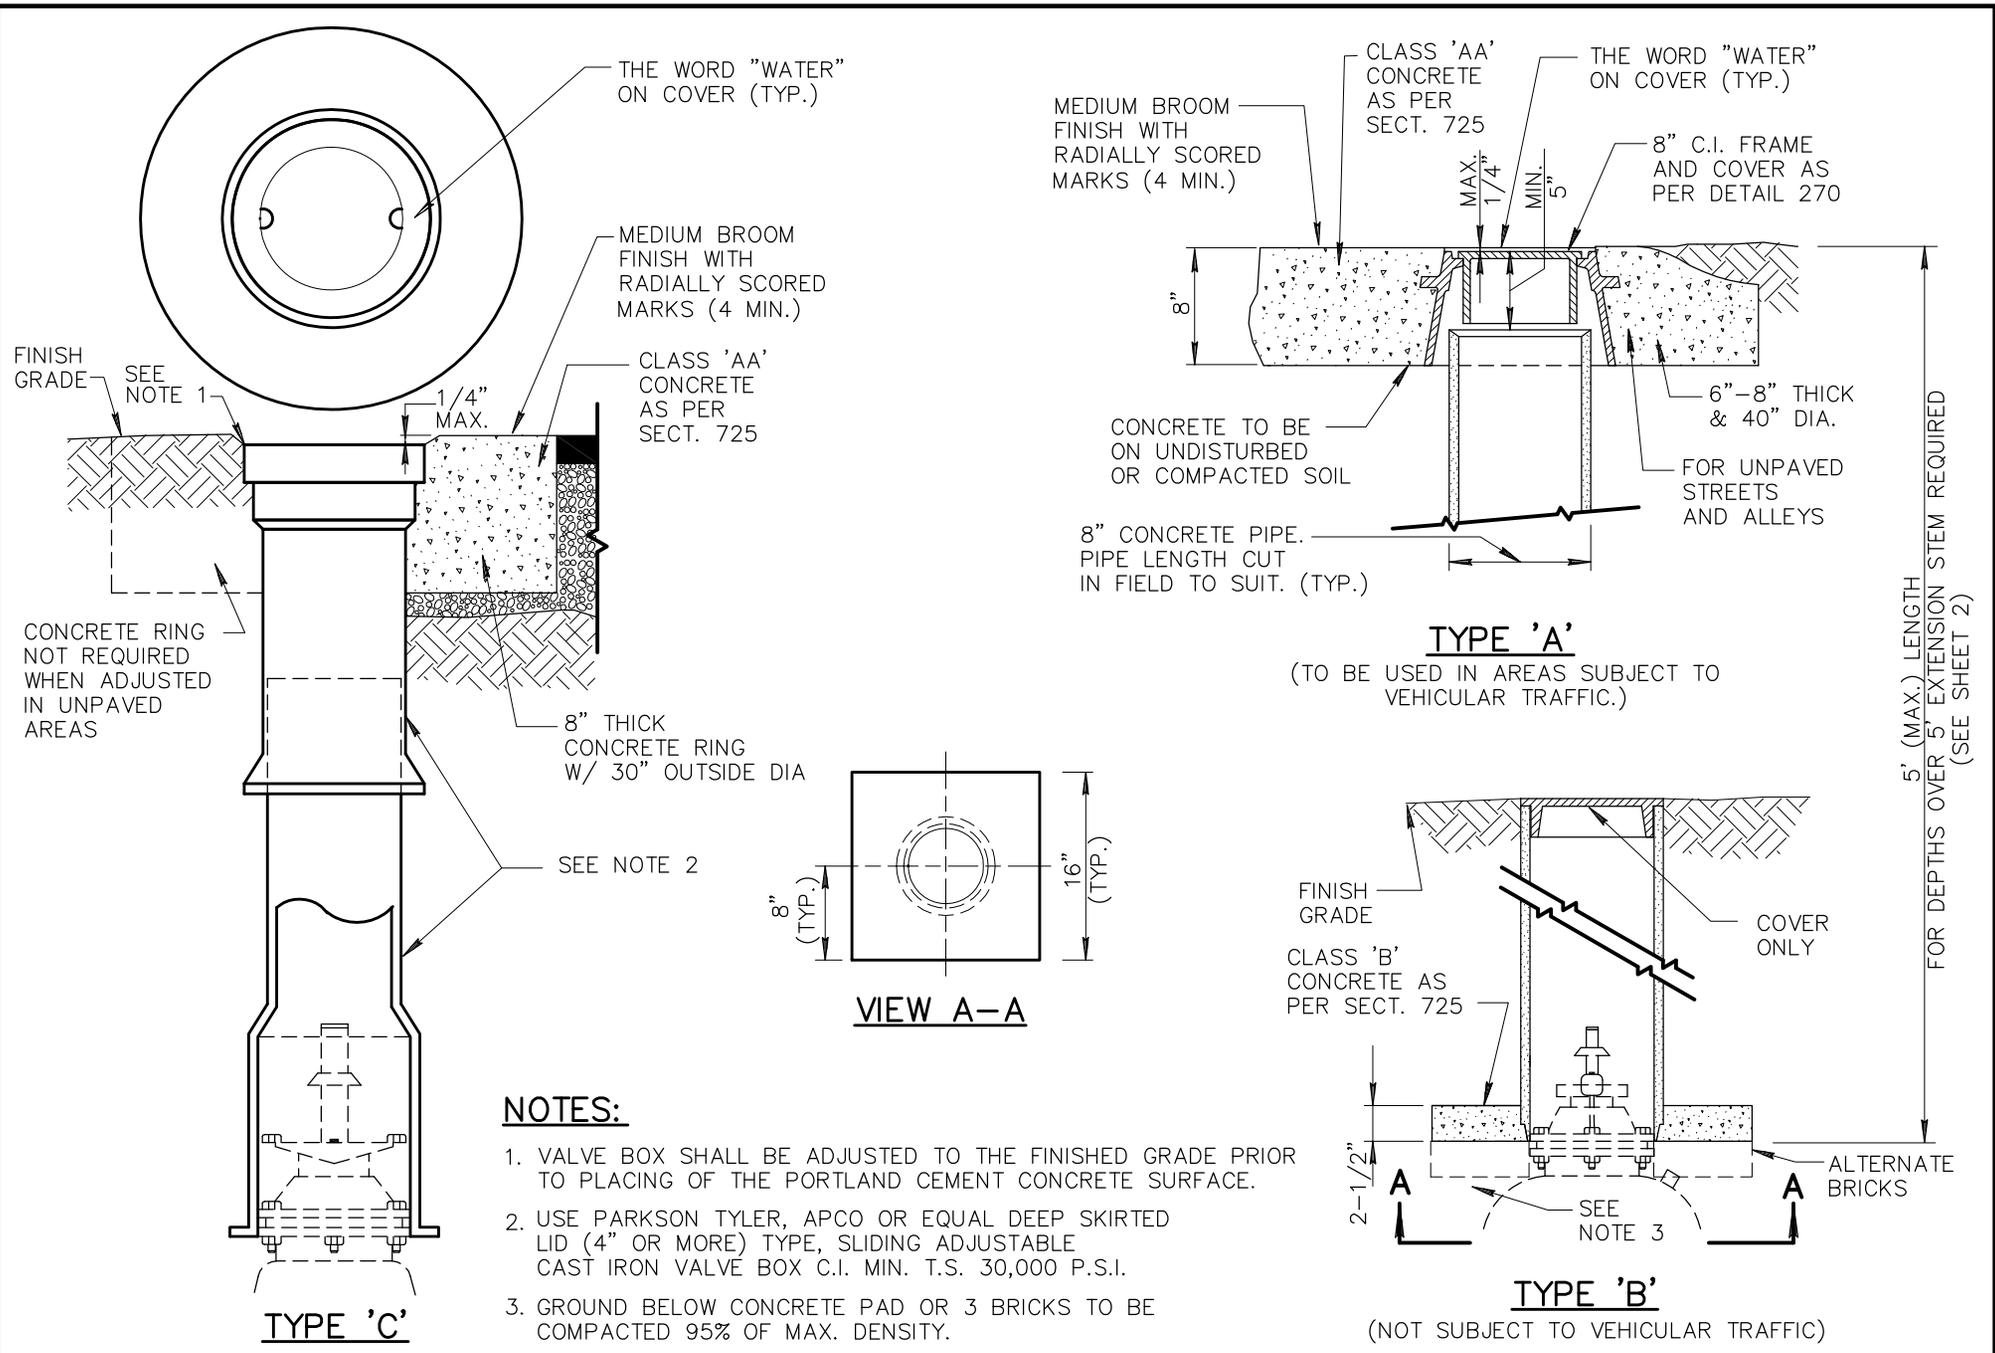

DETAIL NO.
391-1




STANDARD DETAIL
ENGLISH


VALVE BOX INSTALLATION AND GRADE ADJUSTMENT

REVISED
01-01-2014


DETAIL NO.
391-1

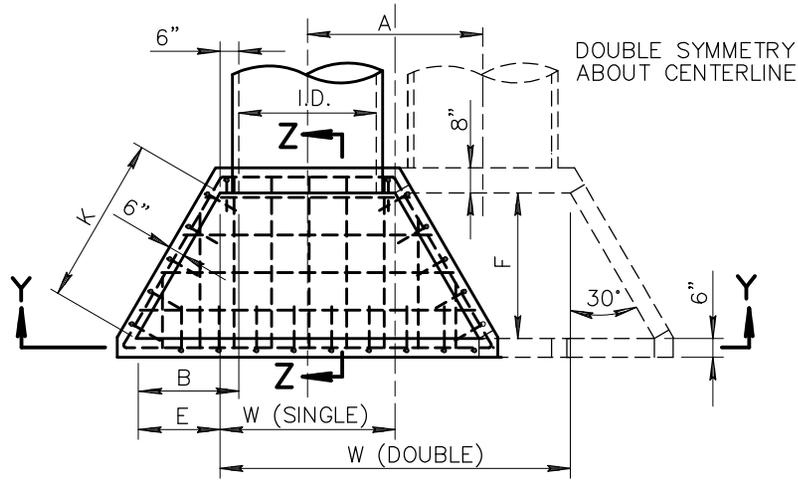

PLAN

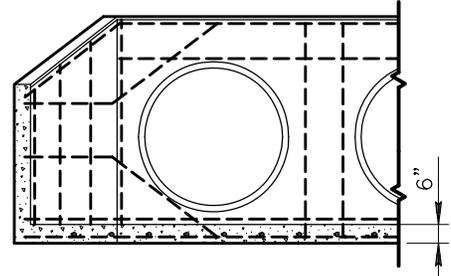


SECTION Y-Y

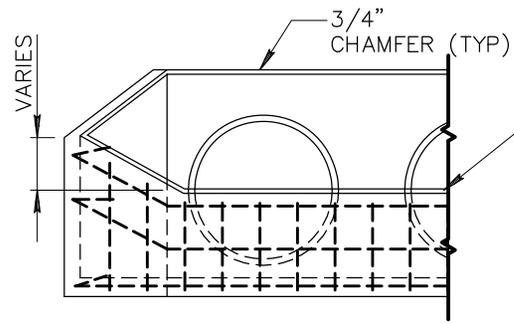

ELEVATION

ELEVATION PER PLAN

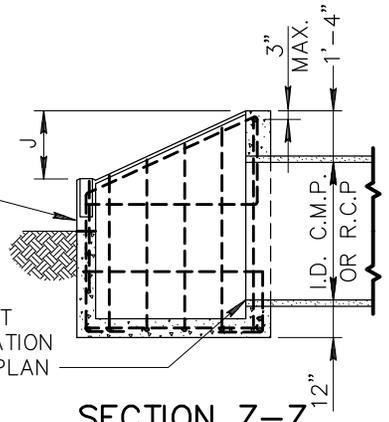

SECTION Z-Z

INVERT ELEVATION PER PLAN

PIPE	DIMENSIONS							
	W		A	B	E	F	J	K
	SINGLE	DOUBLE						
18"	2'-6"	5'-2"	2'-8"	1'-3"	0'-9"	1'-3.5/8"	9"	1'-6"
24"	3'-0"	6'-6"	3'-6"	1'-7.1/2"	1'-1.1/2"	1'-11.3/8"	11"	2'-3"
30"	3'-6"	7'-10"	4'-4"	2'-0"	1'-6"	2'-7.1/4"	1'-1"	3'-0"
36"	4'-0"	9'-2"	5'-2"	2'-4.1/2"	1'-10.1/2"	3'-3"	1'-4"	3'-9"
42"	4'-6"	10'-6"	6'-0"	2'-9"	2'-3"	3'-10.3/4"	1'-6"	4'-6"

NOTES:

1. HIGH POINT OF HEADWALL SHALL NOT PROJECT MORE THAN 3" ABOVE SLOPE.
2. ALL CONCRETE SHALL BE CLASS 'A' PER SECT. 725.
3. ALL REINFORCING BARS SHALL BE NO. 4, 12" C TO C AND 3" CLEAR TO INSIDE OF FLOOR AND WALLS.