


2017 Revision to the
2015 Edition



Uniform Standard Specifications and Details for Public Works Construction

Sponsored and Distributed by the

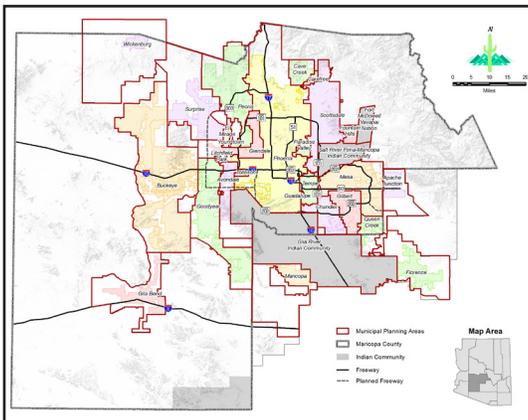

January 2017

NEW IN THE 2017 REVISION

Uniform Standard Specifications and Details for Public Works Construction—2017 Revision to the 2015 Edition

The MAG Standard Specifications and Details Committee, with assistance from five specialized working groups, considered 20 cases during the 2016 session. Of these, 16 were approved and included in this revision.

New Specifications:

- Section 326: Placement and Construction of Polymer Modified Asphalt Concrete
- Section 719: Polymer Modified Asphalt Concrete

Specifications rewritten, or with major updates:

- Section 106: Control of Materials
- Section 309: Lime Stabilization or Modification of Subgrade
- Section 340: Concrete Curb, Gutter, Sidewalk, Curb Ramps, Driveway and Alley Entrance
- Section 710: Asphalt Concrete
- Section 717: Asphalt-Rubber Asphalt Concrete
- Section 727: Steel Reinforcement

Specifications with minor updates:

- Section 310: Placement and Construction of Aggregate Base Course
- Section 322: Decorative Asphalt
- Section 331: Microsurfacing Specifications
- Section 415: Flexible Metal Guardrail
- Section 505: Concrete Structures
- Section 608: Horizontal Directional Drilling
- Section 616: Reclaimed Water Line Construction
- Section 711: Paving Asphalt
- Section 725: Portland Cement Concrete
- Section 729: Expansion Joint Filler
- Section 772: Chain Link Fence
- Section 796: Geosynthetics

Specifications that have been deleted:

- None

New detail drawings:

- Detail 236-1: DUAL CURB RAMP (RADIAL, 25'-35' R) ATTACHED SIDEWALK
- Detail 236-2: DUAL CURB RAMP (RADIAL, 25'-35' R) DETACHED SIDEWALK
- Detail 236-3: DUAL CURB RAMP (RADIAL, 20' R) ATTACHED SIDEWALK
- Detail 237-1: DUAL CURB RAMP (DIRECTIONAL, 25'-35' R) ATTACHED SIDEWALK
- Detail 237-2: DUAL CURB RAMP (DIRECTIONAL, 25'-35' R) DETACHED SIDEWALK
- Detail 237-3: DUAL CURB RAMP (DIRECTIONAL, 20' R) ATTACHED SIDEWALK
- Detail 271: SQUARE FRAME AND COVER AND GRADE ADJUSTMENT
- Detail 310: STEEL WATER METER BOX COVER
(Replaces Detail 310: CAST IRON WATER METER BOX COVER NO. 1)
- Detail 315: POLYMER CONCRETE WATER METER BOX COVER
- Detail 319: TRAFFIC RATED BOX AND COVER
- Detail 393: WATER VALVE EXTENSION

Details that have been updated:

- Detail 100-1: INDEX (Page 1 of 2)
- Detail 100-2: INDEX (Page 2 of 2)
- Detail 251: RETURN TYPE DRIVEWAYS
- Detail 270: FRAME AND COVER AND GRADE ADJUSTMENT
- Detail 320: NON TRAFFIC RATED WATER METER BOXES
- Detail 391-1: VALVE BOX INSTALLATION AND GRADE ADJUSTMENT
- Detail 391-2: VALVE BOX INSTALLATION AND GRADE ADJUSTMENT
- Detail 507: ENCASED CONCRETE PIPE (FOR SHALLOW INSTALLATION)

Details that have been deleted:

- Detail 310: CAST IRON WATER METER BOX COVER NO. 1
- Detail 311: CAST IRON WATER METER BOX COVER NO. 2
- Detail 312: CAST IRON WATER METER BOX COVER NO. 3
- Detail 313: CAST IRON WATER METER BOX COVER NO. 4
- Detail 314: CAST IRON WATER METER BOX COVER NO. 5

Changes made in the 2016 Revision

Uniform Standard Specifications and Details for Public Works Construction—2016 Revision to the 2015 Edition

The MAG Standard Specifications and Details Committee, with assistance from five specialized working groups, considered 18 cases during the 2015 session. Of these, 14 were approved and included in this revision.

New Specifications:

- Section 322: Decorative Asphalt
- Section 608: Horizontal Directional Drilling

Specifications rewritten, or with major updates:

- Section 321: Placement and Construction of Asphalt Concrete Pavement
- Section 336: Pavement Matching and Surfacing Replacement
- Section 342: Interlocking Concrete Paver Installations
- Section 602: Trenchless Installation of Steel Casing
- Section 718: Preservative Seal for Asphalt Concrete

Specifications with minor updates:

- Section 325: Placement and Construction of Asphalt-Rubber Asphalt Concrete Pavement
- Section 334: Preservative Seal for Asphalt Concrete
- Section 345: Adjusting Frames, Covers and Valve Boxes
- Section 601: Trench Excavation, Backfilling and Compaction

- Section 625: Manhole Construction and Drop Sewer Connections
- Section 710: Asphalt Concrete
- Section 717: Asphalt-Rubber Asphalt Concrete
- Section 735: Reinforced Concrete Pipe
- Section 771: Galvanizing
- Section 772: Chain Link Fence

Specifications that have been deleted:

- Section 744: ABS Truss Pipe and Fittings

Details that have been updated:

- Detail 145: SAFETY RAIL
- Detail 200-1: TRENCH BACKFILL AND SURFACE REPLACEMENT
- Detail 200-2: TRENCH BACKFILL AND SURFACE REPLACEMENT
- Detail 225: INTERLOCKING CONCRETE PAVERS
- Detail 270: FRAME AND COVER AND GRADE ADJUSTMENT

Changes made in the 2015 Edition

Uniform Standard Specifications and Details for Public Works Construction—2015 Edition

The MAG Standard Specifications and Details Committee considered 22 cases during the 2014 session. Of these, 18 were approved and included in this revision.

New Specifications:

- Section 607: Trenchless Installation of Smooth Wall Jacking Pipe
- Section 742: Precast Manhole

Specifications rewritten, or with major updates:

- Section 101: Abbreviations and Definitions
- Section 321: Placement and Construction of Asphalt Concrete Pavement
- Section 324: Portland Cement Concrete Pavement
- Section 325: Placement and Construction of Asphalt-Rubber Asphalt Concrete Pavement
- Section 405: Monuments
- Section 601: Trench Excavation, Backfilling and Compaction
- Section 610: Water Line Construction
- Section 611: Water, Sewer and Storm Drain Testing
(was Disinfecting Water Mains)
- Section 615: Sewer Line Construction
- Section 618: Storm Drain Construction
- Section 625: Manhole Construction and Drop Sewer Connections
- Section 735: Reinforced Concrete Pipe

Specifications with minor updates:

- Section 107: Legal Regulations and Responsibility to Public
- Section 206: Structure Excavation and Backfill
- Section 211: Fill Construction
- Section 310: Placement and Construction of Aggregate Base Course
- Section 336: Pavement Matching and Surfacing Replacement
- Section 340: Concrete Curb, Gutter, Sidewalk, Sidewalk Ramps, Driveway and Alley Entrance
- Section 342: Decorative Pavement, Concrete Paving Stone
- Section 345: Adjusting Frames, Covers, Valve Boxes, Meter Boxes and Pull Boxes
- Section 355: Utility Potholes-Keyhole Method
- Section 616: Reclaimed Water Line Construction
- Section 710: Asphalt Concrete
- Section 717: Asphalt-Rubber Asphalt Concrete
- Section 726: Concrete Curing Materials
- Section 739: Steel Reinforced Polyethylene Pipe and Fittings for Storm Drain, Irrigation and Sanitary Sewer

- Section 740: Polypropylene Pipe and Fittings for Storm Drain, Irrigation and Sanitary Sewer
- Section 750: Iron Water Pipe and Fittings
- Section 775: Brick and Concrete Masonry Units (Blocks)

Specifications that have been deleted:

- Section 603: Installation for High Density Polyethylene Pipe
(Incorporated into Section 601.)

New detail drawings:

- Detail 420-1: CONCRETE SANITARY SEWER MANHOLE
(Replaces existing 420-1: Precast Concrete Sewer Manhole)
- Detail 420-2: PRECAST MANHOLE BASE
- Detail 420-3: CONCRETE MANHOLE BASE
(Replaces parts of existing 420-2 and adds details.)

Details that have been updated:

- Detail 100-1: INDEX (Page 1 of 2)
- Detail 100-2: INDEX (Page 2 of 2)
- Detail 120: SURVEY MARKER
- Detail 200-1: BACKFILL, PAVEMENT AND SURFACE REPLACEMENT
- Detail 200-2: BACKFILL, PAVEMENT AND SURFACE REPLACEMENT
- Detail 212: UTILITY POT HOLE REPAIR
- Detail 391-1: VALVE BOX INSTALLATION AND GRADE ADJUSTMENT
- Detail 391-2: VALVE BOX INSTALLATION AND GRADE ADJUSTMENT
- Detail 392: DEBRIS CAP INSTALLATION
- Detail 421: OFFSET MANHOLE 8" TO 30" PIPE
- Detail 422: MANHOLE FRAME AND COVER ADJUSTMENT
- Detail 429: INDUSTRIAL WASTE CONTROL VAULT WITH MANHOLE
- Detail 522: STORM DRAIN MANHOLE SHAFT
- Detail 552: FORD CROSSING AND CUT-OFF WALLS

Details that have been deleted:

- Detail 428: MANHOLE STEPS

**UNIFORM STANDARD
SPECIFICATIONS
for
PUBLIC WORKS
CONSTRUCTION**

**SPONSORED and DISTRIBUTED
by the**



2017 Revision to the 2015 Edition

ARIZONA

FOREWORD

Publication of these Uniform Standard Specifications and Details for Public Works Construction fulfills the goal of a group of agencies who joined forces in 1966 to produce such a set of documents. Subsequently, in the interest of promoting county-wide acceptance and use of these standards and details, the Maricopa Association of Governments accepted their sponsorship and the responsibility of keeping them current and viable.

These specifications and details, representing the best professional thinking of representatives of several Public Works Departments, reviewed and refined by members of the construction industry, were written to fulfill the need for uniform rules governing public works construction performed for Maricopa County and the various cities and public agencies within Maricopa County who could not afford to promulgate such standards for themselves. Agencies in other regions or climates that desire to use these specifications may need to make adjustments for local conditions.

A uniform set of specifications and details, updated and embracing the most modern materials and construction techniques will reduce conflicts, provide clarity and lower construction costs for the benefit of the public.

Use of these standards for projects outside of the right-of-way should be reviewed by professional engineers and architects and applied with care to insure relevance to the planned work.

Specifications and details should be incorporated into project plans and specifications after careful review by the design engineer or architect of specific project needs. Not all specifications contained herein will apply to all projects. Prepared plans and specifications should clearly call out only those specific uniform specifications and details required for the project.

Uniform specifications and details are not a substitute for good engineering judgment. Unique conditions will arise that are outside the scope of these standards. When this happens, professional engineers and architects are required to use their judgment to amend these standards to best meet site-specific project needs in accordance with the rules set forth by the State of Arizona and policy statements made by the Arizona State Board of Technical Registration.

The Uniform Standard Specifications and Details for Public Works Construction are revised periodically and reprinted to reflect the changing technology of the construction industry. To this end a Specifications and Details Committee has been established as a permanent organization to continually study and recommend changes to the Specifications and Details. Interested parties may address suggested changes and questions to:

Standard Specifications & Details Committee
c/o Maricopa Association of Governments
302 North First Avenue, Suite 300
Phoenix, Arizona, 85003

Suggestions will be reviewed by the committee and appropriate segments of the construction industry and revisions will be published the first of each year. A copy of this publication is available for review on the internet at the website listed below. Please follow the links to the publications page and look for *Uniform Standard Specifications for Public Works Construction* and/or *Uniform Standard Details for Public Works Construction*:

www.azmag.gov

In the interest of regional uniformity, it is hoped that all using agencies will adopt these standards with minimal changes. It is recognized that because of charter requirements and for other reasons, some agencies will find it necessary to modify or supplement certain requirements. In the interest of regional uniformity, it is strongly recommended that using agencies bring desired modifications to the MAG Committee for consideration and inclusion into these standards.

TABLE OF CONTENTS

PART 100 - GENERAL CONDITIONS

Section	Last Revised	Title	Page
101	2015	Abbreviations and Definitions	101-1
102	2008	Bidding Requirements and Conditions	102-1
103	1999	Award and Execution of Contract	103-1
104	2012	Scope of Work	104-1
105	2008	Control of Work	105-1
106	2017	Control of Materials	106-1
107	2015	Legal Regulations and Responsibility to Public	107-1
108	2014	Commencement, Prosecution and Progress	108-1
109	2011	Measurements and Payments	109-1
110	2000	Notification of Changed Conditions and Dispute Resolution	110-1

PART 200 - EARTHWORK

Section	Last Revised	Title	Page
201	1999	Clearing and Grubbing	201-1
205	1998	Roadway Excavation	205-1
206	2015	Structure Excavation and Backfill	206-1
210	2009	Borrow Excavation	210-1
211	2015	Fill Construction	211-1
215	1998	Earthwork for Open Channels	215-1
220	2012	Riprap Construction	220-1
230	2010	Dust Palliative Application	230-1

PART 300 - STREETS AND RELATED WORK

Section	Last Revised	Title	Page
301	2014	Subgrade Preparation	301-1
306	2010	Mechanically Stabilized Subgrade- Geogrid Reinforcement	306-1
309	2017	Lime Stabilization or Modification of Subgrade	309-1
310	2017	Placement and Construction of Aggregate Base Course	310-1
311	2014	Placement and Construction of Cement Treated Subgrade	311-1
312	2012	Cement Treated Base	312-1
315	1998	Bituminous Prime Coat	315-1
317	2013	Asphalt Milling	317-1
320	1999	Road-Mixed Surfacing	320-1
321	2016	Placement and Construction of Asphalt Concrete Pavement	321-1
322	2017	Decorative Asphalt	322-1
324	2015	Portland Cement Concrete Pavement (PCCP)	324-1
325	2016	Placement and Construction of Asphalt-Rubber Asphalt Concrete	325-1
326	2017	Placement and Construction of Polymer Modified Asphalt Concrete	326-1
327	2012	Hot In-Place Recycling	327-1
329	1998	Tack Coat	329-1
330	1998	Asphalt Chip Seal	330-1
331	2017	Microsurfacing Specifications	331-1
332	2013	Placement and Construction of Asphalt Emulsion Slurry Seal Coat	332-1
333	2012	Fog Seal Coats	333-1
334	2016	Preservative Seal for Asphalt Concrete	334-1
335	2012	Placement and Construction of Hot Asphalt-Rubber Seal	335-1
336	2016	Pavement Matching and Surfacing Replacement	336-1
337	2014	Crack Sealing	337-1
340	2017	Concrete Curb, Gutter, Sidewalk, Curb Ramps, Driveway and Alley Entrance	340-1
342	2016	Interlocking Concrete Paver Installations	342-1
343	1998	Exposed Aggregate Paving	343-1
345	2016	Adjusting Frames, Covers and Valve Boxes	345-1
350	2013	Removal of Existing Improvements	350-1
355	2015	Utility Potholes-Keyhole Method	355-1
360	1998	Telecommunications Installation	360-1

PART 400 - RIGHT-OF-WAY AND TRAFFIC CONTROL

Section	Last Revised	Title	Page
401	1998	Traffic Control	401-1
405	2015	Survey Monuments	405-1
410	1998	Precast Safety Curbs	410-1
415	2017	Flexible Metal Guardrail	415-1
420	1998	Chain Link Fences	420-1
424	1998	Parkway Grading	424-1
425	1998	Topsoils	425-1
430	2014	Landscaping and Planting	430-1
440	1999	Sprinkler Irrigation System Installation	440-1

PART 500 - STRUCTURES

Section	Last Revised	Title	Page
505	2017	Concrete Structures	505-1
506	2012	Precast Prestressed Concrete Members	506-1
510	1998	Concrete Block Masonry	510-1
511	1998	Brick Masonry	511-1
515	1998	Steel Structures	515-1
520	2012	Steel and Aluminum Handrails	520-1
525	1998	Pneumatically Placed Mortar	525-1
530	2000	Painting	530-1

PART 600 – WATER, SEWER, STORM DRAIN AND IRRIGATION

Section	Last Revised	Title	Page
601	2016	Trench Excavation, Backfilling and Compaction	601-1
602	2016	Trenchless Installation of Steel Casing	602-1
604	2012	Placement of Controlled Low Strength Material	604-1
605	2014	Subdrainage	605-1
607	2015	Trenchless Installation of Smooth Wall Jacking Pipe	607-1
608	2017	Horizontal Directional Drilling	608-1
610	2015	Water Line Construction	610-1
611	2015	Water, Sewer and Storm Drain Testing	611-1
615	2015	Sanitary Sewer Line Construction	615-1
616	2017	Reclaimed Water Line Construction	616-1
618	2015	Storm Drain Construction	618-1
620	2012	Cast-in-place Concrete Pipe	620-1
621	1998	Corrugated Metal Pipe and Arches	621-1
625	2016	Manhole Construction and Drop Sewer Connections	625-1
630	2012	Tapping Sleeves, Valves and Valve Boxes on Water Lines	630-1
631	2012	Water Taps and Meter Service Connections	631-1

PART 700 - MATERIALS

Section	Last Revised	Title	Page
701	2013	Aggregate	701-1
702	2013	Base Materials	702-1
703	2012	Riprap	703-1
705	2012	Portland Cement Treated Base	705-1
708	2011	Asphalt Pavement Core Bonding Materials	708-1
710	2017	Asphalt Concrete	710-1
711	2017	Paving Asphalt	711-1
712	1999	Liquid Asphalt	712-1
713	2012	Emulsified Asphalts Materials	713-1
714	2012	Microsurfacing Materials	714-1

PART 700 - MATERIALS

Section	Last Revised	Title	Page
715	2012	Slurry Seal Materials	715-1
716	2012	Cover Material	716-1
717	2017	Asphalt-Rubber Asphalt Concrete	717-1
718	2016	Preservative Seal for Asphalt Concrete	718-1
719	2017	Polymer Modified Asphalt Concrete	719-1
725	2017	Portland Cement Concrete	725-1
726	2015	Concrete Curing Materials	726-1
727	2017	Steel Reinforcement	727-1
728	2013	Controlled Low Strength Material	728-1
729	2017	Expansion Joint Filler	729-1
735	2016	Reinforced Concrete Pipe	735-1
736	2012	Non-Reinforced Concrete Pipe	736-1
738	2012	High Density Polyethylene Pipe And Fittings for Storm Drain And Sanitary Sewer	738-1
739	2015	Steel Reinforced Polyethylene Pipe And Fittings for Storm Drain, Irrigation And Sanitary Sewer	739-1
740	2014	Polypropylene Pipe And Fittings for Storm Drain, Irrigation And Sanitary Sewer	740-1
741	2011	Lining for Reinforced Concrete Sanitary Sewer Pipe	741-1
742	2015	Precast Manhole	742-1
743	1998	Vitrified Clay Pipe	743-1
745	1998	PVC Sewer Pipe and Fittings	745-1
750	2015	Iron Water Pipe and Fittings	750-1
752	1998	Asbestos-Cement Water Pipe and Fittings	752-1
753	2000	Galvanized Pipe and Fittings	753-1
754	2012	Copper Pipe, Tubing and Fittings	754-1
755	2012	Polyethylene Pipe for Water Distribution	755-1
756	2008	Dry Barrel Fire Hydrants	756-1
757	1998	Sprinkler Irrigation System	757-1
758	2005	Concrete Pressure Pipe - Steel Cylinder Type	758-1
759	2002	Steel Pipe	759-1
760	1998	Coating Corrugated Metal Pipe and Arches	760-1
761	1998	Structural Plate Pipe, Arches, and Pipe Arches	761-1
770	2013	Structural and Rivet Steel, Rivets, Bolts, Pins, and Anchor Bolts	770-1
771	2016	Galvanizing	771-1
772	2017	Chain Link Fence	772-1
775	2015	Brick and Concrete Masonry Units (Blocks)	775-1
776	2012	Masonry Mortar and Grout	776-1
778	1998	Lumber	778-1
779	1998	Wood Preservatives	779-1
787	1999	Gray Iron Castings	787-1
790	1999	Paint	790-1
792	2010	Dust Palliative	792-1
795	2014	Landscape Material	795-1
796	2017	Geosynthetics	796-1
	2017	Index	Index-1

This Page Reserved for Future Use

PART 100
GENERAL CONDITIONS

Section	Last Revised	Title	Page
101	2015	Abbreviations and Definitions	101-1
102	2008	Bidding Requirements and Conditions	102-1
103	1999	Award and Execution of Contract	103-1
104	2012	Scope of Work	104-1
105	2008	Control of Work	105-1
106	2017	Control of Materials	106-1
107	2015	Legal Regulations and Responsibility to Public	107-1
108	2014	Commencement, Prosecution and Progress	108-1
109	2011	Measurements and Payments	109-1
110	2000	Notification of Changed Conditions and Dispute Resolution	110-1

This Page Reserved for Future Use

SECTION 106

CONTROL OF MATERIALS

106.1 SOURCE OF MATERIALS AND QUALITY:

All construction materials to be used on the work or incorporated into the work, equipment, plant, tools, appliances or methods to be used on the work shall be subject to the inspection and approval or rejection of the Engineer.

The materials used on the work shall meet all quality requirements of the contract. In order to expedite the inspection and testing of materials, the Contractor shall notify the Engineer of his proposed source of materials prior to delivery. At the option of the Engineer, materials may be approved at the source of supply before delivery is started. If it is found after trial that sources of supply for previously approved materials do not produce specified products the Contractor shall furnish materials from other sources.

Unless otherwise noted, all materials used in the project shall be new and unused. Additionally, any new materials used in this project that are damaged during the construction of the project and prior to final acceptance, as determined by the Engineer, shall be replaced by the Contractor with new material at no additional cost to the Contracting Agency.

106.2 SAMPLES AND TESTS OF MATERIALS:

All materials to be incorporated in the work may be subject to sampling, testing and approval, and samples furnished shall be representative of the materials to be used. The Engineer may select samples, or may require that samples be delivered by the Contractor to a laboratory designated by the Engineer.

The Contracting Agency will pay for the initial or normal test required by the Engineer to guard against unsuitable materials or defective workmanship. Additional tests, required due to failure of the initial or normal test(s), shall be paid for by the Contractor. The Engineer will designate the laboratory which will accomplish the additional test(s).

The procedures and methods used to sample and test materials will be determined by the Engineer. Unless otherwise specified, samples and tests will be made in accordance with either: the Materials Testing Manual of the Contracting Agency; the standard methods of AASHTO or ASTM, which were in effect and published at the time of issuance of the solicitation for a construction price proposal (aka: at the time of advertising for bids).

The laboratory responsible for the test shall furnish at least one copy of the test results to the Engineer, to the Contractor, and to the appropriate material supplier.

With respect to certain manufactured materials, the Engineer may permit the use of some materials prior to sampling and testing provided they are delivered with either a certificate of compliance or analysis or both, stating that the materials comply in all respects with the requirements of the specifications. These certificates shall be furnished in triplicate and clearly identify each delivery of materials to the work area. The certificates shall be signed by a person having legal authority to bind the supplier or manufacturer.

106.2.1 Certificate of Compliance: A Certificate of Compliance shall be submitted on the manufacturer's or supplier's official letterhead, and shall contain the following information:

1. The current name, address, and phone number of the manufacturer or supplier of the material or equipment.
2. A description of the material or equipment supplied.
3. Quantity of material represented by the certificate.
4. Means of material identification, such as label, lot number, or marking.
5. A statement that the material complies in all respects with the requirements of the cited specifications. Certificates shall state the name of the specific cited specifications, such as AASHTO M 320, ASTM C494, or specific table or subsection of the Specifications or Special Provisions.
6. A statement that the individual identified in item eight below has the legal authority to bind the manufacturer or the supplier of the material.

SECTION 106

7. Project identification: Project name and all associated numbers (agency, Federal, and ADOT TRACS).
8. The name, title, and signature of the responsible individual. The date of the signature shall also be given.

Each of the first six items specified above shall be completed prior to the signing of the certificate as defined in item eight. No certificate will be accepted that has been altered, added to, or changed in any way after the authorized signature has been affixed to the original certificate. However, notations related to project specifics such as project identification, contractor, or quantity shipped are acceptable, provided the basic requirements of the certificate (items one through six) are not affected.

A copy or facsimile reproduction of the original certificate will be acceptable; however, the original certificate shall be made available upon request.

106.2.2 Certificate of Analysis: A Certificate of Analysis shall include all the information required for a Certificate of Compliance and, in addition, shall include the results of all tests required by the specifications.

106.3 PLANT INSPECTION:

The Engineer may undertake the inspection of materials at the source. In this event, the following conditions shall be met:

(A) The Engineer shall have the cooperation and assistance of the Contractor and the producer with whom he has contracted for materials.

(B) The Engineer shall have full entry at all times to such parts of the plant as may concern the manufacture or production of the materials being furnished.

It is understood that the Contracting Agency reserves the right to retest all materials, prior to their use in the work, upon delivery.

106.4 TRADE NAMES AND SUBSTITUTIONS:

Plans and specifications may contain references to equipment, materials or patented processes by manufacturer, trade name, make or catalog number. Unless the name is followed by words indicating that no substitution is permitted, such references shall be regarded as establishing a standard of quality, finish, appearance, performance or, as indicated, a selection based upon compatibility with existing equipment or materials.

The use of an alternate or substitute item or source may be permitted, subject to the following:

(A) No consideration will be given to a substitution prior to the award of the contract.

(B) Only substitutions submitted by the Contractor will be accepted for review. The substitution shall be submitted in writing to the Engineer.

(C) The submittal shall certify that the substitution will perform the functions and achieve the results called for by the general design, be similar and of equal substance, and be suited to the same use as that specified.

(D) The submittal shall state any required changes in the contract documents to adapt the design to the proposed substitution. This will include all changes required of other contractors/subcontractors affected by the resulting changes.

(E) The submittal shall contain an itemized estimate of all costs and credits that will result directly or indirectly from the acceptance of such substitution, including costs of design, license fees, royalties, testing, Engineer's evaluation, claims of other contractors/subcontractors, etc. Also, the submittal shall include any adjustment in the contract time created by the substitution.

(F) The Contractor, on request of the Engineer, shall submit samples or any additional information the Engineer may deem necessary to evaluate the acceptability of the substitution. The Engineer will evaluate the information provided, perform tests

SECTION 106

when necessary and make comparisons. The Engineer will then make the final decision as to the acceptability of the proposed substitution. The Contractor will be notified in writing by the Engineer as to whether his substitution has been accepted or rejected.

(G) The submittal, for purposes of review, number of copies, etc., shall follow the procedures as outlined in Section [105.2](#), except in the case of response time. If the Engineer does not respond in a timely manner, which in turn, impacts the substitution, the Contractor shall continue to perform the work in accordance with the contract and the substitution will be considered rejected. Also, no adjustment in the contract time will be granted for nonacceptance of the substitution.

(H) There will be no additional costs to the Contracting Agency for the substitution. If the substitution yields a net savings in the contract price, the amount of savings shall be divided between the Contracting Agency and the Contractor in a percentage established by the Contracting Agency.

(I) If the substitution is accepted and an adjustment in the contract cost and/or contract time is in order, a change order will be issued to the Contractor for the changes.

106.5 STORAGE OF MATERIALS:

The Contractor shall provide storage facilities and exercise such measures as will insure the preservation of the quality and fitness of all materials and/or equipment to be used in the work. Stored materials and/or equipment, even though approved before storage, may again be inspected prior to their use in the work. Stored items shall be located so as to facilitate their prompt inspection. That portion of the right-of-way and easements not required for public travel may be used for storage purposes, when approved by the Engineer. Any additional storage area as required must be provided by the Contractor. Private property shall not be used for storage purposes without written permission of the owner or lessee. If requested, by the Engineer, copies of such written permission shall be made available.

106.6 HANDLING MATERIALS:

All materials and/or equipment shall be handled in such a manner as to preserve their quality and fitness for the work.

106.7 UNACCEPTABLE MATERIALS:

All materials and/or equipment not conforming to the requirements of the specifications, whether in place or not, may be rejected. Rejected materials and/or equipment shall be removed immediately from the site of work unless otherwise permitted by the Engineer. No rejected material and/or equipment, the defects of which have been subsequently corrected, shall be used until approved in writing by the Engineer.

106.8 FURNISHED MATERIALS:

Materials and/or equipment, furnished by the Contracting Agency, will be delivered or made available to the Contractor as indicated in the special provisions. The cost of handling and placing shall be considered as included in the contract price for the pay item with which they are used.

The Contractor will be held responsible for all materials and/or equipment accepted by him and will make good any shortages, deficiencies and damages which may occur after such acceptance.

- End of Section -

SECTION 107

LEGAL REGULATIONS AND RESPONSIBILITY TO PUBLIC

107.1 COMPLIANCE WITH LAWS:

The Contractor shall keep fully informed of, observe and comply with all Federal and State laws, County and City ordinances, regulations, codes and all orders and decrees of bodies or tribunals having any jurisdiction or authority, which in any way affect the conduct of the work. The Contractor warrants that all items supplied and work performed under the contract have been sold, produced, delivered and furnished in strict compliance with all such laws, ordinances, regulations, codes, orders and decrees to which the items, work and Contractor are subject. Upon request, Contractor shall execute and deliver to the Agency such documents as may be required by the Agency to evidence compliance with such laws, ordinances, regulations, codes, orders and decrees. The Contractor shall protect and indemnify the Contracting Agency and its representatives against any claim or liability arising from or based on the violation of such, whether by the Contractor or the Contractor's employees.

107.2 PERMITS:

Permits, bonding and insurance requirements shall be as required by statutes, codes, ordinances or regulations.

The Public Agency, when acting as the Contracting Agency, may obtain some of the required permits. It is the duty of the Contractor to determine that all necessary permits have been obtained. The Contractor shall, at the Contractor's own expense, obtain all the required permits which have not been furnished. The Contractor shall comply with all permit requirements until the Contract is completed or the permit is closed-out or transferred. The Contractor shall be responsible to close out all permits except those authorized by special provision to be transferred.

In all cases, the Contractor or the person supervising the authorized work shall notify the appropriate permit agency so as to insure proper inspection by the agency concerned.

107.3 PATENTED DEVICES, MATERIALS AND PROCESSES:

If the Contractor employs any design, device, material, or process covered by letters of patent or copyright, he shall provide for such use by suitable legal agreement with the patentee or owner. The Contractor and the surety shall indemnify and save harmless the Contracting Agency, any affected third party or political subdivision from any and all claims for infringement by reason of the use of any such patented design, device, material or process, or any trademark or copyright, and shall indemnify the Contracting Agency for any costs, expenses, and damages which it may be obligated to pay by reason of any infringement, at any time during the prosecution or after the completion of the work.

107.4 ARCHAEOLOGICAL REPORTS:

Attention is directed to Sections 41-844 and 41-865 Arizona Revised Statutes. In view of the above, it shall be a provision of every contract that when archaeological features are encountered or unearthed in the excavation of material pits or of the roadway prism, or other excavation, the Contractor shall report promptly to the Director of the Arizona State Museum and the Contracting Agency. The Contractor will be allowed extra time as appropriate in accordance with the provisions of Section [108](#).

107.5 SAFETY, HEALTH AND SANITATION PROVISIONS:

The Contractor shall provide and maintain in a neat, sanitary condition such accommodations for the use of his employees as may be necessary to comply with the requirements and regulations of the Arizona State Department of Health or as specified by the Maricopa County Health Department, Sanitary Code.

The Contractor shall provide all safeguards, safety devices and protective equipment and take any other needed actions, on his own responsibility or as the Engineer may determine, reasonably necessary to protect the life and the health of employees on the job, the safety of the public and to protect property in connection with the performance of the work covered by the contract.

Precaution shall be exercised by the Contractor at all times for the protection of persons (including employees) and property. The Contractor shall comply with the provisions of all applicable laws, pertaining to such protection including all Federal and State occupational safety and health acts, and standards and regulations promulgated there under.

PART 300

STREETS AND RELATED WORK

Section	Last Revised	Title	Page
301	2014	Subgrade Preparation	301-1
306	2010	Mechanically Stabilized Subgrade-Geogrid Reinforcement	306-1
309	2017	Lime Stabilization or Modification of Subgrade	309-1
310	2017	Placement and Construction of Aggregate Base Course	310-1
311	2014	Placement and Construction of Cement Treated Subgrade	311-1
312	2012	Cement Treated Base	312-1
315	1998	Bituminous Prime Coat	315-1
317	2013	Asphalt Milling	317-1
320	1999	Road-mixed Surfacing	320-1
321	2016	Placement and Construction of Asphalt Concrete Pavement	321-1
322	2017	Decorative Asphalt	322-1
324	2015	Portland Cement Concrete Pavement (PCCP)	324-1
325	2016	Placement and Construction of Asphalt-Rubber Asphalt Concrete	325-1
326	2017	Placement and Construction of Polymer Modified Asphalt Concrete	326-1
327	2012	Hot In-Place Recycling	327-1
329	1998	Tack Coat	329-1
330	1998	Asphalt Chip Seal	330-1
331	2017	Microsurfacing Specifications	331-1
332	2013	Placement and Construction of Asphalt Emulsion Slurry Seal Coat	332-1
333	2012	Fog Seal Coats	333-1
334	2016	Preservative Seal for Asphalt Concrete	334-1
335	2012	Placement and Construction of Hot Asphalt-Rubber Seal	335-1
336	2016	Pavement Matching and Surfacing Replacement	336-1
337	2014	Crack Sealing	337-1
340	2017	Concrete Curb, Gutter, Sidewalk, Curb Ramps, Driveway and Alley Entrance	340-1
342	2016	Interlocking Concrete Paver Installations	342-1
343	1998	Exposed Aggregate Paving	343-1
345	2016	Adjusting Frames, Covers and Valve Boxes	345-1
350	2013	Removal of Existing Improvements	350-1
355	2015	Utility Potholes-Keyhole Method	355-1
360	1998	Telecommunications Installation	360-1

This Page Reserved for Future Use

SECTION 309

LIME STABILIZATION OR MODIFICATION OF SUBGRADE

309.1 DESCRIPTION:

This section shall consist of constructing a mixture of soil, lime and water for the stabilization or modification of subgrade soils. The work shall be performed in conformity with the lines, grades thickness, and typical cross sections shown on the plans.

According to the National Lime Association, “Stabilization: When adequate quantities of lime and water are added, the pH of the soil quickly increases to above 10.5, which enables the clay particles to break down. Determining the amount of lime necessary is part of the design process and is approximated by tests such as the Eades and Grim test (ASTM [D3276](#)). Silica and alumina are released to react with calcium from the lime to form calcium-silicate-hydrates (CSH) and calcium-aluminate-hydrates (CAH). CSH and CAH are cementitious products similar to those formed in Portland cement. They form the matrix that contributes to strength of lime-stabilized soil layers. As this matrix forms, the soil is transformed from a sandy, granular material to a hard, relatively impermeable layer with significant load bearing capacity. The process begins within hours and can continue for years in a properly designed system. The matrix formed is permanent, durable, and significantly impermeable, producing a structural layer that is both strong and flexible.”

Lime modification may be used to “Dry-up of wet soil at a construction sites” or “include treating fine-grained soils or granular base materials to construct temporary haul roads or construction platforms.”

309.2 MATERIALS:

309.2.1 Soil or Subgrade: For lime stabilization applications, the soil or subgrade material used for this work shall consist of materials on the site or imported, and shall be free of roots, sod, weeds and stones larger than 3 inches and have a plasticity index (PI) greater than 10, when tested in accordance with AASHTO T-146 Method A, AASHTO T-89 Method A, and T-90. For lime modification applications, the allowable soil or subgrade properties will be determined by the Engineer.

309.2.2 Quicklime and Hydrated Lime: Lime used shall be either quicklime or hydrated lime and shall conform to the requirements of ASTM [C977](#). All lime shall come from a single source. If a source change is requested, a new mix design shall be submitted using lime from the proposed new source. The new design must be approved by the Engineer prior to use.

309.2.3 Lime Slurry: Lime slurry shall be a pumpable suspension of solids in water. The solids portion of the mixture, when considered on the basis of solids content, shall consist principally of hydrated lime of a quality and fineness sufficient to meet Section [309.2.2](#) requirements. Upon request, a Certificate of Compliance shall be provided to the Engineer for each load of lime applied at the project.

309.2.4 Water: Water used for mixing or curing shall be reasonably clean and free of oil, salt, acid, alkali, sugar, vegetable, or other substances injurious to the finished product. The pH (hydrogen ion concentration) of water to be used during construction for mixing or curing shall be within the range of 6.0 to 8.5. The procedure for determining pH values shall be based on the test apparatus used, the test apparatus may use either an electrometric or colorimetric method. The testing procedure shall be in accordance with the methods and instructions furnished by the manufacturer of the apparatus. Water known to be of potable quality may be used without testing.

309.3 COMPOSITION:

309.3.1 Lime Stabilization Mix Design: Before commencing lime treatment work, the Contractor shall submit for approval by the Engineer, a proposed mix design. The proposed mix design shall be prepared by a testing laboratory under the direction and control of an Arizona registered professional engineer. The mix design shall be determined using the soils or subgrade material to be stabilized, water from the source to be used during construction, and lime from the proposed supplier. The mix design shall identify the water source to be used during construction and, if not from a potable source, the water’s pH value.

Revised 2017

SECTION 309

For soil stabilization applications, the mix design shall report and comply with the following requirements:

Untreated Soil:

- (a) Sulfates: Tested per ARIZ 733, AASHTO T-290, or ASTM [C1580](#).
- (b) Moisture-Density Relationship (Proctor): Tested per ASTM [D698](#) Method A.
- (c) Plasticity Index: Test method AASHTO T-146 Method A, AASHTO T-89 Method A, and T-90.
- (d) Sieve Analysis and Minus No. 200 Wash: Test methods ASTM [C136](#) and ASTM [D1140](#).

Lime Treated Soil:

- (a) pH: Lime saturation content per ASTM [C977](#) APPENDIX or ASTM D6276.
- (b) Plasticity Index: Less than 3, per AASHTO T-146 Method A, AASHTO T-89 Method A, and T-90.
- (c) Swell Potential: Maximum expansive potential of 1.0 per ARIZ 249 using passing No. 4 sieve material. The maximum expansive potential shall be determined on a sample compacted to approximately 95 percent of the ASTM [D698](#) Method A maximum dry density at approximately 2% below optimum moisture content. The sample should be confined under a 100 psf surcharge and inundated.
- (d) Unconfined Compressive Strength: Minimum 160 psi per ASTM [D5102](#) Procedure A, after five days curing at 100°F, sealed in air-tight condition.
- (e) Mellowing time and mellowing moisture content for treated soil sections b and c to be determined by design engineer. Mellowing time and mellowing moisture content for treated soil section d determined by ASTM [D5102](#).
- (f) Hydrated Lime Content: The design engineer shall designate the minimum percentage of lime by dry weight of the dry soil to satisfy the criteria for Section [309.3.2](#) requirements. The percentage of lime specified shall be sufficient to allow for expected variations during the mixing process. A minimum of 5.0% hydrated lime by dry weight of the dry soil is required for all mix designs.

309.3.2 Lime Modification: For soil modification purposes only, the Engineer shall specify the minimum amount of hydrated lime or lime slurry required to meet the desired improved soil properties.

309.4 CONSTRUCTION:

309.4.1 General: It is the primary requirement of this specification to secure a completed subgrade containing a uniform lime mixture free from loose segregated areas, of uniform density and moisture content, well bound for its full depth, and with a smooth surface suitable for placing subsequent courses.

Prior to beginning any lime stabilization or modification, the subgrade shall be constructed and brought to grade and shall be shaped to conform to the typical sections, lines and grades as shown on the plans.

Lime shall be applied at the mix design rate for the depth of subgrade stabilization or modification shown on the plans or requested by the Engineer.

When the design requires treatment to a depth greater than 12 inches, the subgrade soil shall be treated in equal layers. The top layer(s) of soil shall be removed and stockpiled. The lower layer of soil to be treated shall then be treated and allowed to cure in place. After final mixing, the lower layer shall be compacted in maximum 12 inch thick compacted lifts. The stockpiled soil shall then be placed, treated, mixed and compacted in successive maximum 12 inch thick compacted lifts.

309.4.2 Weather Limitation: Lime treated subgrade shall not be constructed if the ambient temperature is below 40° F or when conditions indicate that temperatures may fall below 40° F within 24 hours.

309.4.3 Equipment: Contractor shall provide all equipment necessary to complete the work including grading and scarifying equipment, a spreader of the lime, mixing and pulverizing equipment, sheepsfoot and pneumatic rollers, sprinkling equipment and trucks. Gravity feed or tailgate spreading, defined as not having automatic controls, will not be permitted. The spreader shall demonstrate the ability to maintain a consistent spread rate over variable travel speeds. All equipment used for this work is subject to approval by the Engineer.

309.4.4 Application: Lime shall be spread only on that area where the mixing operation can be completed during the same working day. The lime application rate shall be at the design content to +0.5%, based on weight of dry soil. The Engineer reserves the right to vary the rate of application of lime from the mix design during the progress of construction as necessary to maintain a pH of the lime/soil mixture above 12.0 and the desired characteristics of the treated subgrade.

SECTION 309

For all lime applications, the Contractor shall provide the Engineer with daily application quantities.

309.4.4.1 Quicklime Application: Quicklime shall only be applied by approved spreader trucks equipped with operating dust collectors to minimize dust issues while loading. Additionally, dust control measures must be utilized during the spreading and soil mixing of quicklime. Contractor shall exercise safety measures when mixing quicklime with water.

309.4.4.2 Dry Hydrated Lime Application: Hydrated lime shall only be applied by approved spreader trucks equipped with operating dust collectors to minimize dust issues while loading. Additionally, dust control measures must be utilized during the spreading and soil mixing of dry lime.

309.4.4.3 Lime Slurry Application: Lime slurry shall be mixed in a portable mixing unit and spread with trucks equipped with an approved distribution system. Lime slurry shall be applied at a rate that will yield the required lime percentage determined by the mix design.

309.4.5 Mixing: The full depth of the treated subgrade shall be mixed with an approved mixing machine. The use of disc plows or blades are strictly prohibited except in areas specified by the Engineer. To insure a complete chemical reaction of the lime and soil or subgrade, water shall be used as required to maintain moisture content at optimum to +4% above the optimum of the lime treated mix design proctor, prior to beginning compaction. During the interval of time between application and mixing, lime that has been applied, unmixed and exposed to the open air for 10 hours or more will not be accepted. No traffic other than the mixing equipment will be allowed to pass over the spread of lime until after completion of mixing.

After mixing and prior to compaction, clay lumps shall meet the following criteria:

	<u>Percent</u>
Minimum of clay lumps passing 1-1/2 inch sieve	100
Minimum of clay lumps passing No. 4 sieve	60

309.4.6 Compaction: Compaction of the mixture shall begin after final mixing and shall be accomplished in accordance with the design specifications. Areas inaccessible to conventional rolling equipment shall be compacted to the required density by methods approved by the Engineer. Mellowing time and mellowing moisture content shall be specified by the mix design and performed prior to final compaction.

The material shall be aerated or watered as necessary to provide and maintain required moisture content. A composite of treated soil or subgrade materials from a minimum of five (5) random locations, per soil type, within the area to be stabilized shall be used to determine the maximum dry density and optimum moisture content in accordance with ASTM [D698](#). The field density of the compacted mixture shall be at least 95 percent of the maximum dry density of the field sampled proctor. The in-place compacted field density shall be determined in accordance with ASTM [D1556](#), sand cone, or ASTM [D6938](#), nuclear gauge. In the event of disputed results, the nuclear gauge density shall be correlated to the referee sand cone density while the nuclear water content shall be correlated to the referee ASTM [D2216](#) water content. The adjustment for rock larger than the no. 4 sieve shall be performed in accordance with ASTM [D4718](#).

After each section is completed, tests will be made by the Engineer. If the material fails to meet the density requirements and finished requirements, it shall be reworked to meet requirements at no additional cost to the Contracting Agency.

309.4.7 Thickness: The thickness of the lime treated subgrade shall be determined by visual inspection and/or by depth tests taken at intervals so that each test shall represent no more than 1000 square yards per layer. If more than one layer, the method used to remove material to determine the depth of lime treatment may be by shovel and/or pick, coring or other method approved by the Engineer. Phenolphthalein solution shall be used to detect the presence of lime. When the grade deficiency is more than 1 inch, the Contractor shall correct such areas in a manner satisfactory to the Engineer. Contractor shall replace, at no cost to the Contracting Agency, the material where depth tests are taken.

All irregularities, depressions, or weak spots which develop shall be corrected immediately by scarifying the areas affected, adding or removing material as required, and reshaping and recompacting. The surface of the course shall be maintained in a smooth condition, free from undulations and ruts, until other work is placed thereupon or the work is accepted. Compaction and finishing shall be done in such a manner as to produce a smooth dense surface free of compaction planes, cracks, ridges or loose materials.

Throughout this entire operation, the shape of the course shall be maintained by blading, and the surface upon completion, shall be smooth and shall conform with the typical section shown on the plans and to the established lines and grades. Should the

SECTION 309

material, due to any reason or cause, lose the required stability, density, and finish before the next course is placed or the work is accepted, it shall be recompact and refinished at no cost to the Agency.

309.4.8 Finishing and Curing: After the final layer or course of lime treated subgrade has been compacted, it shall be brought to the required lines and grades in accordance with the plans. The completed section shall then be finished by rolling with a pneumatic or other suitable roller.

Each layer of lime treated subgrade shall be maintained in a moist condition until the next layer of pavement structure is placed. If required, a fog seal for curing, in compliance with Section [333](#), shall be furnished and applied to the surface of the final layer of the lime stabilized material as soon as possible after the completion of final rolling and before the temperature falls below 40° F. Curing seal shall be applied at a rate between 0.10 and 0.20 gallons per square yard of surface. The exact rate will be determined by the Engineer.

After curing begins, all traffic, except necessary construction equipment shall be kept off the lime stabilized subgrade for a minimum of 7 days or until the final pavement structure layer(s) are placed. As an alternative, the Contractor may place a loose lift of aggregate base course over the curing subgrade. The aggregate base course should be kept moist during the curing process.

309.4.9 Maintenance: The Contractor shall maintain, at his/her own expense, the entire lime treated subgrade in good condition from the start of work until all the work has been completed, cured and accepted by the Engineer.

309.5 MEASUREMENT:

The quantity of lime slurry treated soils shall be measured by the square yard, measured in place, treated, compacted, to the proper depth, and accepted.

The quantity of curing seal shall be measured by the ton.

309.6 PAYMENT:

The lime treated soils measured as provided above, will be paid for at the contract price per square yard, which price shall be full compensation for the item complete, as herein described and specified.

The Owner or Engineer reserves the option to pay for the lime separately. Should this option be chosen, the lime treated soils measured as provided above will be paid for at the contract price per square yard which shall include full compensation for the item less lime, as herein described and specified. The lime materials will be paid for by the contract price per ton based on hydrated lime. If quicklime in slurry form is used there will be an additional pay factor of 1.3 applied to determine the actual amount of hydrated lime placed.

Payment for curing seal will be by the ton, based on the rate of application as requested by the Engineer.

- End of Section -

SECTION 310

PLACEMENT AND CONSTRUCTION OF AGGREGATE BASE COURSE

310.1 DESCRIPTION:

Aggregate base course shall comply with Section [702](#) unless the use of a different type of material is specifically authorized in the special provisions.

310.2 PLACEMENT AND CONSTRUCTION:

The compacted lift thickness shall not exceed 6 inches, unless approved by the Engineer. Based on the type of material, type of equipment and compaction methods used, the Contractor may propose a greater lift thickness to the Engineer for approval.

After distributing, the aggregate base course material shall first be uniformly watered and then graded to a uniform layer that will net, after compacting, the required thickness. The grading operation shall be continued to such extent as may be necessary to minimize segregation. The quantity of water applied shall be that amount which will assure proper compaction resulting in the density required by Section [310.3](#).

After placement, the aggregate base course surface shall be true, even and uniform conforming to the grade and cross-section specified. In no case shall the aggregate base course vary by more than ½ inch above or below required grade.

310.3 COMPACTION

The contractor is responsible for providing appropriate equipment and techniques to achieve the compaction results required by this specification. The aggregate base course shall be compacted in lift thicknesses as allowed by Section [310.2](#).

The laboratory maximum dry density and optimum moisture content for the aggregate base course material shall be determined in accordance with AASHTO T-99. (Note: when testing base materials – use method “C” or “D” as required based upon the gradation of the material.) Field ‘one-point’ maximum dry density and optimum moisture procedures shall only be allowed upon approval of the Engineer.

The in-place density shall be determined in the field by nuclear density testing in accordance with AASHTO T-310 or sand cone density testing in accordance with AASHTO T-191. In the event nuclear density testing is selected, and density results are in question, a sand cone correlation will be performed by the accepting agency at the contractor’s request, not to exceed one sand cone for each ten nuclear density tests.

A rock correction, to compensate for rock content larger than the #4 or ¾ inch sieves (as required by the laboratory maximum dry density and optimum moisture procedure selected), shall be performed in accordance with AASHTO T-224. Care should be taken to account for the specific gravity of the oversize particles particularly if recycled materials are utilized for aggregate base course. The specific gravity shall be determined in accordance with ARIZ-227c, as applicable.

For roadway construction, a minimum of one field density test shall be performed per lift per 660 feet per lane. For other aggregate base course applications, a minimum of one field density test shall be performed for each 800 square yards.

Unless otherwise noted in the project plans or project specifications, the moisture content of the aggregate base course at the time of compaction shall be the optimum moisture content +/- 3%.

The following percent compaction is required:

(A) Below asphalt concrete pavement	100%
(B) Below Portland cement concrete pavement, driveways, curb & gutter, sidewalks, and roadway shoulders	95%
(C) All other areas not subject to vehicular traffic	85%

SECTION 310

Areas which fail initial testing for density and/or moisture content shall be reworked until passing tests for density and/or moisture content are achieved. Lower moisture content percentages at the time of field density testing may be allowed if significant time has passed since the time of compaction and the required density has been achieved.

310.4 THICKNESS AND/OR PLASTICITY INDEX DEFICIENCY:

When in the opinion of the Engineer there is reason to believe that a deficiency in thickness, or an excess of plasticity exists, measurements or samples will be taken in the same pattern as that defined in Section 321. If the base has been covered or it is otherwise impractical to correct the deficiency, the corrective measures in Table 310-1 shall be taken by the Contractor at no additional cost to the Contracting Agency.

TABLE 310-1		
THICKNESS AND PLASTICITY DEFICIENCY		
Type	Deficiency	Corrective Measure
I	Less than 1/2 inch of the required thickness	No corrective measure required.
II	1/2 inch or more but less than 1 inch of the required thickness	(1) The contractor may choose to add additional material and rework the grade to meet the specification requirements. (2) The contractor may choose to increase the thickness of asphalt concrete by the amount of the aggregate base course thickness deficiency at no additional cost to the Owner. Required grade shall be met.
III	Thickness deficiency by greater than 1 inch	(1) The contractor will remove the aggregate base course and regrade the subgrade to allow the required aggregate base course layer thickness to be constructed. (2) If grades allow, the contractor may propose that the thickness of asphalt concrete be increased by the amount of the aggregate base course deficiency at no additional cost to the Owner.
IV	A plasticity index of 6 to 7 inclusive	(1) An Engineering Analysis (EA) that includes R-value testing may be prepared by the contractor to evaluate the expected performance of the aggregate base course layer. The EA may provide mitigation options for the Engineer to consider. If the Engineer accepts the plasticity index as a result of the EA, the material will be accepted at full payment. If the Engineer rejects the EA, the contractor will perform either option 2 or 3 below. (2) The contractor may choose to reprocess or treat the existing material to bring it within specification limits or remove deficient material from affected area and replace with material complying with the specifications. (3) If grades allow, the contractor may increase the thickness of asphalt concrete by 1/2-inch at no additional cost to the Owner.
V	A plasticity index of over 7	(1) The contractor may choose to reprocess or treat the existing material to bring it within specification limits or remove deficient material from affected area and replace with material complying with the specifications.

SECTION 322

DECORATIVE ASPHALT

322.1 GENERAL REQUIREMENTS:

Decorative asphalt is asphalt stamping that creates an imprinted surface pattern and/or installs color coatings to the surface of a newly constructed asphalt pavement. Mock ups may be required at the owner’s discretion to ensure Contractor familiarity with product and installation procedures. Acceptance of colors and application procedures should be accepted in writing from the agency/owner prior to commencement of work. Payment for mock ups, if required in the contract documents, will be considered incidental to the stamping or coating item.

The Contractor shall submit for review and approval all manufacturer product and technical data for materials proposed to be installed. The Contractor shall submit for review and approval a sample of the stamped asphalt material prior to installation. These submittals shall be submitted to the Engineer.

322.2 MATERIALS:

All products used in the surfacing system shall meet the minimum physical and performance properties in Table 322-1. The Contractor shall, upon request, submit a Certificate of Compliance to the Engineer indicating that the materials to be included in the work meet these specification requirements. The color used for painted asphalt shall be as per the contract documents or as approved by the Agency.

TABLE 322-1		
ASPHALT SURFACING SYSTEM PHYSICAL PROPERTIES		
CHARACTERISTIC	TEST SPECIFICATION	TEST RESULT – BASE
Solids by Volume (%)	ASTM D2697	68% Min
Solids by Weight (%)	ASTM D2369	78% Min
Density	ASTM D1475	13.7 lbs./gal Min
Dry-Time (To Recoat)	ASTM D5895	20 Min
Taber Wear Abrasion Dry H-10 Wheel	ASTM D4060 1 day cure	0.16 g/1000 cycles Max
Taber Wear Abrasion Wet H-10 Wheel	ASTM D4060 7 days cure	2.34 g/1000 cycles Max
QUV E Accel.	ASTM G154 Delta	0.53 Min
Hydrophobicity Water Absorption	ASTM D570	7.6% (9 Day Immersion) Max
Shore Hardness	ASTM D2240	67 Type D Min
Mandrel Blend	ASTM D522-93A	1/4" @ 21 Degree C Pass Min
Permeance	ASTM D1653	3.77 g/m ² /hr. (52 mils) Max
VOC	Per MSDS	25 g/l Max
Adhesion to Asphalt	ASTM D4541	Substrate Failure
Friction Wet	ASTM E303 British Pendulum Tester	WP * Coated - 62 Min WP * Uncoated - 59 Min AC ** Coated - 70 Min AC ** Uncoated - 61 Min
Cure Time	Measured @ 77 Degrees Fahrenheit	Dry to touch – 20 Min Light Foot/Vehicle Traffic – 2-4 Hrs. Full Cure – 5 to 7 days

WP*= Wheel Path (Test conducted on asphalt pavement in wheel path.)

AC**= Adjacent to curb (Test conducted on asphalt pavement adjacent to curb.)

SECTION 322

322.3 INSTALLATION & SURFACE PATTERNING:

The patterning equipment shall be metal templates that shall correspond to the patterns shown in the project plans and specifications.

The Contractor shall obtain the Engineer's approval prior to beginning asphalt stamping.

When new asphalt is to be stamped, it shall have one overnight period to set prior to stamping for conventional mixes and ARAC mixes shall have 30 days to set prior to the stamping/coating process. Asphalt shall be fully compacted prior to positioning the patterning template and meet all the requirements set forth in Sections [321](#) or [325](#) as applicable.

For raised medians and other areas not subject to vehicular traffic, the surface course shall be at least 2-1/2" of 1/2" or 3/8" Marshall Low Traffic asphalt concrete mix in accordance with Section [710](#), or as approved by the engineer.

The asphalt to be stamped shall be uniformly heated using infrared technology to a temperature that shall not exceed 280 degrees Fahrenheit. Templates shall be set in place using a plate compactor and fully embedded into the asphalt.

The template imprint depth shall be 3/8" over 95% of the patterned area. Template print depth shall be inspected prior to coating to ensure compliance. All hand tooling shall be complete, full depth, aligned vertically, and shall extend to the edge of the asphalt pavement, common edge, concrete curb, gutter, or other border. There shall be no over print or shadowing of patterns and no remnants of excess print on surrounding unintended areas. Should overprinting or other imperfections occur, these areas shall be repaired by using the same process outlined in this section to return the asphalt to a smooth condition to that of the unstamped area(s).

322.3.1 Surfacing System (Painted Asphalt & Clear Coat Sealant): The air temperature shall be at least 45 degrees F and rising before the application of surface system products begins. There shall also be no precipitation expected within 24 hours of the anticipated surfacing completion. The surface shall be free from laitance, grease, deleterious oils, or any other foreign matter prior to placing any pavement coating.

The surfacing system products shall be spray-applied. Where required to cover small areas, the surfacing system may be applied using brooms or brushes. When complete, the entire asphalt surface shall be uniformly covered with the surfacing product with no exposed asphalt present.

The Contractor shall use sufficient masking to ensure that the surface system products are applied only where specified. Masking shall be complete and no overspray, or other imperfections, onto surfaces not designated as coated surfaces shall be allowed.

The Contractor shall apply the surface system products per the manufacturer's recommendations. After the colorant has had sufficient time to set, a clear coat sealant, if required, shall be applied per the manufacturer's recommendations.

Total thickness of the surfacing product shall be per the manufacturer's recommendations or greater including the sealant.

After the surfacing system products have been applied, the treated asphalt shall not be exposed to vehicular traffic for eight (8) hours, or per the manufacturer's recommendations.

322.4 MEASUREMENT:

Approved and accepted decorative asphalt installations shall be measured by the square foot for asphalt surface patterning with color coating or for asphalt surface color coating without surface patterning. The measurement for asphalt stamping specialty design shall be the number of approved and accepted installations of each specialty design. Asphalt coloring shall be measured by the square foot.

322.5 PAYMENT:

Payment for specialty designs, for asphalt surface patterning with color coating, and for asphalt surface color coating without surface patterning shall be at the contract unit price and shall be full compensation for furnishing all labor, material, tools, equipment and incidentals, and doing all work involved in the installation of asphalt stamping complete in place, in compliance with the contract documents.

SECTION 325

Payment for safety edge preparation will be at the contract unit price for the quantities measured as described above.

Payment for tack coat will be by the ton diluted, based on the rate of application, as directed by the Engineer.

Payment for ARAC will be at the contract unit price, complete in place.

Application of lime water as approved by the Engineer will be paid at the contract unit price.

Payment for frame and cover adjustments will be at the contract unit prices specified in the proposal.

- End of Section -

SECTION 326

PLACEMENT AND CONSTRUCTION OF POLYMER MODIFIED ASPHALT CONCRETE

326.1 DESCRIPTION:

This section is to provide specifications for furnishing all materials, mixing at a plant, hauling and placing a mixture of aggregate materials, mineral admixture and asphalt binder to form a pavement course for placement upon a previously prepared base or sub base.

326.2 MATERIALS AND MANUFACTURE:

The materials shall conform to Section [719](#) for the type specified. The specific required mix type shall be called out in the contract documents or as directed by the Engineer.

326.3 WEATHER AND MOISTURE CONDITIONS:

Asphalt concrete shall be placed only when the surface is dry, and when the atmospheric temperature in the shade is 40 degrees F. (50 degrees F for Asphalt Concrete lift less than 2 inch thick) or greater. No asphalt concrete shall be placed when the weather is foggy or rainy, or when the base or sub base on which the material is to be placed is unstable. Asphalt concrete shall be placed only when the Engineer determines that weather conditions are suitable.

326.4 APPLICATION OF TACK COAT:

A tack coat shall be applied to all existing and to each new course of asphalt concrete prior to the placing of a succeeding lift of asphalt concrete. If approved by the Engineer, the tack coat may be deleted when a succeeding layer of asphalt concrete is being applied over a freshly laid course that has been subjected to very little traffic.

The application of the tack coat shall comply with Section [329](#). The grade of emulsified asphalt shall be SS-1h or CSS-1h as specified in Section [713](#).

The same material that is specified above for the tack coat shall be applied to the vertical surfaces of existing pavements, curbs, and gutters, against which asphalt concrete is to be placed.

The surface to be covered may require repair or patching as directed by the Engineer. This shall be addressed in the project specifications prior to the bidding of the project.

326.5 MIX DESIGN:

The mix design shall be submitted to the Engineer at least five working days prior to the start of asphalt concrete production. Mix designs provided by the agency may be utilized on projects at the Engineer's discretion. The Engineer will review and approve the mix design to assure it contains all of the required information as outlined in Section [719.3.1](#). The target values for gradations, binder contents, and air voids will be established as the accepted Job Mix Formula (JMF) based upon the mix design. Mix designs not containing all of the information will be returned within five working days of receipt of all mix design information, for action and resubmission by the contractor.

Once the mix design has been approved by the agency and the mixing plant selected, the Contractor and/or his supplier shall not change plants nor utilize additional mixing plants without prior approval of the Engineer.

If the contractor elects to change its source of material, the contractor shall furnish the Engineer with a new mix design, which meets the requirements of Section 719, as amended by the Project Specifications.

The contractor may make self-directed target changes to the approved mix design within the limits shown below. Requests for self-directed target changes shall be made in writing and acknowledged by the Engineer prior to the start of production of a lot and will remain in effect until such time as any additional changes are implemented. The self-directed target changes must meet

SECTION 326

the contract requirements for mix design criteria and gradation limits.

TABLE 326-1 ALLOWABLE SELF-DIRECTED TARGET CHANGES	
MEASURED CHARACTERISTICS	ALLOWABLE SELF-DIRECTED TARGET CHANGES
Gradation (Sieve Size)	
3/8 inch	± 4% from mix design target value
No 8	± 4% from mix design target value
No 40	± 2% from mix design target value
No 200	+0.5% from mix design target value
Binder Content	± 0.2% from mix design target value
Effective Air Voids	None

The contractor may propose target changes, other than self-directed changes, to the approved mix design for the approval of the Engineer. The Engineer will determine if the proposed target change will result in mix production that meets the contract requirements for mix design criteria and gradation limits. The target changes will not be retroactive for the purpose of acceptance.

326.6 MIX PRODUCTION:

All materials shall be proportioned by weight in a hot mix asphalt plant in the proportions required by the mix design to provide a homogeneous and workable mass. Each hot mix asphalt plant shall be inspected in accordance with the provisions contained in the 'Hot Mix Asphalt Production Facilities' by the Arizona Rock Products Association and shall have a current inspection certificate. All measuring devices shall be calibrated at least annually by a technician licensed by the Arizona Bureau of Weights & Measures. Mixing plants shall conform to the requirements of AASHTO M-156, except as modified herein.

In drum mix plants the mineral admixture shall be added and thoroughly mixed with the mineral aggregate by means of a mechanical mixing device prior to the mineral aggregate and mineral admixture entering the dryer. The moisture content of the combined mineral aggregate shall be a minimum of three percent by weight of the aggregate during the mixing process.

For drum-mix plants, the mineral admixture shall be weighed across a weight belt, or other approved alternative weighing system, with a weight totalizer prior to entry into the mechanical mixing device. The mechanical mixing device shall be a pugmill type mixer that is in good working condition. The rate of the aggregate feed shall not exceed the mixing device's capacity in ton per hour. The mixer shall be constructed to minimize the loss of mineral admixture and shall be located in the aggregate delivery system at a location where the mixed material can be readily inspected. The mixing device shall be capable of effective mixing in the full range of the asphalt concrete production rates.

The hot plant and equipment shall be constructed and operated to prevent loss of mineral admixture through the dust collection system of the plant.

A positive signal system shall be provided and used during production whereby the mixing shall automatically be stopped if the mineral admixture is not introduced into the mineral aggregate. The plant will not be permitted to operate unless the signal system is in good working condition.

The introduction of bituminous material shall be controlled by an automated system fully integrated with the controls or the mineral aggregate and mineral admixture. The production of the plant shall be controlled by the rate required to obtain a uniform mixture of all components. Drying and heating shall be accomplished in such a manner as to preclude the mineral admixture from becoming coated with un-spent fuel. The completed asphalt concrete may be held in storage for up to 12 hours in insulated or heated silos, providing the minimum temperature noted herein for placement and compaction is met behind the placement device. If the Engineer determines that there is an excessive amount of heat, heat loss, drain down, segregation and/or oxidation of the mixture due to temporary storage, use of surge bins or storage bins will be discontinued.

The temperature of the asphalt concrete upon discharge from the mixer shall not exceed 335 degrees F. The discharge temperature may be increased to 350 degrees F if the binder supplier affirms that no binder degradation will occur from such an increase, and when approved by the Engineer. If the asphalt concrete is discharged from the mixer into a hopper, the hopper shall be constructed so that segregation of the asphalt concrete will be minimized.

SECTION 326

326.7 TRANSPORTATION:

Petroleum distillates or other substances that will have a detrimental effect on the asphalt concrete shall not be used as a release agent.

The beds of all transportation units shall be clean and smooth to allow the free flow of material into the paving machine's hopper.

Tarpaulins shall be furnished on all trucks and used when weather condition warrant, or if directed by the Engineer.

326.8 PLACEMENT:

Placement of asphalt concrete pavement shall not commence until authorized by the Engineer. The Engineer's authorization to allow commencement of asphalt concrete paving will generally require all newly constructed valley gutters, curbing, and curb and gutters which new pavement is to be placed against to be in-place and in an acceptable condition. While it is preferred to have all newly constructed concrete items against which new pavement is to be placed be in an acceptable condition, the Engineer may allow paving to commence based on weather, the amount of defective concrete, or other considerations.

326.8.1 Placing: All courses of asphalt concrete shall be placed and finished by means of a self-propelled paving machine equipped with an automatically actuated control system, except under certain conditions or at locations where the Engineer deems the use of a self-propelled paving machine impracticable.

The control system shall control the elevation of the screed at each end by controlling the elevation of one end directly and the other end indirectly either through controlling the transverse slope or alternatively when directed, by controlling the elevation of each end independently.

The control system shall be capable of working with one of the following devices:

- (a) Ski or non-contact device of not less than 30 feet in length, supported throughout its entire length
- (b) Taut stringline or wire set to grade
- (c) Short ski or sonar sensing units from curb control
- (d) Joint matching shoe

Failure of the control system to function properly shall be cause for the suspension of asphalt concrete production. In order to achieve a continuous operation, the speed of the paving machine shall be coordinated with the hot mix plant and transport units.

If the asphalt concrete is dumped from the hauling vehicles directly into the paving machine, care shall be taken to avoid jarring the machine or moving it out of alignment. No vertical load shall be exerted on the paving machine by the truck.

If asphalt concrete is dumped upon the surface being paved and subsequently loaded in the paving machine, the loading equipment shall be self-supporting and shall not exert any vertical load on the paving machine. Substantially all of the asphalt concrete shall be picked up and loaded into the paving machine.

Self-propelled paving machines shall spread the mixture without segregation or tearing, true to line, grade and crown indicated on the project plans. Pavers shall be equipped with hoppers and augers that will distribute the mixture uniformly in front of an adjustable floating screed. The raising of the hopper wings must be minimized and the paving machine will not be operated when in an empty condition.

Screeds shall include any strike-off device operated by tamping or vibrating action which is effective, without tearing, shoving or gouging the mixture and which produces a course with a uniform texture and density for the full width being paved. Screeds shall be adjustable as to height and crown and shall be equipped with a controlled heating device for use when required. In the case of the screed, auger extensions and vibrators shall be installed wherever the screed is extended more than one (1) foot beyond the end of the base auger or auger extension. However, when placing material against an extremely uneven curb or edge over a short distance, the Engineer may waive the auger extensions and vibrators.

At any place not accessible to the roller, the mixture shall be thoroughly compacted with tampers to provide a uniform and smooth layer over the entire area compacted in this manner.

SECTION 326

326.8.2 Joints: Transverse joints, before a surface course is placed in contact with a cold transverse construction joint, the cold existing asphalt concrete shall be trimmed to a vertical face for its full depth exposing a fresh face. The fresh face shall be tack coated prior to placement of the new asphalt concrete. After placement and finishing the new asphalt concrete, both sides of the joint shall be dense and the joint shall be smooth and tight. The surface in the area of the joint shall not deviate more than 1/4 inch from a 12-foot straightedge, when tested with the straightedge placed across the joint, parallel to the centerline.

Longitudinal joints of each asphalt course shall be staggered a minimum of 6 inches with relation to the longitudinal joint of the immediate underlying course's cold longitudinal construction joint.

Longitudinal joints with existing or cold (more than 32 hours old) asphalt concrete shall require the existing pavement to be trimmed to a vertical face for its full depth exposing a fresh face. The fresh face shall be tacked prior to placement of the adjacent course. Longitudinal joints with an existing asphalt pavement that is less than 32 hours old that has had its edge protected from damage may have adjacent new asphalt concrete placed after applying the required tack coat. After placement and finishing of longitudinal joints, both sides of the joint shall be dense and the joint shall be smooth and tight. The surface in the area of the joint shall not deviate more than 1/4 inch from a 12-foot straightedge, when tested with the straightedge placed across the joint, in any direction.

326.8.3 Asphalt Leveling Course: A leveling course shall be used when specified, or as directed in writing by the Engineer, to bring existing pavement to a uniform grade prior to placing an overlay or other course. If a leveling course is being applied on an asphalt surface, a tack coat shall be applied. The compaction requirements contained in Section [326.10](#) do not apply to leveling courses.

326.8.4 Compaction; Asphalt Base Course and Surface Course: It is the contractor's responsibility to perform Quality Control monitoring and/or testing during compaction operations to achieve the required density. The temperature of the asphalt concrete immediately behind the laydown machine shall be at least 265 degrees F. A probe type electronic thermometer with a current calibration sticker attached will be used to measure the temperature of the asphalt concrete mixture. When measuring the temperature of the mat, the probe shall be inserted at mid-depth and as horizontal as possible to the mat. The contractor is responsible to achieve the required compaction.

Asphalt compaction equipment shall be of sufficient size and weight to accomplish the required compaction. All compaction equipment shall be operated and maintained in accordance with the manufacturer's recommendations and the project requirements. During the rolling operation, the speed of the roller shall not exceed three miles per hour, unless otherwise approved by the Engineer.

Pneumatic tired compactors shall be equipped with skirt-type devices mounted around the tires so that the temperature of the tires will be maintained during the compaction process.

The Engineer will determine the acceptability of the pavement compaction in accordance with Section [326.10](#).

326.8.5 Smoothness: The completed surfacing shall be thoroughly compacted, smooth and true to grade and cross-section and free from ruts, humps, depressions or irregularities. An acceptable surface shall not vary more than 1/4 inch from the lower edge of a 12-foot straightedge when the straightedge is placed parallel to the centerline of the roadway.

326.8.6 Polymer Modified Asphalt Concrete Overlay: Polymer modified asphalt concrete overlay consists of the placing and compacting plant mix polymer modified asphalt concrete over existing pavement. The mix design and thickness of the overlay shall be as shown on the plans or as specified in the special provisions.

Except when the existing asphalt surface is to be preheated and remixed, pavement surfaces shall be prepared as follows:

- (a) Areas designated for pavement repair by the contract documents (which may include severely raveled areas, severely cracked areas, over-asphalted areas, and other defects) shall be cut out and replaced. Pavement repairs shall be completed and approved before placing the overlay.
- (b) Before placing the overlay, raised pavement markers shall be removed, and milling shall be completed. Milling shall be as shown on the plans or specified in the special provisions and shall be in accordance with Section [317](#).
- (c) After pavement repairs and milling have been completed the entire surface shall be cleaned with a power broom.

SECTION 326

(d) After surfaces have been prepared to the satisfaction of the Engineer, they shall receive a tack coat per Section [326.4](#). Traffic will not be permitted to travel over surfaces which have received a tack coat, except when tack coat is applied to milled surfaces in compliance with Section [317.2](#) for dust control purposes. When the overlay is to extend onto a concrete surface, the concrete surface shall be thoroughly cleaned of loose dust and cement particles and shall be tack coated.

The overlay shall be placed as specified in Section [326.8.1](#) and compacted as specified in Section [326.8.4](#). The surface smoothness shall meet the tolerances specified in Section [326.8.5](#).

Frames and covers of manholes, survey monuments, valve boxes, clean-outs and other existing structures shall be adjusted in accordance with Section [345](#) to set flush with the finished surface of the new pavement. During adjustment, if pavement or base materials are removed or disturbed, they shall be replaced with approved materials installed in a manner acceptable to the Engineer.

On roads without curb and gutter, the existing unpaved shoulder elevation shall be adjusted by the Contractor to match the elevation at the edge of the new overlay and slope away from the new pavement surface at a rate that the existing quantity of shoulder material will allow. Shoulder material shall be compacted to a minimum of 95% of maximum density, determined in accordance with Section [301.3](#). Shoulder adjustment to match the new pavement surface elevation shall not be measured. The cost of shoulder adjustment shall be included in the price paid for the asphalt concrete overlay or other related pay items. When the Engineer determines an insufficient amount of material is available for shoulder adjustment, the Engineer may require the Contractor to provide additional material. Acceptable material for shoulders includes the existing shoulder material, millings, untreated base materials, or a granular material approved by the Engineer. Engineer requested imported material for shoulder adjustment is not included in the price paid for the asphalt concrete overlay.

326.8.7 Pavement Fabric Interlayer: Pavement fabric interlayer shall be used only when specified on the plans or in the specifications.

Pavement fabric interlayer shall be in accordance with Table [796-1](#) and be the class designated on the plans or in the specifications.

Asphalt binder coat used to bond the fabric to the pavement shall be paving asphalt PG 70-10 asphalt cement conforming to the requirements of Section [711](#). The application and distributing equipment for the asphalt binder shall conform to the requirements of Section [330](#). The asphalt binder coat shall be uniformly spray applied to the prepared pavement surface at the rate of 0.20 gallons per square yard for Class B fabric or at the rate of 0.25 gallons per square yard for Class A fabric. Some underlying surfaces may require a higher or lower application rate. A test strip may be necessary to determine the proper application rate. The width of liquid asphalt cement application shall be the fabric width, plus six inches.

Neither the asphalt binder coat or fabric interlayer shall be placed when weather conditions, in the opinion of the Engineer, are not suitable. The asphalt binder and fabric interlayer shall only be placed when the pavement is dry, the ambient air temperature is 50 degrees F and rising, and pavement temperature is 40 degrees F and rising.

Equipment for placing the fabric shall be mechanized and capable of handling full rolls of fabric. The equipment shall be able to lay the fabric smoothly to maximize pavement contact and remove air bubbles. Stiff bristle brooms shall be used to smooth the fabric. The equipment used to place the fabric shall be in good working order and is subject to approval by the Engineer.

Pavement fabric interlayer shall not be placed if the in-place binder is hotter than 325 degrees F or has cooled to 180 degrees F or below (as determined by non-contact thermometer).

Pavement fabric interlayer shall be placed onto the asphaltic binder with the heat bonded side up with a minimum amount of wrinkling or folding. Remaining wrinkles or folds 1-inch and larger shall be removed or slit and shingle-lapped in the direction of paving. Burning or torching of wrinkles is not allowed. Fabric shall overlap three to six inches to insure full closure of the joint. Transverse joints shall be shingle-lapped in the direction of paving to prevent edge pickup by the paver. A second application of hand-placed asphalt binder may be required at laps and repairs as determined by the Engineer to ensure proper binding of the narrow double fabric layer.

All areas where fabric has been placed shall be paved with asphaltic concrete during the same workshift. Placement of the asphaltic concrete shall closely follow fabric lay down. The temperature of the asphaltic concrete immediately behind the laydown machine shall not exceed 335 degrees F, unless the binder supplier has affirmed a higher temperature range in writing. In

SECTION 326

the event that the asphalt binder coat bleeds through the fabric causing construction problems before the overlay is placed, the affected areas shall be sanded with a sand blotter in compliance with Section [333](#). Excess sand shall be removed before beginning the paving operation. In the event of rainfall prior to the placement of the asphaltic concrete, the fabric shall be allowed to dry before the asphalt concrete is placed.

Turning of the paving machine or of other vehicles on the fabric shall be gradual and kept to a minimum to avoid damage to the fabric. Should equipment tires stick to the fabric during pavement operations, small quantities of paving asphalt concrete shall be broadcast on the fabric to prevent pick-up. Decrease of binder rate in order to minimize pick-up on tires is not allowed.

326.8.8 Thickened Edge: Shall be constructed in accordance with Section 321.8.8

326.8.9 Safety Edge: Shall be constructed in accordance with Section 321.8.9

326.8.10 Protection for Asphalt Base Course: Arterial roadway traffic shall not be allowed on a new asphalt base course that is less than five inches (5") in thickness without the written consent of the Engineer.

326.9 QUALITY CONTROL:

It is the contractor's responsibility to perform Quality Control monitoring and/or testing during asphalt concrete production to achieve the required compaction and to perform Quality Control monitoring and/or testing during asphalt concrete production to achieve the required mix properties. The Engineer may obtain samples of any portion of any material at any point of the operations for his own use. Also, the Engineer may order the use of any drying, proportioning and mixing equipment or the handling of any material discontinued which, in his/her opinion, fails to produce a satisfactory mixture.

The asphalt concrete produced shall conform to the requirements of the production tolerances established in Section [326.10](#). When the asphalt concrete does not conform to the production tolerances, it shall be reported to the Engineer, and corrective quality control measures shall be implemented, or production shall cease immediately at no additional cost to the contracting Agency.

Requests for referee testing as described in Section [326.11](#) will only be considered based on quality control test results performed by a laboratory accredited by the AASHTO Accreditation Program (AAP) for the tests being performed or a laboratory listed in the current ADOT Directory of Approved Materials Testing Laboratories for the set of tests in question. The laboratory shall use properly certified technicians in accordance with ASTM [D3666](#), Section 7 (Personnel Qualifications).

326.10 ACCEPTANCE:

326.10.1 Acceptance Criteria: Asphalt concrete will be divided into lots for the purpose of acceptance. A lot shall be one day's production. Each lot shall be divided into sublots of 500 ton or fraction thereof. Tests used to determine acceptance will be performed by a laboratory accredited by the AASHTO Accreditation Program (AAP) for the tests being performed. The contracting agency shall provide an appropriately accredited laboratory or laboratories to perform the acceptance testing. Laboratories shall use properly certified technicians in accordance with ASTM [D3666](#), Section 7 (Personnel Qualifications). The acceptance laboratory will take representative samples of the asphalt concrete from each subplot to allow for testing of gradation, binder content, air voids, pavement thickness, and compaction of base and surface courses. Acceptance of each subplot will be based on the test data from the sample(s) from that subplot. All acceptance samples shall be taken using random locations or times designated by the Engineer in accordance with ASTM [D3665](#).

326.10.2 Gradation, Binder Content and Air Voids: The acceptance laboratory will take a sample of the asphalt concrete in accordance with the requirements of Section 2 or 4 of Arizona Test Methods 104 or AASHTO T-168 from each subplot. The minimum weight of the sample shall be 45 pounds. Asphalt binder content and gradation shall be determined in accordance with AASHTO T-308 using the ignition furnace for each subplot. The acceptance laboratory is responsible for obtaining the necessary materials and performing an ignition furnace calibration as outlined in AASHTO T-308 for each asphalt concrete mixture utilized on the project. The correction factor used for each test shall be clearly indicated on the report. The bulk density for Marshall Mix designs shall be tested in accordance with AASHTO T-245. The bulk density for Gyrotory mix designs shall be determined in accordance with AASHTO T-312. The maximum theoretical density shall be determined in accordance with the requirements of AASHTO T-209 including fan drying per AASHTO T-209 Section 15. Effective voids of the laboratory compacted specimens will be determined at a minimum of once per lot in accordance with the requirements of AASHTO T-269. Should the testing for effective air voids not meet the "Full Payment" or "No Corrective Action" requirements of Table

SECTION 326

[326-5](#), additional testing for laboratory air voids on the remaining sublots will be performed as necessary to determine the extent of the deficiency. Acceptance testing results will be furnished to the contractor and the supplier within five working days of receipt of samples by the acceptance laboratory.

During production, the allowable deviations from the mix design gradation targets are listed in the tables below. The allowable production tolerances may fall outside of the mix design gradation bands.

TABLE 326-3	
GRADATION ACCEPTANCE LIMITS FOR PMAC	
Sieve Size	
1 inch	---
3/4 inch	---
1/2 inch	±7%
3/8 inch	±6%
No. 8	±6%
No. 40	±4%
No. 200	±2%

If the results from a single acceptance sample fall outside of the acceptance limits in Table 326-3 as applicable, a second sample shall be taken and if the second acceptance sample is also outside of the acceptance limits the Contractor shall cease production of asphalt concrete. Production shall not begin again until calibration test results verify that adjustments made to materials or proportions yield a gradation that falls within acceptance limits in Table 326-3 or as applicable.

If the asphalt binder content is within ± 0.50% of the mix design target value, the asphalt concrete will be paid for at the contract unit price. If the asphalt binder content deviates by more than ± 0.50% from the mix design target value, the deficient area will be evaluated within the subplot by coring one additional location at a maximum interval of 100 feet on each side of the deficient sample. The asphalt content of the original deficient sample will be averaged with the asphalt binder content of the two additional cores to determine compliance with the acceptance requirements. If the resulting average of the asphalt binder content deviates by more than ± 0.50% from the mix design target value, then Table [326-4](#) shall apply to the subplot. If approved by the Engineer, the Contractor may obtain additional cores to assist in formulation of an Engineering Analysis, but the additional cores shall not be used for re-evaluating acceptance.

TABLE 326-4		
ASPHALT BINDER CONTENT ACCEPTANCE AND PENALTIES		
Deviation from that permitted	When the contracting agency is the owner: Payment Reduction (\$ per ton of asphalt concrete)	When the contracting agency is not the owner (i.e. permits): Corrective Action
Over 0.2% <u>above</u> that permitted	Removal* or EA	Removal* or EA
Over 0.1% to 0.2% <u>above</u> that permitted	\$6.00	EA
Over 0.0% to 0.1% <u>above</u> that permitted	\$2.00	EA
Within permitted range	Full Payment	No Corrective Action
Over 0.0% to 0.1% <u>below</u> that permitted	\$2.00	EA
Over 0.1% to 0.2% <u>below</u> that permitted	\$6.00	EA
Over 0.2% <u>below</u> that permitted	Removal* or EA	Removal* or EA

NOTES: *The Contractor shall remove and replace the entire subplot that is deficient.
EA = Engineering Analysis per Section 326.10.6

SECTION 326

If the laboratory air voids fall within a range of -1.5% and +2% of the design target, the asphalt concrete will be paid for at the contract unit price. If the laboratory air voids are outside of this range, the deficient area will be evaluated within the subplot by coring one additional location at a maximum interval of 100 feet on each side of the deficient sample. The laboratory air voids of the original deficient sample will be averaged with the laboratory air voids obtained from each of the two additional cores to determine compliance with the acceptance requirements. If the resulting average of the laboratory air voids is outside the indicated range, then Table [326-5](#) shall apply to the subplot. If approved by the Engineer, the Contractor may obtain additional cores to assist in formulation of an Engineering Analysis, but the additional cores shall not be used for re-evaluating acceptance.

TABLE 326-5		
LABORATORY VOIDS ACCEPTANCE AND PENALTIES		
Laboratory Air Voids (Measured at N_{des} or 75 blows as applicable)	When the contracting agency is the owner: Payment Reduction (\$ per ton of asphalt concrete)	When the contracting agency is not the owner (i.e. permits): Corrective Action
Greater than -2.7% from Target	Removal* or EA	Removal* or EA
-2.7% to -2.1% from Target	\$5.00	EA
-2.0% to -1.6% from Target	\$2.00	EA
-1.5% to +2% from Target	Full Payment	No Corrective Action
+2.1 to +2.9% from Target	\$2.00	EA
+3.0% to +4.0% from Target	\$5.00	EA
Greater than 4.0% from Target	Removal* or EA	Removal* or EA

NOTES: *The Contractor shall remove and replace the entire subplot that is deficient.

EA = Engineering Analysis per Section [326.10.6](#)

If an agency or Engineer is purchasing asphalt concrete directly from a commercial material supplier, the agency or Engineer will use Section [326.10](#), and specifically Table 326-3 as applicable, [326-4](#) and [326-5](#) from Section [326.10](#), when determining the acceptance of the asphalt concrete with the material supplier.

326.10.3 Surface Testing: If directed by the Engineer surface drainage test shall be performed. The completed surfacing shall be thoroughly compacted, smooth and true to grade and cross-section and free from ruts, humps, depressions or irregularities. An acceptable surface shall not vary more than 1/4 inch from the lower edge of a 12-foot straightedge when the straightedge is placed parallel to the centerline of the roadway. The straightedge shall be furnished by the contractor and shall be acceptable to the Engineer.

All streets shall be water tested for drainage in the presence of the Engineer or designated representative before final acceptance. Any areas not draining properly shall be corrected to the Engineer's satisfaction at the Contractor's expense. Water for this testing shall be provided and paid for by the Contractor.

When deviations in excess of the above tolerance are found, humps or depressions shall be corrected to meet the specified tolerance. The defective pavement shall be cut out along neat straight lines or for multiple course pavements the surface course may be milled out, and the removed pavement replaced with fresh hot mixture and thoroughly compacted to conform with and bond to the surrounding area. Materials and work necessary to correct such deviations shall be at no additional cost to the Contracting Agency.

When pavement is cut out along neat straight lines, full depth longitudinal joints shall not be located within a lane wheel path or within forty-eight inches (48") of an asphalt pavement edge. Longitudinal joints shall comply with the restrictions for Type A Trench Repairs in Section [336.3](#).

SECTION 326

326.10.4 Asphalt Pavement Thickness: Asphalt pavement thickness will be determined from cores secured from each lift of each sublot. Such cores will be taken and measured by the Asphalt Concrete Coring Method. This method is found in Section [321.14](#). Each core location will be patched by the party responsible for the testing.

Acceptance or assessment of penalties for asphalt pavement thickness will be based on the combined total thickness of all asphalt concrete layers omitting all layers of asphalt-rubber asphalt concrete. If the final total pavement thickness exclusive of all ARAC layers is deficient from the target thickness by 0.25 inches or less, it will be paid for at the contract unit price.

If the thickness deficiency of the pavement core exceeds 0.25 inch, the thickness deficiency shall be evaluated by coring at a maximum interval of 100 feet on each side of the deficient core. The thickness of the original deficient core will be averaged with the thicknesses of the cores taken from each side of it to determine compliance with the acceptance requirements.

If the pavement thickness deficiency is greater than 0.25 inches and the contracting agency is not the owner (i.e. permits) the following will apply:

- (1) If the pavement thickness deviates from the target thickness by more than 0.25 inch but not more than 0.50 inch, corrective action will be required. This corrective action shall consist of application of a Type II slurry seal coat in accordance to Section [715](#). The Contractor may present an Engineering Analysis outlining other proposed remedial measures for the consideration by the Engineer. The Engineer will review the engineering analysis and decide within 30 working days whether to accept the proposed remedial measures.
- (2) If the pavement thickness deviates from the target thickness by more than 0.50 inch, corrective action will be required. The deficient area shall be overlaid with no less than a 1 inch thick lift, for the full width of the pavement to meet or exceed the designed thickness, with appropriate end and edge milling, with a mixture approved by the Engineer. The Contractor may present an engineering analysis outlining other proposed remedial measures for the Engineer's consideration. The Engineer will review the engineering analysis and decide within ten working days whether to accept the proposed remedial measures. If the Engineer chooses to reject the Engineering Analysis, the indicated overlay shall be constructed by the Contractor at no additional cost to the Owner.

If the contracting agency is the owner and the pavement thickness deficiency is greater than 0.25 inches but less than 0.50 inches, Table [326-6](#) will apply. If the pavement thickness deficiency is greater than 0.5 inches, the deficient area shall be overlaid with no less than a 1-inch thick lift for the full width of the pavement to meet or exceed the designed thickness using an asphalt mixture approved by the Engineer. The Contractor shall provide appropriate end and edge milling. The overlay and milling shall be accomplished by the Contractor at no additional cost to the contracting agency.

Total Specified Asphalt Pavement Thickness exclusive of ARAC (if any)	Reduction in Payment Applied to asphalt concrete Except ARAC layers (if any)
Less than 1.5 inches	50%
1.50 inches to 1.99 inches	33%
2.00 inches to 2.49 inches	25%
2.50 inches to 2.99 inches	20%
3.00 inches and greater	17%

326.10.5 Density:

326.10.5.1 Pavement 1-1/2 Inches or Less in Nominal Thickness:

Compaction shall consist of a "Rolling Method Procedure" using an established sequence of coverage with specified types of compactors. A pass shall be defined as one movement of a compactor in either direction. Coverage shall be the number of

SECTION 326

passes as are necessary to cover the entire width being paved.

The rolling sequence, the type of compactor to be used, and the number of coverages required shall be as shown in Table [326-7](#).

TABLE 326-7				
ROLLING SEQUENCE FOR LIFT THICKNESS 1½" OR LESS				
Rolling Sequence	Type of Compactor		No. of Coverages	
	Option No. 1	Option No. 2	Option No. 1	Option No. 2
Initial	Static Steel	Vibrating Steel	1	1
Intermediate	Pneumatic Tired	Vibrating Steel	4	2- 4*
Finish	Static Steel	Static Steel	1-3	1-3
* Based on the roller pattern which exhibits the best performance.				

The Contractor shall select the option for compaction and, when pneumatic-tired compactors are used will designate the tire pressure. Steel wheel compactors shall not be used in the vibratory mode for courses of one inch or less in thickness nor when the temperature of the asphaltic concrete falls below 180 degrees F. Initial and intermediate compaction shall be accomplished before the temperature of the asphaltic concrete falls below 200 degrees F.

Compaction will be deemed to be acceptable on the condition that the asphaltic concrete is compacted using the type of compactors specified, ballasted and operated as specified, and with the number of coverages of the compactors as specified.

326.10.5.2 Pavement Greater than 1-1/2 Inches in Nominal Thickness:

Achieving the required compaction is the responsibility of the contractor. The number and types of rollers is the contractor's responsibility and shall be sufficient to meet these requirements.

In-place air voids shall be determined in accordance with AASHTO T-269 utilizing cores taken from the finished pavement. The maximum theoretical density used in the determination of in-place air voids will be the average value from the acceptance samples determined for the lot as outlined in [326.10.1](#).

The Engineer will designate one random test location for each subplot and the acceptance laboratory will obtain one core from that location. Regardless of subplot quantities or boundaries, a minimum of one core will be obtained per residential street and a minimum of one core per travel lane for collector and arterial streets. The outside one foot of each pass of the pavement course or any unconfined edge will be excluded from testing. The Engineer may exclude areas from the compaction lot that are not accessible by normal compaction equipment. All coring shall be in accordance with Section 321.14.

The Contractor shall provide the traffic control to facilitate any coring operations necessary for compaction acceptance.

Cores will be taken per the Asphalt Concrete Coring Method. This method can be found in Section [321.14](#). Acceptance testing results will be furnished to the contractor within five working days of receipt of samples by the acceptance laboratory.

If the pavement density has in-place voids of between 4.0% and 8.0%, the asphalt concrete will be paid for at the contract unit price. If the acceptance core for a subplot indicates that the pavement density has in-place voids of less than 4.0% or greater than 8.0%, the deficient area will be evaluated by coring two additional locations at maximum intervals of 100 feet from the deficient core. The in-place voids of the original deficient core will be averaged with the in-place voids of the cores taken from 100 feet on each side of it to determine compliance with the acceptance requirements. If the resulting average of the in-place voids is outside the indicated range, then Table [326-8](#) shall apply to the subplot. If approved by the Engineer, the Contractor may obtain additional cores to assist in formulation of an Engineering Analysis, but the additional cores shall not be used for re-evaluating acceptance. All coring shall be in accordance with Section 321.14.

SECTION 326

TABLE 326-8		
PAVEMENT DENSITY PENALTIES		
Limits of In-place Air Voids for design lift thicknesses 1.5 inches and greater	When the contracting agency is the owner Payment Reduction (\$ per ton of asphalt concrete)	When the contracting agency is not the owner i.e. permits Corrective Action
Below 3.0%	Removal* or EA	Removal* or EA
3.0% to below 4.0%	\$10.00	EA
4.0% to 8.0%	Full Payment	No Corrective Action
Greater than 8.0% to 9.0%	\$6.00	EA
Greater than 9.0% to 10.0%	\$10.00	EA and Type II Surry Seal
Greater than 10.0%	Removal* or EA	Removal* or EA

NOTES: *The Contractor shall remove and replace the entire subplot that is deficient.
EA = Engineering Analysis per Section [326.10.6](#)

326.10.6 Engineering Analysis (EA): Within 10 working days after receiving notice that a lot or subplot of asphalt concrete is deficient and is found to fall within the “Removal or EA” band per Table(s) [326-4](#), [326-5](#), and/or [326-8](#) the contractor may submit a written proposal (Engineering Analysis) to accept the material in place at the applicable penalties along with possible remediation(s) listed in the “Removal or EA” category. Engineering Analysis can also be proposed for non-removal categories of “Corrective Actions” when the contracting agency is not the owner (i.e. permits).

The Engineering Analysis shall contain an analysis of the anticipated performance of the asphalt concrete if left in place. The Engineering Analysis shall also detail the effect of any proposed corrective action to the material(s) in place as it relates to the in-place material’s performance. The Engineering Analysis shall be performed by a professional engineer experienced in asphalt concrete testing and mix designs.

If a lot or subplot is accepted for referee testing and the referee test results still show a deficiency, the contractor shall have ten working days to submit an Engineering Analysis beginning upon notification of referee test results.

When an Engineering Analysis recommends that a specific lot or subplot should not be removed, the Engineering Analysis will recommend that the following penalties (Table [326-9](#)) be paid when the contracting agency is the owner, for the specific criteria being reviewed by the EA.

TABLE 326-9		
ENGINEERING ANALYSIS PENALTIES for REMOVAL* LOTS/SUBLOTS LEFT IN-PLACE		
Acceptance Criteria	Acceptance Limits	Penalty When Contracting Agency is the Owner (\$/Ton)
Asphalt Binder Content	Over 0.2% points from that Permitted	\$9.00
Laboratory Air Voids (Measured at N_{des} or 75 blows as applicable)	Less than 1.5% or Greater Than 8.0%	\$7.50
Limits of In-place Air Voids	Less than 2.7% or Greater than 4.0% from Target	\$15.00

Within 15 working days, the Engineer will determine whether or not to accept the contractor’s proposed Engineering Analysis.

SECTION 326

326.11 REFEREE:

If the Contractor has reason to question the validity of any of the acceptance test results, the Contractor may request that the Engineer consider referee test for final acceptance. Any request for referee testing must describe the contractor's reasons for questioning the validity of the original acceptance test results and must clearly describe which set of acceptance tests are in question. The engineer may either accept or reject the request for referee testing. When referee testing is accepted the Contractor (at the Contractors own expense) will engage an independent laboratory accredited by the AAP or a laboratory listed in the current ADOT Directory of Approved Materials Testing Laboratories as appropriate the acceptance tests that are being questioned. The independent referee laboratory shall use properly certified technicians in accordance with ASTM [D3666](#), Section 7 (Personnel Qualifications). For the set of test results in question the referee laboratory shall perform a new set of acceptance tests (as required by Section [326.10](#) representing the area for the set of tests in question). The referee tests will replace the original acceptance tests that were in question.

These tests may include asphalt binder content, aggregate gradation, Marshall or Gyrotory unit weight, maximum theoretical unit weight, laboratory air voids and in-place air voids (compaction). Samples for referee testing shall come from representative samples obtained from the completed pavement, as directed by the Engineer.

The number of samples taken will be the same as specified in Section [326.10](#). The independent laboratory shall compile the test results and transmit them to both the Engineer and the contractor. The independent laboratory shall include a report sealed and signed by an Engineer registered in the State of Arizona, who is experienced in asphalt concrete testing and mix design development. The signed report shall give an opinion that the material evaluated does or does not comply with project specifications, shall clearly describe any deficiencies, and the results will be binding between all parties.

326.12 MEASUREMENT:

Asphalt concrete pavement will be measured by the ton, or by the square yard, for the mixture actually used as allowed above, which shall include the required quantities of mineral aggregates, asphalt binder, and mineral admixture. Measurement shall include any tonnage used to construct intersections, roadways, streets, or other miscellaneous surfaces indicated on the plans or as directed by the Engineer.

Measurement for safety edge preparation only applies to overlays of existing pavements that require the construction of a safety edge when none exists. Safety edge preparation will be measured by the linear foot. Safety edge preparation will not be measured when a safety edge is part of new pavement construction, pavement widening, or when overlaying an existing pavement that contains a safety edge. The asphalt concrete pavement measurement shall include the tonnage used to construct safety edges or the square yard measurement for asphalt concrete pavement will be increased by the horizontal extension of the safety edge beyond the roadway pavement edge.

326.13 PAYMENT:

The asphalt concrete measured as provided above will be paid for at the contract price per ton or square yard, as adjusted per Section [326.10](#), which price shall be full compensation for the item complete, as herein described and specified.

Payment for tack coat will be by the ton diluted, based on the rate of application, as directed by the Engineer.

No payment will be made for any overrun in quantity of asphalt concrete in excess of 10 percent for newly constructed pavement having a total thickness equal to or greater than 2.5 inches. The overrun quantity is excess tonnage above the tonnage calculated based on actual field measurement of area covered, design thickness, and the mix design unit weight. The calculations for overrun will be by individual pay item. To compensate or adjust for a thickness deficiency in an underlying asphalt concrete course, the Engineer may authorize a quantity increase in excess of 10 percent for a subsequent asphalt concrete course. In such cases, the quantity in excess of 10 percent will be paid for at the lowest unit price.

Removal of raised pavement markers, pavement repairs, and surface pavement replacements required prior to roadway overlay operations will be paid for by other pay items unless otherwise specified. Except as otherwise specified, no separate payment will be made for work necessary to construct thickened edges, safety edges, or other miscellaneous items or surfaces of asphalt concrete.

Payment for safety edge preparation will be at the contract unit price for the quantities measured as described above.

-End of Section-

This Page is Reserved for Future Use

SECTION 331

MICROSURFACING SPECIFICATIONS

331.1 GENERAL:

The work covered by this specification consists of furnishing all labor, equipment, and materials for the application of a "quick traffic solid/polymer microsurface."

This specification covers the equipment and construction procedures for rut filling and/or resurfacing of existing paved surfaces. The microsurface shall be a mixture of cationic polymer modified asphalt emulsion, mineral aggregates, mineral filler, water and other additives properly proportioned, mixed and spread on the pavement surface.

331.2 MATERIALS:

The Contractor shall supply all materials necessary for the performance of the work in accordance with the specifications. The asphalt emulsion, aggregate, and mineral filler shall be as specified in Section [714](#). Materials shall be approved by the Engineer prior to the start of construction. When requested by the Engineer, Certificates of Compliance shall be provided for each delivery of emulsion.

The Contractor shall be responsible for the safety of all materials of which he has taken delivery until they are in place on the road, and shall take all necessary precautions to avoid loss by fire or theft, or damage by water, and shall bear the cost of replacing any such material that is lost, spilt, destroyed or damaged after delivery.

331.3 PROPORTIONING:

The microsurface shall be proportioned in accordance with the mix design. Calibrated sign flowmeters shall be provided to measure both the addition of water and additives to the pugmill. Emulsion and cement flow shall be tied directly to aggregate flow. All additive flows shall be calibrated.

331.3.1 Performance: The microsurface mixture shall be proportioned per the mix design to ensure:

(A) Trafficability - the material will permit controlled traffic without damage to the surface within thirty (30) minutes and uncontrolled traffic without damage within sixty (60) minutes, per Section [331.4.2.2](#).

(B) Prevent development of bleeding, raveling, separation or other distress for seven (7) days after placing the microsurface.

331.4 MIX DESIGN:

331.4.1 General:

331.4.1.1: The Contractor shall provide a job mix formula from an approved laboratory and present certified test results for the Engineer's approval. Compatibility of the aggregate and polymer modified emulsion shall be certified by the emulsion manufacturer. All the materials used in the job mix formula shall be representative of the materials proposed by the Contractor for use in the project.

331.4.1.2: All the products used in the construction shall have certifications from the suppliers and they shall be given to the Engineer upon delivery to the project.

331.4.1.3: Mix design and proportioning will be approved by the Engineer prior to the start of the project.

331.4.2: Specifications:

331.4.2.1: The Engineer shall approve the mix design prior to use. The specification limits are as follows:

Residual Asphalt	(ASTM D244)	6% - 11.5% by dry weight of aggregate
Mineral Filler	(ASTM C136)	0.1% - 1% by dry weight of aggregate

SECTION 331

Polymer Content/Type	4% min. (see Section 714.4)
Additive	As required for mix properties
Water	As required for mix properties
Aggregate Grading	Meets Section 331.4.2.4
Consistency (ISSA T-106)	2.5 to 3.0 cm
Traffic Time	See Section 331.4.2.2
Abrasion Loss (ISSA TB-100)	75 g/ft ² maximum
Adhesion (ISSA TB-114)	90% minimum
Loaded Wheel Sand Adhesion	See Section 331.4.2.3

331.4.2.2 Modified Cohesion Test (ISSA TB-139): Furnish laboratory test data showing the mix design to be trafficable thirty (30) minutes after application at 77 F conforming to the following criteria in accordance with test methods described in the applicable specifications.

Set Time Test: 30 minutes 12 kg-cm minimum.

Early Rolling Traffic Time: 60 minutes 20 kg-cm minimum.

331.4.2.3 Loaded Wheel Sand Adhesion Test (ISSA TB-109): Furnish laboratory test data showing the mix design conforming to the following criteria in accordance with test methods described in the appropriate specifications.

<u>Vehicles/day</u>	<u>Minimum Sand Adhesion</u>
0-30	70 g/ft ²
250-1500	60 g/ft ²
1500-3000	55 g/ft ²
greater than 3000	50 g/ft ²

331.4.2.4 The laboratory shall further report the quantitative effects of moisture content in the unit weight of the aggregate (bulking effect). The report must clearly show the theoretical recommended proportion of aggregate, mineral filler (Min. & Max.), water (Min. & Max.), additive(s), and asphalt, and how the proportions are based (dry aggregate weight, total mix, etc.).

331.5 TESTING: Samples for quality assurance will be taken throughout the project per ISSA TB101 for testing by an approved laboratory as required by the Engineer. Materials with test results not meeting these specifications shall be corrected immediately. Testing shall be at the expense of the Agency for the following:

- (A) Asphalt content
- (B) Aggregate gradation
- (C) Percent polymer content and type—certified by supplier

331.6 EQUIPMENT:

331.6.1 General: All equipment, tools and machines used in the performance of this work shall be maintained in satisfactory working condition at all times to ensure a high quality product.

SECTION 337

337.6.1 Blotter: On two lane roads or where traffic may come in contact with the hot sealant before it cures, a blotter or specialized bond breaking material shall be used to prevent asphalt bleeding and/or pickup of sealant by vehicular traffic. Blotter material shall be compatible with the crack sealant and any surface treatment being used.

337.7 MEASUREMENT:

Accepted pavement crack sealing shall be measured as indicated in the fee proposal by one of the following methods: square yards of pavement surface area sealed, pounds of sealant placed, or linear feet of cracks sealed.

337.8 PAYMENT:

Payment for pavement crack sealing at the contract unit price shall be full compensation for all labor, materials, equipment, tools, and incidentals used for surface preparation, placement of crack sealant and blotter materials, and cleanup.

- *End of Section* -

SECTION 340

CONCRETE CURB, GUTTER, SIDEWALK, CURB RAMPS, DRIVEWAY AND ALLEY ENTRANCE

340.1 DESCRIPTION:

The various types of concrete curb, gutter, sidewalk, curb ramps, driveways and alley entrances shall be constructed to the dimensions indicated on the plans and standard detail drawings.

340.2 MATERIALS:

Concrete shall conform to the requirements of Section [725](#). Concrete class shall be as noted on the standard details.

Expansion joint filler shall be ½-inch thick preformed bituminous material in compliance with Section [729](#), unless otherwise noted.

340.2.1 Detectable Warnings: Detectable warnings shall consist of raised truncated domes aligned in a square grid pattern in conformity to the Americans with Disabilities Act Accessibilities Guidelines (ADAAG). Truncated domes shall have the following nominal dimensions: base diameter of 1.0 inches (0.9 inches minimum) top diameter of 50 percent of the base diameter minimum to 65 percent of the base diameter maximum, and height of 0.2 inches. Dome center-to-center spacing of 2.35 inches, measured between the most adjacent domes on the square grid. Dome center-to-center spacing for radial installations shall be 1.6 inches minimum and 2.4 inches maximum with a base-to-base spacing of 0.65 inches minimum. Detectable warning panels shall be installed with the dome spacing and alignment maintained across adjoining panels.

Detectable warnings shall contrast visually with adjoining surfaces, either light-on-dark or dark-on-light. Specific colors to be used shall be approved by the local jurisdictional agency prior to installation. Detectable warnings shall have integral color throughout.

Detectable warning materials shall be durable with a non-slip surface not subject to spalling, chipping, delamination, or separation. All detectable warnings shall be approved by the local jurisdictional agency prior to installation.

Detectable warnings shall be either placed in freshly poured concrete (wet-set) or recessed into pre-formed concrete. Detectable warnings using wet-set placement shall have the bottom of the detectable warning continuously supported by the underlying concrete with no air voids. Detectable warnings placed into pre-formed recesses in the concrete shall have a firm fit without gaps along the edges, and be able to resist movement (i.e. sliding, rocking, or lifting) once in place.

340.3 CONSTRUCTION METHODS:

Existing concrete shall have a clean vertical edge where it is to be joined by new construction. Sawcutting is required when the existing matching edge is not a straight vertical edge.

340.3.1 Subgrade Preparation: The subgrade shall be constructed and compacted true to grades and lines shown on the plans and as specified in Section [301](#). All soft or unsuitable material shall be removed to a depth of not less than 6 inches below subgrade elevation and replaced with material satisfactory to the Engineer. Removal and replacement of soft or unsuitable materials will be paid for as extra work.

Subgrade classified as marginally expansive or expansive as defined in Table [340-1](#) shall be treated as follows unless the construction documents require alternative measures for mitigation of expansive soils. The upper 6 inches of marginally expansive soils shall be compacted per Section [301.3](#) at a moisture content between 0% to 3% above optimum moisture per ASTM [D698](#). Expansive soils shall be considered unsuitable and shall be treated or removed and replaced with material as directed by the Engineer. Alternate corrective measures contained in an existing geotechnical report or new site analysis can be submitted to the Engineer for approval. The submittal of alternative corrective measures must be a recommendation of an

SECTION 340

The Contractor shall stamp the company name and year on each end of the sidewalk or curb ramp constructed. The letters shall not be less than 3/4 inch in height and the depth of the stamped impression shall be between 1/8-inch and 1/4-inch.

340.3.8 Curing: As soon after the completion of the finishing operation as the condition of the concrete will permit, all exposed surfaces shall either be sprayed with a pigmented curing compound or sealed with a material conforming to Section [726](#). Curing compound shall be applied under pressure through a spray nozzle in such manner and quantity as to entirely seal all exposed concrete surfaces with a uniform film. The membrane shall be applied in two applications for a total coverage of 150 square feet per gallon. Concrete surfaces shall be kept damp until the curing compound is applied. Should the curing compound seal be broken or damaged before the expiration of 10 days after the placing of the concrete, the break shall be immediately repaired by the application of additional curing compound over the damaged area.

The need for adequate curing is greatest during the first few hours after placement of the concrete.

340.3.9 Tolerances: The face, top, back, and flow line of the curb and gutter shall not deviate in excess of 1/4-inch over 10 feet, as tested with a 10-foot straightedge or curve template, longitudinally along the surface.

The surface of concrete sidewalk or curb ramp shall not deviate in excess of 1/8-inch over 5 feet as tested with a 5-foot straightedge except for the 1/4-inch recess of the preformed material in expansion joints.

All finished concrete elevations shall not deviate from the elevations shown on the plans, or indicated by typical sections or standard details referenced within the construction documents, by more than 1/2 inch.

When required by the Engineer, gutters shall be water tested. The Contractor shall establish flow in the length of gutter to be tested by supplying and distributing water from a hydrant, tank truck or other source. After the supply of water is shut off and water has stopped flowing, the gutter shall be inspected for evidence of ponding. The work shall be deemed deficient if water is found ponded in the gutter to a depth greater than 1/2 inch or ponding extends onto the adjacent asphalt pavement.

Areas between elevations shown on the plans shall be straight graded or smoothly transitioned through a vertical curve in a manner approved by the Engineer or as otherwise indicated on the construction documents.

Slopes of Pedestrian facilities shall not exceed the maximum grades indicated in ADA guidelines: sidewalk cross slope of 2%, ramp slope of 8.33%, ramp and landing cross slope of 2% and flared side (wing) slope of 10%.

340.3.10 Deficiencies: Any section of the work deficient in depth or not conforming to the plans or specifications shall be removed and replaced by the Contractor at no additional cost to the Contracting Agency. Replacement or reconstruction shall be from joint to joint.

Concrete work that does not comply with tolerance requirements of Section [340.3.9](#), Tolerances, shall be removed and replaced. Remove and replace gutters that exceed the ponding tolerance. Grinding shall only be allowed if approved by the Engineer.

340.4 BACKFILLING:

Unless otherwise specified the Contractor shall backfill behind the curbs, sidewalk or curb ramps with soil native to the area to the lines and grades shown on the plans.

340.5 MEASUREMENT:

340.5.1 Concrete Curbs and Gutters: The various types of curb and gutter shown on the plans and in the proposal will be measured along gutter flow line through inlets, catch basins, driveways, curb ramps, etc., by the lineal foot to the nearest foot for each type, complete in place. Measurement for curb terminations and transitions shall be included with the linear measurement of the various types of curb or curb and gutter as shown on the plans and in the proposal.

Curb and gutter type shall be based on the configuration of the final exposed surfaces. The increased curb and gutter depth required at valley gutter aprons or driveways shall not be measured as a separate pay item; any additional Contractor cost shall be included in the unit cost associated with the valley gutter, driveway or other associated item.

SECTION 340

340.5.2 Concrete Flat Work: Sidewalks, driveways, alley intersections, valley gutters and aprons will be measured to the nearest square foot complete in place.

340.5.3 Curb Ramp Installations: Curb ramp installations shall be measured as complete installed units. Curbing (single curb or curb and gutter) located at the edge of roadway shall be measured and paid for separately. The surface area of curb ramps shall not be included in the measured quantity for sidewalk. Detectable warnings are an integral part of curb ramp installations and shall not be measured. Ramp curbs located behind the walkway are an integral part of parallel curb ramp and combination curb ramp installations and shall not be measured.

Curb ramps located within a curb return shall include the entire curb return area excluding the edge of roadway curbing. Curb ramp installations shall be categorized and measured by curb return radius, the number (one or two) of curb ramps contained within the return, and the type of curb ramps (perpendicular, parallel, or combination).

Each curb ramp not located within a curb return shall be categorized by type and measured as a complete unit. Perpendicular curb ramps shall include the area from the back of curb between the outer edges of the ramp wings to the top of the curb ramp, ending prior to and excluding the top landing. The landing area at the top of the perpendicular curb ramp is to be included in the measured sidewalk area. Parallel and combination curb ramps shall include the ramp curb and all surfaces between the ramp curb and the back edge of the roadway curbing.

340.6 PAYMENT:

Payment will be made in accordance with the unit prices as set forth in the proposal. Such payment shall include full compensation for furnishing all labor, material, tools and equipment and accomplishing all work in conformance with the contract documents.

Over-excavation of soft, expansive or unsuitable materials and installation of granular materials will be paid separately and not included within the above measured pay items.

- End of Section -

PART 400

RIGHT-OF-WAY AND TRAFFIC CONTROL

Section	Last Revised	Title	Page
401	1998	Traffic Control	401-1
405	2015	Survey Monuments	405-1
410	1998	Precast Safety Curbs	410-1
415	2017	Flexible Metal Guardrail	415-1
420	1998	Chain Link Fences	420-1
424	1998	Parkway Grading	424-1
425	1998	Topsoils	425-1
430	2014	Landscaping and Planting	430-1
440	1999	Sprinkler Irrigation System Installation	440-1

This Page Reserved for Future Use

SECTION 415

FLEXIBLE METAL GUARDRAIL

415.1 DESCRIPTION:

The work under this section shall consist of furnishing all materials, constructing new guardrail, and delineating guardrail sections at the locations shown on the plans.

Guard rail end treatments shall be as specified on the plans or special provisions.

415.2 MATERIALS:

The rail elements, bolts, nuts and other fittings shall conform to the specifications of AASHTO M 180, except as modified in this section. The rail metal shall conform to AASHTO M 180, Type I, Class A and in addition to the requirements of AASHTO M 180, shall withstand a cold bend, without cracking of 180 degrees around a mandrel of a diameter equal to 2 1/2 times the thickness of the plate.

Guardrail specified to be constructed with weathering steel (sometimes called Corten steel) shall conform to the requirements of AASHTO M 180, Type IV, Class A and use ASTM A588 steel.

Three certified copies of mill test reports of each heat from which the rail element is formed shall be furnished to the Engineer.

All materials shall be new, except as otherwise noted on the plans or special provisions.

Railing Parts furnished under these specifications shall be interchangeable with similar parts regardless of source. All surfaces of guardrail elements that are exposed to traffic shall present a uniform, pleasing appearance and shall be free of scars, stains or corrosion.

Nails shall be 16 penny common galvanized.

Bolts shall have shoulders shaped to prevent the bolts from turning.

Unless otherwise specified the rail elements, terminal sections, bolts, nuts, and other fittings shall be galvanized in accordance with Section [771](#). Where galvanizing has been damaged, the coating shall be repaired in accordance with Section [771](#).

Guardrail reflector tabs shall be either 3003-H14 Aluminum strip 0.063 ± 0.004 inches thick, or steel strip 0.078 ± 0.008 inches thick galvanized in accordance with ASTM [A653](#) coating designation G 90. The reflector material shall be high-reflectivity sheeting, either silver-white or yellow and shall conform to the requirements of Arizona State Department of Transportation Standard Specifications for Road and Bridge Construction. Adhesive for sheeting attachment to the metal tab shall be of the type and quality recommended by the sheeting manufacturer. Reflector tabs shall conform to the Reflector Tab Detail of Maricopa County Department of Transportation Standard Detail 3002.

Timber for posts and blocks shall be rough sawn (unplanned) or S4S with the nominal dimensions indicated. Any species or group of woods graded in accordance with the requirements for Timber and Posts of the Western Wood Products Association may be used. Timber shall be No. 1 or better, and the stress grade shall be as follows:

6" by 8" Post and Block	1200 psi
8" by 8" Post and Block	900 psi
10" by 10" Post and Block	900 psi

When the plans show guardrail systems using 8" by 8" timber posts and blocks, the Contractor may use 8 1/4" nominal size posts and blocks with a stress grade of 825 pounds per square inch.

At the time of installation, the dimensions of timber posts and blocks shall vary no more than plus or minus 1/2" from the nominal dimensions as specified on the project plans. The size tolerance of rough sawn block in the direction of the bolt holes shall vary no more than plus or minus 3/8".

All timber shall have a preservative treatment as per the requirements of AASHTO M 133.

Revised 2017

SECTION 415

Structural steel shapes shall conform to the requirements of ASTM [A36](#) and be galvanized in conformance with the appropriate requirements of AASHTO M 111. Dimensions shall meet the dimensional requirements of the American Institute of Steel Construction.

Steel tubes shall conform to the material requirements of ASTM [A500](#) or [A501](#) and be galvanized in conformance with the requirements of AASHTO M 180, Type 1.

415.3 CONSTRUCTION REQUIREMENTS:

415.3.1 General: The construction of the various types of guardrail shall include the assembly and erection of all component parts complete at the locations shown on the project plans or as directed by the Engineer.

Posts shall be as indicated by plans, standard details, or special provisions. Only one type and size of post and block shall be used for any one continuous length of guardrail.

Terminal sections shall be installed in accordance with the manufacturer's recommendations.

Workmanship shall be equivalent to good commercial practice and all edges, bolt holes and surfaces shall be free of torn metal, burrs, sharp edges and protrusions.

The various types of guardrail shall be constructed with wood posts and wood blocks, except as otherwise noted on the plans.

The bolted connection of the rail element to the post shall withstand a 5,000 pound pull at right angles to the line of the railing. All metal work shall be fabricated in the shop. No punching, cutting or welding shall be done in the field, except as provided for by the project plans. All metal cut in the field shall be cleaned and the galvanizing repaired in accordance with Section 771.

Where field cutting or boring of wood posts and blocks is permitted, the affected areas shall be thoroughly swabbed with at least two passes of the same type of wood preservative as initially used.

Where wood posts with rectangular sections are used, the posts shall be set so that the longest dimension is perpendicular to the rail.

All bolts shall extend beyond the nuts a minimum of two threads, except that all bolts adjacent to pedestrian traffic shall be cut off flush to the nut.

Bolts extending more than 2" beyond the nut shall be cut off to less than ½" beyond the nut.

Unless otherwise shown on the plans, bolts shall be torqued as follows:

Diameter of Bolt	Torque, Foot/Pounds
5/8"	45-50
3/4"	70-75
7/8" and larger	120-125

All bolts, other than those specified to be torqued, shall be securely tightened.

When guardrail is being constructed under traffic, the work shall be conducted so as to constitute the least hazard to the public. Guardrail work shall be performed in the direction of traffic flow when feasible.

Any section of guardrail that is removed for modification shall be replaced within five calendar days of the date the guardrail is removed, unless otherwise directed by the Engineer. At the end of each day, incomplete guardrail sections having an exposed end toward oncoming traffic shall have an appropriate temporary protective end treatment acceptable to the Engineer set securely in place together with approved overnight traffic control devices set in place.

415.3.2 Delineation: The maximum spacing between reflector tabs shall not exceed six posts. The slotted part of the tab shall be installed under the mounting bolt head so that the ReflectORIZED surface of the tab faces oncoming traffic. The exposed ends of the slotted part of the tab shall be bent up against and then over the top of the bolt head. The color of the reflective portion of

SECTION 415

the barrier markers shall conform to the color of the adjacent edge line. Silver-faced reflector tabs shall be installed on the right hand side of all roadways, and yellow-faced tabs shall be installed on the left-hand side of one-way, or median divided roadways.

415.3.3 Roadway Guardrail: Wood posts shall be used for new guard rail installations unless otherwise indicated by plans or special provisions. Wood posts shall either be driven or placed in manually or mechanically dug holes; however, driven posts will not be permitted at locations where damage to the curb, gutter, sidewalk, buried items, shoulders or pavement might occur. The Engineer will be the sole judge as to whether driving of posts will be allowed. Driving of posts shall be accomplished in a manner that will prevent battering, burring, or distortion of the post. Any post which is damaged to the extent it is unfit for use in the finished work, as determined by the Engineer, shall be removed and replaced at no additional cost to the Agency.

The posts shall be firmly placed in the ground. The space around posts shall be backfilled with selected earth, free of rock, placed in layers approximately 4 inches thick and each layer shall be moistened and thoroughly compacted to the density of the surrounding material.

Where pavement is disturbed in the construction of guardrail, the damaged surfacing shall be repaired as approved by the Engineer.

Where a culvert or other obstacle is at an elevation which would interfere with full depth post placement, guardrail installation shall comply with requirements of Section [415.3.4](#) Bolted Guardrail Anchors or Section [415.3.5](#) Nested Guardrail.

Wood blocks shall be toe nailed to the wood post with one 16 penny galvanized nail on each side of the top of the block. Wood blocks shall be set so that the top of the block is no more than ½” above or below the top of the post, unless otherwise shown on the project plans.

Rail elements shall be spliced at 25 foot intervals or less. Rail elements shall be spliced at posts unless otherwise shown on the project plans and shall be spliced by lapping in the direction of traffic in the nearest adjacent lane. Rail elements at joints shall have full bearing. When the radius of curvature is 150 feet or less, the rail elements shall be shop curved.

The Contractor shall dispose of surplus excavated material remaining after the guard railing has been constructed.

415.3.4 Bolted Guardrail Anchors: Where the elevation of the top surface of a concrete box culvert or other similar installation prevents the placement of a post of the specified length, the posts shall be shortened and anchored in accordance with Maricopa County Department of Transportation Standard Detail 3010.

415.3.5 Nested Guardrail: This work shall consist of furnishing and constructing nested guardrail, Type 1, 2, or 3, as shown in Maricopa County Department of Transportation Standard Details 3008-1 through 3008-3.

415.3.6 Guardrail to Structure Transitions: Guardrail transitions shall be constructed in accordance with requirements shown on the plans and special provisions.

415.4 MEASUREMENT:

The limits of measurement for roadway guardrail shall be as detailed in Maricopa County Department of Transportation Standard Detail 3016, except as otherwise noted on the plans or special provisions. Guardrail, of the type shown on the project plans, will be measured by the linear foot along the face of the rail element from center to center of posts, exclusive of guardrail terminals, guardrail end terminal assemblies, nested guardrail (Types 1, 2 and 3) and guardrail transitions.

Delineation is considered a part of installation of guardrail and hence will not be measured as a separate item.

The accepted quantities of guardrail posts secured with bolted guardrail anchors will be measured by the unit each.

Nested guardrail, Types 1, 2, or 3, and guardrail transitions will be measured by the unit each, complete in place and accepted as shown on the plans.

SECTION 415

415.5 PAYMENT:

Payment for accepted quantities of each type of guardrail will be made at the contract unit price. Payment shall be full compensation for furnishing materials and installing guardrails, complete in place including excavation, backfill, and disposal of surplus material.

Payment for Bolted Guardrail Anchors will be at the contract unit price, and shall be full compensation for the work, complete in place, including steel brackets, hardware, excavation, backfill, removing and replacing surfacing, cutting and fitting steel beam posts or timber posts, drilling anchor bolt holes in steel posts, timber posts, and box culverts, and disposal of surplus materials.

Payment for guardrail transitions will be at the contract unit price. Payment shall be full compensation for furnishing materials and installing guardrail transitions, complete in place including excavation, backfill, and disposal of surplus material.

- *End of Section* -

PART 500

STRUCTURES

Section	Last Revised	Title	Page
505	2017	Concrete Structures	505-1
506	2012	Precast Prestressed Concrete Members	506-1
510	1998	Concrete Block Masonry	510-1
511	1998	Brick Masonry	511-1
515	1998	Steel Structures	515-1
520	2012	Steel and Aluminum Handrails	520-1
525	1998	Pneumatically Placed Mortar	525-1
530	2000	Painting	530-1

This Page Reserved for Future Use

SECTION 505

Bars shall not be bent nor straightened in a manner that will injure the material. Bars with kinks or unspecified bends shall not be used.

505.5.3 Welded Wire Fabric: Welded wire fabric shall be held firmly in place and spliced not less than 2 meshes.

505.5.4 Dowels:

505.5.4.1 Dowel Placement: Dowel placement shall consist of drilling or coring dowel holes in concrete, furnishing and placing anchoring materials, and placing reinforcing steel dowels in accordance with the details shown on the Project Plans, and the requirements of the project Special provisions and these Specifications.

Dowel holes shall be cored where dowels are to be placed:

(A) in bridge decks and other thin concrete sections, and the depth of the dowel hole shown on the project plans projects to 3 inches or less from the opposite face of the concrete section, or

(B) within 4 inches from an existing concrete edge.

Cored holes shall be intentionally roughened after coring.

All holes shall be blown clean with compressed air, prior to applying the anchoring material.

The diameter of the holes for the dowels shall be 1/8" larger than the diameter of the dowels to be placed. The depth of the holes for the dowels shall be as shown on the Project Plans.

The anchoring materials for the dowels shall be an epoxy adhesive conforming to the requirements of Section [505.5.4.2](#), unless otherwise specified on the Project Plans and/or the project Special Provisions, or as approved by the Engineer.

505.5.4.2 Anchoring Materials: Epoxy materials shall be used for anchoring dowels. The Contractor shall, upon request, submit Certificates of Compliance or Analysis, complete with supporting documentation, to the Engineer for all epoxy materials to be used for anchoring dowels on a specific project, in accordance with the requirements of Section [106.2](#). The epoxy materials shall be provided by the Contractor in general conformance with the requirements of Section 1015-1 General Requirements of Section 1015 EPOXY MATERIALS of the current Arizona Department of Transportation (ADOT) Standard Specifications for Road and Bridge Construction, amended to date.

Epoxy resin base anchoring adhesive shall be used for anchoring dowels in concrete. High viscosity, or non-sag epoxies in the form of a gel, shall be used for horizontal or near-horizontal applications, where flow out of the anchoring hole is a problem. Low and medium viscosity epoxies may be used in vertical anchoring holes that open upward. The anchoring product shall specifically be designed for the designated application, according to the manufacturer's product literature.

Epoxy resin base anchoring adhesive shall provide the specified minimum tensile pullout resistance, when tested in accordance with Arizona Test Method 725, as modified in accordance with Section [505.5.4.3](#) of these specifications. The pot life of the anchoring material shall be determined in accordance with AASHTO T-237, Part I. The determined pot life shall be within 25 percent or 10 minutes of the pot life specified by the manufacturer, whichever is greater.

505.5.4.3 Dowel Strength Requirements: The epoxy resin base anchoring adhesive shall provide the following minimum pullout resistances:

#4 dowels:	12.0 Kips
#5 dowels:	18.6 Kips
#6 dowels:	26.4 Kips
#7 dowels:	36.0 Kips

Arizona Test Method (ATM) 725 is a Tensile Proof Dowel Test, developed by ADOT to specifically test #6 reinforcing steel dowels anchored in Portland cement concrete with an epoxy adhesive. When testing reinforcing steel dowel sizes, the anchoring hole (ATM 725: PREPARATION – 4. (a)) shall be modified as follows; the rotary hammer drill bit size (ATM 725: APPARATUS – 2. (a)) shall be modified accordingly:

SECTION 505

#4 dowels:	5/8" diameter x 8" long
#5 dowels:	3/4" diameter x 10" long
#6 dowels:	7/8" diameter x 12" long
#7 dowels:	1" diameter x 14" long

The Contractor may opt to conduct pullout tests with hole lengths other than those required above, based on the adhesive manufacturer's product literature and recommendations; however, test results shall demonstrate that the tested system provides the required pullout resistances.

505.6 PLACING CONCRETE:

No concrete shall be placed in any forms supported by falsework until the Contractor's Professional Engineer has inspected the completed falsework, and has issued a properly sealed and signed certificate that the falsework has been constructed according to the approved falsework drawings.

Where a schedule for placing concrete is shown on the plans, no deviation will be permitted therefrom unless approved in writing by the Engineer.

The placing of concrete for a given pour shall start at the low point and shall proceed up grade, unless otherwise permitted by the Engineer.

With the exception of concrete placed in slope paving and aprons, and concrete placed under water, all concrete shall be compacted by means of high frequency internal vibrators of a type, size and number approved by the Engineer. The number of vibrators employed shall be ample to consolidate the incoming concrete to a proper degree within 15 minutes after it is deposited in the forms. In all cases, at least 2 vibrators shall be available at the site of the structure in which more than 25 cubic yards of concrete is to be placed. The vibrators shall not be attached to or held against the forms or the reinforcing steel. The locations, manner and duration of the application of the vibrators shall be such as to secure maximum consolidation of the concrete without causing segregation of the mortar and coarse aggregate, and without causing water or cement paste to flush to the surface. Fresh concrete shall be spread in horizontal layers insofar as practicable and the thickness of the layers shall not be greater than can be satisfactorily consolidated with the vibrators. If additional concrete is to be placed, care shall be taken to remove all laitance and to roughen the surfaces of the concrete to insure that fresh concrete is deposited upon sound concrete surfaces. Layers of concrete shall not be tapered off in wedge-shaped slopes, but shall be built with square ends and level tops.

Mixed concrete, after being deposited, shall be consolidated until all voids are filled and free mortar appears on the surface. The concrete shall be placed as nearly as possible in its final position and the use of vibrators for extensive shifting of the mass of fresh concrete will not be permitted.

Fresh concrete shall not be permitted to fall from a height greater than 6 feet without the use of adjustable length pipes or elephant trunks.

The use of approved external vibrators for compacting concrete will be permitted when the concrete is inaccessible for adequate compaction provided the forms are constructed sufficiently rigid to resist displacement or damage from external vibration.

During the placing of concrete, care shall be taken that methods of compaction used will result in a surface of even texture free from voids, water or air pockets, and that the coarse aggregate is forced away from the forms in order to leave a mortar surface. Spades or broad-tined forks shall be provided and used to produce the desired results if required by the Engineer.

The use of chutes in conveying or depositing concrete will be allowed only at the discretion of the Engineer, and wherever they are used they shall be laid at such inclination as will permit the flow of concrete of such consistency as is required. The use of additional water in mixing the concrete to promote free flow in chutes of low inclination will not be allowed. Where necessary in order to prevent segregation, chutes shall be provided with baffle boards or a reversed Section at the outlet.

Concrete for columns shall be placed using pipes of adjustable length and not less than 6 inches in diameter.

Horizontal members or sections shall not be placed until the concrete in the supporting vertical members or sections has been consolidated and a minimum 2 hour period has elapsed to permit shrinkage to occur.

SECTION 505

Walkways shall be provided along each side and for the full length of bridge structures outside the deck area. These walkways shall be of sufficient width, and so constructed as to provide for the support of the bridges from which the longitudinal floats specified are to be operated. Inspection walkways and access thereto shall be provided under the deck forms between each pair of girders and outside of each outside girder for the full length of the bridge structure. The walkways shall be not more than 8 feet below the concrete to be inspected.

505.6.1 Construction Joints in Major Structures: The work shall be so prosecuted that construction joints will occur at designated places shown on plans unless specifically permitted otherwise by the Engineer. The Contractor shall complete, by continuous depositing of concrete, section for the work comprised between such joints. The joints shall be kept moist until adjacent concrete is placed.

All construction joints at the bottom of walls or arches, at the top of walls, and all longitudinal construction joints having a keyed, stepped or roughened surface shall be cleaned by sandblasting prior to placing the adjacent concrete. Any quality of sand may be used which will accomplish the desired results.

The sandblasting operations shall be continued until all unsatisfactory concrete, and all laitance, coatings, stains, debris, and other foreign materials are removed. The surface of the concrete shall be washed thoroughly to remove all loose material. The method used in disposing of waste water employed in washing the concrete surfaces shall be such that the waste water will not stain, discolor, or affect exposed surfaces of the structures. The method of disposal will be subject to the approval of the Engineer.

All horizontal construction joints or those on slight slopes, shall be covered with Class D mortar as specified in Section [776](#).

Expansion and contraction joints in the concrete structures shall be formed where shown on the plans and as directed. In general, such joints shall have smooth abutting surfaces, painted or separated and sealed as detailed on the plans. No reinforcement shall be extended through the joints, except where specifically noted or detailed on the plans. Concrete or mortar shall not be permitted to lap these joints in such a manner as to effect a tie or bond that would later promote spalling.

Asphalt paint or premolded asphalt filler used in joints shall be as specified in Section [729](#).

No direct payment will be made for furnishing and placing asphaltic paint, premolded asphaltic filler or other types of joint separators; their costs shall be included in the price bid for the item of work of which they are a part.

505.6.2 Adverse Weather Concreting:

(A) Hot Weather Concreting: Hot weather is defined as any combination of high ambient temperature, low relative humidity, and wind velocity which would tend to impair the quality of fresh concrete. These effects become more pronounced as wind velocity increases. Since last minute improvisations are rarely successful, preplanning and coordination of all phases of the work are required to minimize these adverse effects.

As an absolute minimum, the Contractor shall insure that the following measures are taken:

(1) An ample supply of water, hoses, and fog nozzles are available at the site. (2) Spare vibrators are on hand in the ratio of one spare vibrator for each three in use. (3) Preplanning has been accomplished to insure prompt placement, consolidation, finishing, and curing of the concrete. (4) Concrete temperature on arrival should be approximately 60°F. and in any event shall not exceed 90°F. The use of cold water and ice is recommended. (5) The subgrade is moist, but free of standing water. (6) Fog spray is utilized to cool the forms and steel. Under extreme conditions of high ambient temperature, exposure to the direct rays of the sun, low relative humidity, and wind, even strict adherence to these measures may not produce the quality desired and it may be necessary to restrict concrete placement to early morning only. If this decision is made, then particular attention must be directed to the curing process since the concrete will be exposed to severe thermal stresses due to temperature variation; heat of hydration plus midday sun radiation versus nighttime cooling.

(B) Cold Weather Concreting: Concrete shall not be placed on frozen ground, nor shall it be placed when the ambient temperature is below 40°F. unless adequate means are used to heat the aggregate and/or water and satisfactory means have been taken for protecting and heating the concrete during the curing period.

SECTION 505

(C) Wet Weather Concreting: Placing of concrete shall be discontinued when the quantity of rainfall is such as to cause a flow or wash to the surface. Any concrete already placed and partially cured shall be covered to prevent dimpling. A construction joint will be installed prior to shut down.

(D) Replacement of Damaged or Defective Concrete: Upon written notice from the Engineer, all concrete which has been damaged or is defective, shall be replaced by the Contractor at no cost to the Contracting Agency.

(E) Recommended Reference:

- (1) ACI-305 Hot Weather Concreting
- (2) ACI-306 Cold Weather Concreting
- (3) ACI-308 Recommended Practices for Curing Concrete

505.6.3 Bridge Deck Joint Assemblies:

505.6.3.1 Description: This work shall consist of furnishing and installing expansion devices including the seals, anchorage system, and hardware in accordance with the project plans and these specifications.

505.6.3.2 Materials: Elastomer Seals shall be of the Compression Seal or Strip Seal type, and shall conform to the requirements of the Arizona Department of Transportation Standard Specifications for Road and Bridge Construction Section 1011-5.

Steel shapes and plates shall conform to the requirements of ASTM [A36](#), or ASTM [A588](#).

505.6.3.3 Construction Requirements:

(1) General: Deck joint assemblies shall consist of elastomer and steel assemblies which are anchored to the concrete at the deck joint. The seal armor shall be cast in the concrete. The completed assembly shall be properly installed in the planned position, shall satisfactorily resist the intrusion of foreign material and water, and shall provide bump-free passage of traffic. For each size of seal on a project, one piece of the seal material supplied shall be at least 18 inches longer than required by the project Plans. The additional length will be removed in the presence of the Engineer and used for materials testing. Upon request, Certificates of Compliance conforming to the requirements of Section [106.2](#) shall also be submitted by the Contractor.

(2) Shop Drawings: Prior to fabrication, the Contractor shall submit shop drawings to the Engineer for approval, in accordance with the requirements of Section [105.2](#). The shop drawings shall show complete details of the method of installation to be followed, including a temperature correction chart for adjusting the dimensions of the joint according to the ambient temperature, and any additions or rearrangements of the reinforcing steel from that shown on the project plans.

(3) Elastomer Seals: Seals shall conform to the requirements specified.

(4) Armor: All steel for cast-in-place deck joint assemblies shall conform to the requirements specified.

(5) Galvanizing: All steel parts of strip seal assemblies shall be galvanized after fabrication, in accordance with the requirements of ASTM [A123](#) and [A153](#), unless ASTM [A588](#) steel is used. Bolts shall be high strength, conforming to the requirements of ASTM [A325M](#), with a protective coating of zinc, followed by a chromate and baked organic coating conforming to the requirements of ASTM F1135, Grade 3, 5, 6, 7, or 8 and Color Code A.

Steel parts of compression seal assemblies do not require galvanizing, plating, or painting.

(6) Joint Preparation and Installation: At all joint locations, the Contractor shall cast the bridge decks and abutment backwalls with a formed blockout, sized to accommodate the pre-assembled joint assembly. The joint assembly will be anchored in the concrete to be placed with the secondary pour in the blockout. Prior to the secondary pour, the surface of the existing concrete in the blockout shall be coated with an approved adhesive specifically formulated for bonding new concrete to old concrete.

(7) Welding: All welding and inspection of welding for structural steel shall be performed in accordance with the requirements of the latest revision of the AASHTO/AWS D1.5M/D1.5 Bridge Welding Code. The use of electro-slag welding process on structural steel will not be permitted.

PART 600


WATER, SEWER, STORM DRAIN AND IRRIGATION

Section	Last Revised	Title	Page
601	2016	<u>Trench Excavation, Backfilling and Compaction</u>	601-1
602	2016	<u>Trenchless Installation of Steel Casing</u>	602-1
604	2012	<u>Placement of Controlled Low Strength Material</u>	604-1
605	2014	<u>Subdrainage</u>	605-1
607	2015	<u>Trenchless Installation of Smooth Wall Jacking Pipe</u>	607-1
608	2017	<u>Horizontal Directional Drilling</u>	608-1
610	2015	<u>Water Line Construction</u>	610-1
611	2015	<u>Water, Sewer and Storm Drain Testing</u>	611-1
615	2015	<u>Sanitary Sewer Line Construction</u>	615-1
616	2017	<u>Reclaimed Water Line Construction</u>	616-1
618	2015	<u>Storm Drain Construction</u>	618-1
620	2012	<u>Cast-In-Place Concrete Pipe</u>	620-1
621	1998	<u>Corrugated Metal Pipe and Arches</u>	621-1
625	2016	<u>Manhole Construction and Drop Sewer Connections</u>	625-1
630	2012	<u>Tapping Sleeves, Valves and Valve Boxes on Water Lines</u>	630-1
631	2012	<u>Water Taps and Meter Service Connections</u>	631-1

This Page Reserved For Future Use

SECTION 608

Figure 608-1

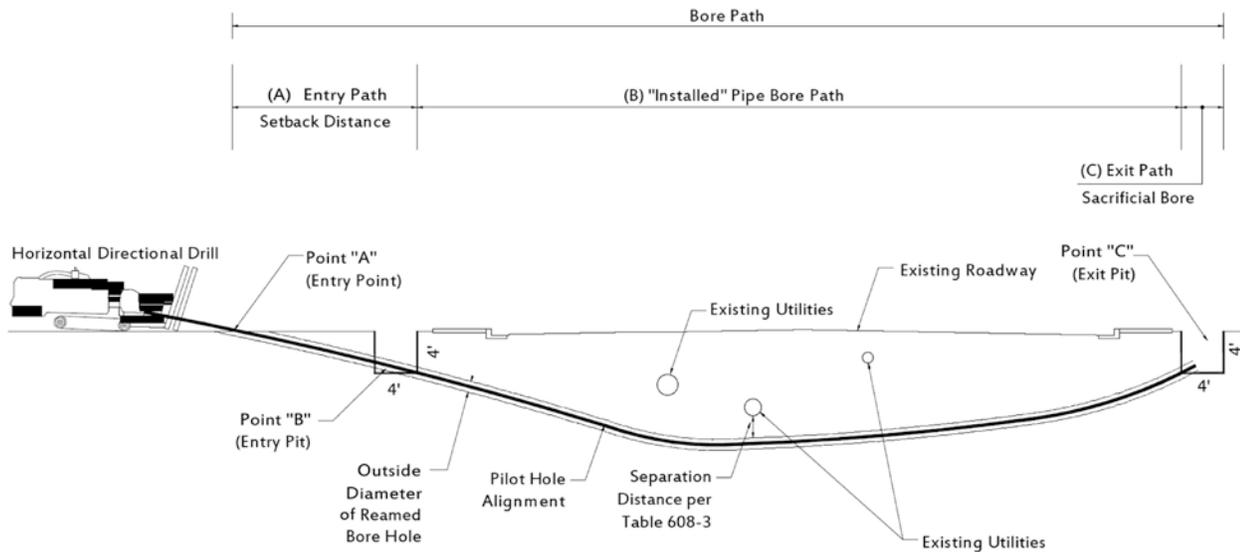

The setback distance is dependent upon elevation difference from A (surface) to B (desired grade), entry angle of rig, and bending radius of drill rods.

608.3 MATERIALS:

All product pipe material shall be of the size, type, and class as shown on the plans.

Sectional pipe is pipe that requires assembly of the joints, such as a bell and spigot pipe. Sectional pipe shall be specifically designed for installation by HDD.

Non-sectional pipe is pipe that requires joining together by a fusion or welding process. It is assembled prior to pulling the product pipe into the bore hole.

Non-sectional pipe that requires fusion of the joints, such as HDPE or Fusible-PVC, shall be fused by a skilled operator. The Contractor is responsible for using qualified personnel to ensure the fusion process follows the pipe manufacturer's recommended procedures. The Contractor shall submit certification from the pipe manufacturer or an accredited training agency documenting personnel qualifications. Untrained personnel shall not be permitted to perform fusion of any pipe on the project. The Contractor shall use a data-logger or manually record the following information for each fused joint in the product pipe line, unless the product pipe is used as a sleeve, pulled through a sleeve, or used for dry utilities.

- Date and time of joint
- Temperature
- Fusion pressure applied to joint
- Joining/fusion time
- Cooling time

Solid tracer wire AWG #14 or larger shall be pulled with the product pipe to ensure compliance with ARS 40-360.22, paragraph M.

608.4 RECORD DOCUMENTS AND SUBMITTAL REQUIREMENTS:

Submittal requirements are based on the bore size classification as shown in Table [608-2](#). The required items contained in items 1 through 10 shall be submitted prior to the authorization to commence field construction. Copies of all documents shall be maintained at the construction site and be available for inspection.

SECTION 608

TABLE 608-2			
SUBMITTAL REQUIREMENTS			
Required Record Document	Bore Size Classification		
	Small	Medium	Large
1. Agency Approved Plans	•	•	•
2. Personnel Qualifications	•	•	•
3. Surface Survey		•	•
4. Bore Plan/Profile		•	•
5. Drilling Fluid Management Plan		•	•
6. Equipment & Site Setup			•
7. Drilling Fluid Pressure Calculations			•
8. Pipe Stress and Pullback Calculations			•
9. Bore Data	•	•	•
10. As-Built	•	•	•

608.4.1 Agency Approved Plans: The facility owner shall submit plans for approval to the Agency in whose right-of-way the facility owner is proposing to install the new utility. Any changes from the approved plans will require a re-submittal of plans and re-approval. Plans are to identify the location of all property lines, right-of-way, and easements within the project construction limits. No work is to take place outside of the construction limits as shown on the agency approved plans.

608.4.2 Personnel Qualifications: The Contractor shall provide a competent and experienced individual familiar with the equipment and the type of HDD operations to be performed. The individual shall be present onsite while HDD operations are being performed and be in direct charge and control of the HDD operations. Documentation of experience and appropriate training evidenced by a certificate of attendance from a training program shall be provided upon request.

608.4.3 Surface Survey: A surface survey is not required for small bores unless specified by contract or permit documents. A surface survey requires the contractor prior to starting the drilling operation to submit to the Engineer a surface survey of elevations along the planned bore alignment, the maximum interval between elevations shall be ten feet (10'). Upon completion of the installation of the product pipe, the Contractor shall have a second survey performed and shall have the elevations compared with the pre-bore survey elevations. The second survey and the comparative results shall be submitted to the Engineer. Any change in elevation of a paved surface greater than ½" shall be considered excessive and shall be repaired at the Contractor's expense. Any elevation deviation of a paved flow line that is greater than ¼" shall be considered excessive and shall be repaired at the Contractor's expense.

608.4.4 Bore Plan/Profile: A scaled plan and profile drawing of the proposed pilot bore shall be submitted by the Contractor. The bore plan/profile shall show existing surface features and grade, the proposed pilot bore size and path, and all existing utilities with dimensioned vertical and horizontal clearances.

608.4.5 Drilling Fluid Management Plan: Indicate the type and amount of the drilling fluid planned to be used on the project. Include safety data sheets for the identified drilling fluid components and additives. The drilling fluid plan is developed based upon the anticipated soil conditions, and a sufficient supply of fluid is to be available to enable successful completion of the bore. Indicate the intended method of disposal of spent drilling fluids and include approvals from off-site disposal sources. The Drilling Fluid Management Plan shall identify contingency measures to be employed in case of inadvertent returns. The contingency plan may include containment with sediment control devices, removal with vacuum equipment or other such contingency measures as appropriate. In all cases, the plan shall indicate that if primary control measures fail and inadvertent returns cannot be controlled, work will be suspended until such a time as the plan can be revised and effective control measures can be implemented.

608.4.6 Equipment & Site Setup: Specifications on directional drilling equipment shall be used to ensure that the equipment will be adequate to complete the project. Equipment list is to include, but not be limited to: drilling rig, mud system, mud motors (if applicable), down-hole tools, guidance system, and rig safety systems. Include calibration records for guidance equipment. Identify the site setup dimensions and where the equipment shall be located. Equipment shown on the site layout

SECTION 616

RECLAIMED WATER LINE CONSTRUCTION

616.1 GENERAL:

This specification prescribes standards for utility water mains for the purpose of conveying, under pressure, reclaimed water for permitted reuse. Installation of reclaimed water mains shall be constructed in accordance with these specifications for materials, installation, and identification.

616.2 MATERIALS:

Pipe materials shall be in accordance with Section [610](#).

Valves shall be in accordance with Sections [610](#) and [630](#).

Valve boxes shall be in accordance with Section [345](#), this Section and Detail 391-1 and 391-2. Frame and cover shall be in accordance with Detail 271, or per Agency requirements. Manholes shall be in accordance with Section [625](#), [787](#), this Section, and applicable Details.

616.3 INSTALLATION:

Pipe shall be installed in accordance with Sections [601](#), [610](#), and this Section.

Valves and risers shall be installed in accordance with this section.

Valve box debris caps shall be installed in accordance with this Section and Detail 392.

When a reclaimed water main is adjacent to or crosses a potable water main, the reclaimed water main shall be considered a pressure or force sanitary sewer and comply with Details 404-1, 404-2 and 404-3 for separation and/or protection. When reclaimed water main is adjacent to or crosses a gravity, pressure or force sanitary sewer, the reclaimed water main shall be considered a potable water main and comply to Detail 404-1, 404-2 and 404-3 for separation and/or protection.

616.4 IDENTIFICATION:

The color purple shall be used for identifying all pipes, valves, and other equipment used for conveying reclaimed water.

Reclaimed water identification tape shall be an inert polyethylene plastic impervious to all known alkalis, acids, chemical reagents and solvents likely to be encountered in the soil. The tape shall be a minimum of 4.0 mils thick and no less than 3 inches wide. The tape shall be purple and shall have the words, "CAUTION: RECLAIMED WATER LINE" or similar wording printed in black lettering continuously along the entire length. Lettering shall be a minimum 1 ½ inches high. Spacing between the individual words of the message shall not exceed three inches.

Reclaimed water identification sleeving (pipe socks) shall be an inert polyethylene plastic that is impervious to all known alkalis, acids, chemical reagents and solvents likely to be encountered in the soil. The sleeving shall be a minimum of 4.0 mils thick. The sleeving shall be purple and shall have the words, "CAUTION: RECLAIMED WATER LINE" or similar wording printed in black lettering continuously along the entire length. Lettering shall be a minimum 1 ½ inches high. Spacing between the individual words of the message shall not exceed three inches.

Reclaimed water identification decals shall be made of inert material resistant to cracking, peeling, and fading due to sunlight and heat. Decals shall have an aggressive adhesive to ensure permanent bonding to the surface that is being identified. The decals shall have the words, "CAUTION: RECLAIMED WATER - DO NOT DRINK" or similar wording printed in black lettering on a purple background. Lettering shall be a minimum 1 inch high. Spacing between the individual words of the message shall not exceed three inches.

Reclaimed water pipe identified by stenciling shall use paint or ink resistive to all known alkalis, acids, chemical reagents and solvents likely to be encountered in the soil. Stenciled pipe shall have the words, "CAUTION: RECLAIMED WATER - DO NOT DRINK" or similar wording printed in black or white lettering on a purple background continuously along the entire length.

SECTION 616

Lettering shall be a minimum of 1 ½ inches high lettering shall be placed on a painted purple band a minimum of 3 inches wide that runs the entire length of the pipe.

Reclaimed water locating tape shall be an inert polyethylene plastic that is impervious to all known alkalis, acids, chemical reagents and solvents likely to be encountered in the soil. The tape shall be a minimum of 4.0 mils thick, 3 inch wide and contain a minimum thickness of 1/3 mil metallic foil or two embedded copper wires. The tape shall be purple and printed with the words, "CAUTION: RECLAIMED WATER LINE BELOW" or similar wordings printed in black lettering continuously along the entire length. Lettering shall be a minimum 1 ½ inches high. Spacing between the individual words of the message shall not exceed three inches.

Integral colored reclaimed water pipe shall be purple in color and shall have the words, "CAUTION: RECLAIMED WATER-DO NOT DRINK" or similar wording printed in black lettering at intervals no greater than 3 feet. Lettering shall be a minimum 1 ½ inches high. Spacing between the individual words of the message shall not exceed three inches.

Reclaimed water valve tags shall be inert polyethylene plastic that is impervious to all known alkalis, acids, chemical reagents and solvents likely to be encountered in the soil. The tags shall be purple and shall have the words, "CAUTION: RECLAIMED WATER-DO NOT DRINK" or similar wording printed in black lettering. The lettering shall be a minimum of ½ inch high.

616.4.1 Below- Ground Pipe:

(A) All below-ground reclaimed water pipelines shall be marked by identification tape, or sleeving, or integral coloring, or stenciling in conformance with this section.

Identification tape shall be installed parallel to the centerline and on top of the pipe. The identification tape shall be installed continuously for the entire length of the pipe and shall be securely fastened with plastic adhesive tape banded around both the pipe and identification tape at no more than 4-foot intervals.

Identification sleeving shall be installed so the wording runs along the top of the pipe. Care shall be exercised to avoid displacement of sock and to ensure its integrity.

Stenciled pipe shall be installed so the wording is parallel to the centerline and on top of the pipe.

(B) The Agency will need to maintain adequate records, install locating devices, conduct surveys, etc. to be capable of locating all below-ground reclaimed water mains as required by Arizona Revised Statutes 40-360. The means for locating the mains shall be at the discretion of the Agency. When locating tape is used, the tape shall be installed with the printed side up, directly above the pipe, parallel to the centerline, and buried 24 inches below the finished surface grade. The backfill shall be sufficiently leveled so that the tape is installed on a flat surface. Care shall be exercised to avoid displacement of the tape and to ensure its integrity.

In lieu of locating tape, a locating wire can be fastened by plastic adhesive tape to the top center of the pipe. The adhesive tape shall be banded around both the pipe and wire at no more than 4 foot intervals. The wire shall be continuous for the entire length of the pipe, without gaps, breaks, etc. The wire shall terminate above ground in a valve riser housing.

616.4.2 Above-Ground Pipe: All above ground pipe shall be identified by stenciling or decals in conformance to this section.

Stenciled pipe shall be installed so that the wording runs along both sides of the pipe.

Identification decals shall be placed on both sides of the pipe at intervals no greater than 3 feet. Surfaces shall be prepared to ensure proper adhesion of the decals.

616.4.3 Valves and Risers: Valve handles shall be affixed with tags in accordance with this section. Tags shall be securely fastened in a manner that ensures their visibility.

PART 700
MATERIALS

Section	Last Revised	Title	Page
701	2013	<u>Aggregate</u>	701-1
702	2013	<u>Base Materials</u>	702-1
703	2012	<u>Riprap</u>	703-1
705	2012	<u>Portland Cement Treated Base</u>	705-1
708	2011	<u>Asphalt Pavement Core Bonding Materials</u>	708-1
710	2017	<u>Asphalt Concrete</u>	710-1
711	2014	<u>Paving Asphalt</u>	711-1
712	1999	<u>Liquid Asphalt</u>	712-1
713	2012	<u>Emulsified Asphalts Materials</u>	713-1
714	2012	<u>Microsurfacing Materials</u>	714-1
715	2012	<u>Slurry Seal Materials</u>	715-1
716	2012	<u>Cover Material</u>	716-1
717	2017	<u>Asphalt-Rubber Asphalt Concrete</u>	717-1
718	2016	<u>Preservative Seal for Asphalt Concrete</u>	718-1
719	2017	<u>Polymer Modified Asphalt Concrete</u>	719-1
725	2017	<u>Portland Cement Concrete</u>	725-1
726	2015	<u>Concrete Curing Materials</u>	726-1
727	2017	<u>Steel Reinforcement</u>	727-1
728	2013	<u>Controlled Low Strength Material</u>	728-1
729	2017	<u>Expansion Joint Filler</u>	729-1
735	2016	<u>Reinforced Concrete Pipe</u>	735-1
736	2012	<u>Non-reinforced Concrete Pipe</u>	736-1
738	2012	<u>High Density Polyethylene Pipe and Fittings for Storm Drain and Sanitary Sewer</u>	738-1
739	2015	<u>Steel Reinforced Polyethylene Pipe & Fittings for Storm Drain, Irrigation & Sanitary Sewer</u>	739-1
740	2014	<u>Polypropylene Pipe & Fittings for Storm Drain, Irrigation & Sanitary Sewer</u>	740-1
741	2011	<u>Lining for Reinforced Concrete Sanitary Sewer Pipe</u>	741-1
742	2015	<u>Precast Manhole</u>	742-1
743	1998	<u>Vitrified Clay Pipe</u>	743-1
745	1998	<u>PVC Sewer Pipe and Fittings</u>	745-1
750	2015	<u>Iron Water Pipe and Fittings</u>	750-1
752	1998	<u>Asbestos-Cement Water Pipe and Fittings</u>	752-1
753	2000	<u>Galvanized Pipe and Fittings</u>	753-1
754	2012	<u>Copper Pipe, Tubing and Fittings</u>	754-1

Section	Last Revised	Title	Page
755	2012	Polyethylene Pipe for Water Distribution	755-1
756	2008	Dry Barrel/Fire Hydrants	756-1
757	1998	Sprinkler Irrigation System	757-1
758	2005	Concrete Pressure Pipe - Steel Cylinder Type	758-1
759	2002	Steel Pipe	759-1
760	1998	Coating Corrugated Metal Pipe and Arches	760-1
761	1998	Structural Plate Pipe, Arches, and Pipe Arches	761-1
770	2013	Structural and Rivet Steel, Rivets, Bolts, Pins, and Anchor Bolts	770-1
771	2016	Galvanizing	771-1
772	2017	Chain Link Fence	772-1
775	2015	Brick and Concrete Masonry Units (Blocks)	775-1
776	2012	Masonry Mortar and Grout	776-1
778	1998	Lumber	778-1
779	1998	Wood Preservatives	779-1
787	1999	Gray Iron Castings	787-1
790	1999	Paint	790-1
792	2010	Dust Palliative	792-1
795	2014	Landscape Material	795-1
796	2017	Geosynthetics	796-1

SECTION 708

ASPHALT PAVEMENT CORE BONDING MATERIALS

708.1 GENERAL:

This specification covers the materials required to bond asphalt pavement cores to the asphalt concrete pavement from which it was originally removed.

708.2 MATERIALS:

Bonding material shall be a single component cementitious, rapid hardening, high strength, waterproof bonding agent conforming to the physical properties shown in Table [708-1](#).

TABLE 708-1		
Bond Material Properties		
Property	ASTM Test Method	Requirements
Bond Strength, psi	C882	20 min.
Compressive Strength, psi, (70 degrees F., 30 minute cure)	C109	200 min.

Bonding material shall be impervious to water penetration at the joint after curing.

Bonding material shall, within 30 minutes at minimum ambient temperature of 70 degrees F., allow an 18" diameter core to support a traffic load equivalent to at least three (3) times the AASHTO H-25 standard wheel load.

The bonding material is required to securely bond the asphalt concrete core to asphalt concrete pavement and to fill all voids between the core and pavement and within the core.

708.3 TEST REPORT:

Specifications and test results for the bonding material shall be submitted to the Agency for review and approval before use.

- End of Section -

SECTION 710

ASPHALT CONCRETE

710.1 GENERAL:

Asphalt concrete shall be a mixture of asphalt cement and mineral aggregates. Mineral admixture shall be included in the mixture when required by the mix design or by the Engineer. Asphalt concrete shall be produced in accordance with Section [321](#).

The designation for asphalt concrete mixes shall be based on the nominal maximum aggregate size of the mix. The applicable mix designations are 3/8 inch, 1/2 inch, 3/4 inch. Each mix shall be designed using Marshall or Gyratory compaction methods.

The following table (Table [710-1](#)) displays the recommended range for lift thickness for various asphalt concrete mix designations found within Section [710](#). Please note that the minimum lift thicknesses are based on each mix designation's "Nominal Aggregate Size" and the relative coarseness of its gradation. The compacted thickness of layers placed shall not exceed the Maximum Lift Thickness of Table [710-1](#) except as otherwise provided in the plans and specifications, or if approved in writing by the Engineer.

TABLE 710-1				
RECOMMENDED LIFT THICKNESS FOR ASPHALT CONCRETE MIXES				
Asphalt Concrete Mix Designation (inches)	Minimum Lift Thickness Marshall Mixes	Maximum Lift Thickness Marshall Mixes	Minimum Lift Thickness Gyratory Mixes	Maximum Lift Thickness Gyratory Mixes
3/8"	1.0 inches	2.0 inches	1.5 inches	3.0 inches
1/2"	1.5 inches	3.0 inches	2.0 inches	3.0 inches
3/4"	2.5 inches	4.0 inches	3.0 inches	4.0 inches

710.2 MATERIAL:

710.2.1 Asphalt Binder: The asphalt binder specified in this section has been developed for use in desert climate conditions. When used in other climates, consideration should be given to adjustments in the asphalt binder selection. The asphalt binder shall be Performance Grade Asphalt conforming to the requirements of Section [711](#) for PG 70-10, unless otherwise approved by the Engineer or specified differently in the plans or special provisions.

710.2.2 Aggregate: Coarse and Fine aggregates shall conform to the applicable requirements of this section. Coarse mineral aggregate shall consist of crushed gravel, crushed rock, or other approved inert material with similar characteristics, or a combination thereof, conforming to the requirements of these specifications.

Coarse aggregate for hot mix asphalt is material retained on or above the No. 4 sieve and Fine aggregate is material passing the No. 4 sieve. Aggregates shall be relatively free of deleterious materials, clay balls, and adhering films or other material that prevent coating with the asphalt binder. Coarse and Fine aggregates shall conform to the following requirements when tested in accordance with the applicable test methods.

SECTION 710

TABLE 710-2		
COARSE/FINE AGGREGATE REQUIREMENTS		
Characteristics	Test Method	Requirements
Fractured Faces, % (Coarse Aggregate Only)	Arizona 212	85, 1 or more 80, 2 or more
Uncompacted Voids, % Min.	AASHTO T-304, Method A	45
Flat & Elongated Pieces, % 5:1 Ratio	ASTM D4791	10.0 Max.
Sand Equivalent, %	AASHTO T-176	50 Min.
Plasticity Index	AASHTO T-90	Non-plastic
L.A. Abrasion, % Loss	AASHTO T-96	9 max. @ 100 Rev. 40 max. @ 500 Rev
Combined Bulk Specific Gravity	AI MS-2/SP-2	2.35-2.85
Combined Water Absorption	AI MS-2/SP-2	0-2.5%

Tests on aggregates used in asphalt concrete outlined above, shall be performed on materials furnished for mix design purposes and composited to the mix design gradation.

Blend sand (naturally occurring or crushed fines) shall be clean, hard and sound material which will readily accept asphalt binder coating. The blend sand grading shall be such that, when it is mixed with the other mineral aggregates, the combined product shall meet the requirements of Table [710-2](#).

The natural sand shall not exceed 20 percent for the Marshall mixes and 15 percent for the Gyratory mixes by weight of the total aggregate for a mix.

710.2.3 Reclaimed Asphalt Pavement (RAP): When allowed by the Engineer, Reclaimed Asphalt Pavement (RAP), as defined in Section [701.5](#), may be used in asphalt concrete provided all requirements of Section [710](#) are met. References to use of RAP in Section [710](#) apply only if RAP is used as part of the mixture.

When RAP is used in asphalt concrete, it shall be of a consistent gradation, asphalt content, and properties. When RAP is fed into the plant, the maximum RAP particle size shall not exceed 1 1/2 in. The percentage of asphalt in the RAP shall be established in the mix design. The percentage of RAP binder shall be established in the mix design.

When RAP is used in base and intermediate courses, the amount of RAP aggregate and RAP binder should not exceed 30% contribution; Surface courses should be limited to 20% RAP aggregate and RAP binder contribution.

In addition to the requirements of Section [710.3.1](#), the job mix formula shall indicate the percent of asphalt RAP and the percent and performance grade of virgin (added) asphalt binder.

When less than or equal to 15% RAP binder is used by weight of total binder in the mix, the added virgin binder shall meet the requirements for PG 70-10 as shown in Section [711](#). When greater than 15% RAP is used by weight of the total binder in the mix, the added virgin binder will be dropped one grade for low and high temperature properties to a PG 64-16, unless testing indicates that the blend of the recovered RAP binder and virgin binder meets the requirements for PG 70-10 as shown in Section [711](#). The virgin asphalt binder shall not be more than one standard asphalt material grades different than the specified mix design binder grade.

710.2.4 Mineral Admixture: Mineral admixture when used as an anti-stripping agent in asphalt concrete shall conform to the requirements of AASHTO M-17. Mineral admixture used in asphalt concrete shall be dry hydrated lime, conforming to the requirements of ASTM [C1097](#) or Portland cement conforming to ASTM [C150](#) Type II or ASTM [C595](#) Type IP. The amount of hydrated lime or Portland cement used shall be determined by the mix design. The minimum mineral admixture content within a mix will be 1.00 percent, by weight of total aggregate.

SECTION 710

710.3 MIX DESIGN REQUIREMENTS:

710.3.1 General: The mix design for asphalt concrete shall be prepared by a laboratory that is accredited through the AASHTO Accreditation Program (AAP) in Hot Mix Asphalt Aggregates and Hot Mix Asphalt. The laboratory shall be under the direct supervision of a Civil Engineer, registered by the State of Arizona, and who is listed by ADOT as a “Qualified Asphaltic Concrete Mix Design Engineer” within ADOT’s latest list of approved laboratories. The latest list of approved laboratories is available on ADOT’s web page www.azdot.gov. The date of the design shall not be older than one year from the date of submittal, unless supportive documentation is provided and approved by the Engineer.

The mix design report shall include the following elements as a minimum.

- (1) The name and address of the testing organization and the person responsible for the mix design report.
- (2) The mix plant identification and/or location, as well as the supplier or producer name.
- (3) A description of all products that are incorporated in the asphalt concrete along with the sources of all products, including admixtures and asphalt binder, and their method of introduction.
- (4) The supplier and grade of asphalt binder, the source and type of mineral aggregate, and the percentage of asphalt binder and mineral admixture used.
- (5) The percentage of RAP and RAP Binder being contributed to the total mix shall be included in the mix design report.
- (6) The mix design report shall state whether it is Gyratory or Marshall, and the size designation.
- (7) The results of all testing, determinations, etc., such as: specific gravity and gradation of each component, water absorption, sand equivalent, loss on abrasion, fractured coarse aggregate particles, Tensile Strength Ratio (ASTM [D4867](#)), Marshall stability and flow, asphalt absorption, percent air voids, voids in mineral aggregate, and bulk density. Historical abrasion values may be supplied on existing sources. The submittal should include a plot of the gradation on the Federal Highway Administration’s 0.45 Power Gradation Chart, plots of the compaction curves and the results of moisture sensitivity testing.
- (8) The laboratory mixing and compaction temperature ranges for the supplier and grade of asphalt binder used within the mix design.
- (9) A specific recommendation for design asphalt binder content and any limiting conditions that may be associated with the use of the design, such as minimum percentages of crushed or washed fine aggregate.
- (10) The supplier’s product code, the laboratory Engineer’s seal (signed and dated), and the date the design was performed.
- (11) If a Warm Mix Technology or additive is used; the following shall be included:
 - Technology type and supporting manufacturer information; including instructions pertaining to laboratory mixture temperatures and curing.
 - Amount (%) of additive (technology) used in the mixture.
 - Attached copy of the ADOT approved product list, showing additive/technology
 - Minimum plant production temperature shall not fall below manufacturer’s recommendation.
 - Minimum field compaction temperature shall be identified.
 - Identify any special mixing or compaction temperatures or special methods to be used when conducting Quality Assurance or Quality Control testing of field collected samples. Example: if the field collected samples of warm mix asphalt can be treated as conventional hot asphalt mix, provide the equivalent conventional hot asphalt mix compaction temperature.

SECTION 710

The mix design shall be submitted to the Agency or Engineer by the Contractor/Supplier for which it was developed as part of his project submittals. Once the mix design has been approved by the agency or Engineer, the Contractor and/or his supplier shall not change plants nor use additional mixing plants without prior approval of the Engineer. Any changes in the plant operation, the producer's pit, the asphalt binder, including modifiers in the asphalt binder, or any other item that will cause an adjustment in the mix, shall be justification for a new mix design to be submitted.

710.3.2 Mix Design Criteria: The mix design shall be performed by one of two methods, Marshall Mix Design or Gyrotory Mix Design. The method shall be specified on the plans, special provisions, or by the Engineer. A minimum of 4 points will be used to establish the mix design results. The oven aging period for both Marshall and Gyrotory mix design samples shall be 2 hours.

710.3.2.1 Marshall Mix Design: The Marshall Mix Design shall be performed in accordance with the requirements of the latest edition of the Asphalt Institute's Manual, MS-2 "Mix Design Methods for Asphalt Concrete." The mix shall use the compactive effort of 75 blows per side of specimen. The mix shall comply with the criteria in Table [710-3](#).

TABLE 710-3				
MARSHALL MIX DESIGN CRITERIA				
Criteria	Requirements			
	3/8" Mix	1/2" Mix	3/4" Mix	Designated Test
1.Voids in Mineral Aggregate: %, min	15.0	14.0	13.0	AI MS-2
2.Effective Voids: %, Range	4.0±0.2	4.0 ±0.2	4.0 ±0.2	AI MS-2
3.Absorbed asphalt: %, Range*	0-1.0	0-1.0	0-1.0	AI MS-2
4.Dust to Eff. Asphalt Ratio, Range **	0.6-1.4	0.6-1.4	0.6-1.4	AI MS-2
5.Tensile Strength Ratio: % Min.	65	65	65	ASTM D4867
6.Dry Tensile Strength: psi, Min.	100	100	100	ASTM D4867
7.Stability: pounds, Minimum	2,000	2,500	2,500	AASHTO T-245
8.Flow: 0.01-inch, Range	8-16	8-16	8-16	AASHTO T-245
9.Mineral Aggregate Grading Limits				AASHTO T-27
Percent Passing with Admix				
Sieve Size	3/8 inch Mix	1/2 inch Mix	3/4 inch Mix	
1-1/4 inch				
1 inch			100	
3/4 inch		100	90 – 100	
1/2 inch	100	85 – 100	---	
3/8 inch	90-100	62 – 85	62 – 77	
No. 8	45-60	40 – 50	35 – 47	
No. 40	10-22	10 – 20	10 – 20	
No. 200	2.0 – 10.0	2.0 – 10.0	2.0 – 8.0	

* Unless otherwise approved by the Engineer.

** The ratio of the mix design composite gradation target for the No. 200 sieve, including admixture, to the effective asphalt content shall be within the indicated range.

SECTION 710

710.3.2.2 Gyrotory Mix Design: Gyrotory Mix Designs shall be performed in accordance with the requirements of latest edition of the Asphalt Institute's SP-2 manual. Mix design laboratory compacted specimens shall be prepared using a gyrotory compactor in accordance with AASHTO T-312.

The mix design shall be formulated in a manner described for volumetric mix designs in the current edition of the Asphalt Institute Manual SP-2, except the number of trial blend gradations necessary will be determined by the mix design laboratory. Duplicate gyrotory samples shall be prepared at a minimum of four (4) binder contents to select the recommended binder content. The gyrotory specimens shall be compacted to 160 gyrations. Volumetric data for the design number of gyrations, N_{des} , and the initial number of gyrations, N_{ini} , are then back calculated based on the bulk specific gravity, G_{mb} , of the N_{max} specimens and the height data generated during the compaction process of those same specimens.

TABLE 710-4	
Number of Gyrations	
N_{ini}	8
N_{des}	100
N_{max}	160

The corrected density of the specimens shall be less than 89.0 percent of maximum theoretical density at N_{ini} . The corrected density of the specimens shall be less than 98.0 percent of maximum theoretical density at N_{max} . The Gyrotory mix shall comply with the criteria in Table [710-5](#).

TABLE 710-5				
GYRATORY MIX DESIGN CRITERIA				
Criteria	Requirements			Designated Test
	3/8" Mix	1/2" Mix	3/4" Mix	Method
1. Voids in Mineral Aggregate: %, Min.	15.0	14.0	13.0	AI SP-2
2. Effective Voids: %, Range	4.0 ± 0.2	4.0 ± 0.2	4.0 ± 0.2	AI SP-2
3. Absorbed Asphalt: %, Range *	0 - 1.0	0 - 1.0	0 - 1.0	AI SP-2
4. Dust to Eff. Asphalt Ratio, Range **	0.6 - 1.4	0.6 - 1.4	0.6 - 1.4	AI SP-2
5. Tensile Strength Ratio: %, Min.	75	75	75	ASTM D4867
6. Dry Tensile Strength: psi, Min.	75	75	75	ASTM D4867
7. Mineral Aggregate Grading Limits				AASHTO T-27
	Percent Passing with Admix			
Sieve Size	3/8 inch Mix	1/2 inch Mix	3/4 inch Mix	
1 inch			100	
3/4 inch		100	90-100	
1/2 inch	100	90-100	43-89	
3/8 inch	90-100	53-89	-	
No. 8	32-47	29-40	24-36	
No. 40	2-24	3-20	3-18	
No. 200	2.0-8.0	2.0-7.5	2.0-6.5	

* Unless otherwise approved by the Engineer.

** The ratio of the mix design composite gradation target for the No. 200 sieve, including admixture, to the effective asphalt content shall be within the indicated range.

SECTION 711

Newtonian fluid. Any suitable standard means of viscosity measurement may be used, including capillary or rotational viscometer (AASHTO T-210 or AASHTO T-202).

(3) If the Creep Stiffness is below 300 MPa, the direct tension test is not required. If the Creep Stiffness is between 300 and 600 MPa, the direct tension failure strain requirement can be used in lieu of the Creep Stiffness requirement. Direct tension test is recommended for polymer modified asphalt binders. The *m*-value requirement must be satisfied in all cases.

Polymer modified paving asphalt shall be classified by the Performance Grading System and shall conform to the requirements set forth in Table 711-2 and AASHTO M320 with the PAV temperature changes noted in the table. On all Grades Flash Point Temperature AASHTO T48: Minimum 230 °C and Mass Loss, Maximum 1.00 percent. P is for Polymer and TR is for Tire Rubber.

TABLE 711-2				
PERFORMANCE GRADING SYSTEM				
	PG 64-28P	PG-76-22P	PG76-22TR Type 1 (Note 4)	PG76-22TR Type 2 (Note 4)
Viscosity, AASHTO T-316 (Note 1) Max. 3 Pa-s, Test Temp, °C	135	135	135	135
Dynamic Shear, AASHTO T-315 (Note 2) G*/Sin δ, Min., 1.0 kPa Test Temp. @ 10 rad/s, °C	64	76	76	76
Elastic recovery, ASTM D6084 Procedure "B" @ 10°C	65	65	65	55
Phase Angle, Max	75	75	75	75
Separation test, Texas 540 % Max	4	4	4	4
Solubility in Trichloroethylene, ASTM D2042 or n-propyl bromide, ASTM D7553 % Minimum	-	-	97.5	-
Tests Using Rolling Thin Film Oven Residue (AASHTO T-240)				
Mass Loss, Maximum %	1.0	1.0	1.0	1.0
Dynamic Shear, AASHTO T-315 G*/sin δ, Min., 2.20 kPa Test Temp. @ 10 rad/s, °C	64	76	76	76
Tests Using Pressure Aging Vessel Residue (AASHTO R-28)				
PAV Aging Temperature, °C (AASHTO R-28)	100	110	110	110
Dynamic Shear, AASHTO T-315 G*/sin δ, Max., 5000 kPa Test Temp. @ 10 rad/s, °C	22	31	31	31
Mass Loss, AASHTO T-240 Weight % Max	1.0	1.0	1.0	1.0
Creep Stiffness, AASHTO T-313 S, Maximum, 300 Mpa <i>m</i> -value, Minimum, 0.300 Test Temp. @ 60s, °C	-18	-12	-12	-12
Direct Tension, AASHTO T-314 (Note 3) Failure Strain, Minimum 1.0% Test Temp. @ 1.0 mm/min. °C	-18	-12	-12	-12

SECTION 711

NOTES:

- (1) This requirement may be waived at the discretion of the specifying agency if the supplier warrants that the asphalt binder can be adequately pumped and mixed at temperatures that meet all applicable safety standards.
- (2) For quality control of unmodified asphalt cement production, measurement of the viscosity of the original asphalt cement may be substituted for dynamic shear measurements of $G^*/\sin \delta$, at test temperatures when the asphalt is a Newtonian fluid. Any suitable standard means of viscosity measurement may be used, including capillary or rotational viscometer (AASHTO T-210 or AASHTO T-202).
- (3) If the Creep Stiffness is below 300 MPa, the direct tension test is not required. If the Creep Stiffness is between 300 and 600 MPa, the direct tension failure strain requirement can be used in lieu of the Creep Stiffness requirement. Direct tension test is recommended for polymer modified asphalt binders. The m-value requirement must be satisfied in all cases.
- (4) "TR" binders shall have 9% to 11% reclaimed tire rubber and enough virgin polymer to meet all performance grade criteria specified. The blend percentages shall be listed on the Certificate of Compliance by the manufacturer. Type 1 shall meet solubility limits.

711.3 TEST REPORT AND CERTIFICATION:

Test reports and certifications shall be provided to the Engineer when requested by the Engineer. At the time of delivery of each shipment of asphalt, the supplier supplying the material shall deliver to the purchaser a certified copy of the test report which shall indicate the name of the refinery and supplier, type and grade of asphalt delivered, date and point of delivery, quantity delivered, delivery ticket number, purchase order number, and results of the above specified tests. The test report shall be signed by an authorized representative of the supplier certifying that the product delivered conforms to the specifications for the type and grade indicated.

Until the certified test reports and samples of the material have been checked by the Engineer, that material will be only tentatively accepted by the Contracting Agency. Final acceptance will be dependent upon the determination of the Engineer that the material involved fulfills the requirements prescribed. The certified test reports and the testing required in connection with the reports shall be at no additional cost to the Contracting Agency.

711.4 TEMPERATURES:

Paving asphalt shall be heated in such a manner that steam or hot oils will not be introduced directly into the paving asphalt during heating.

711.5 CONVERSION OF QUANTITIES:

When pay quantities of paving asphalt are determined from volumetric measurements, the volumetric measurement at any temperature shall be reduced to the volume the material would occupy at 60 degrees F. in accordance with ASTM [D1250](#). In converting volume to weight, the computations shall be based on Table [711-3](#).

TABLE 711-3		
ASPHALT CEMENT QUANTITY CONVERSION		
Grade of Material	Gals. Per Ton of 60 °F.	Lbs. Per Gal at 60 °F.
PG 58-22	236	8.47
PG 64-16	235	8.51
PG 70-10	235	8.51
PG 64-28P	236	8.47
PG 76-22P,TR	236	8.47
PG 76-16	233	8.58

- End of Section -

SECTION 717

ASPHALT-RUBBER ASPHALT CONCRETE

717.1 DESCRIPTION:

The work under this section shall consist of furnishing, proportioning and mixing all the ingredients necessary to produce an Asphalt-Rubber Asphalt Concrete (ARAC) material. ARAC mixes may be used for low or high traffic conditions, as determined by the agency. Low traffic conditions are conditions where the asphalt mix will be subject to low volume and low weight vehicle usage. Examples of this condition are residential streets, most parking lots and residential minor collector streets. High traffic conditions are conditions where the asphalt mix will be subject to high volume and/or heavy weight vehicle usage as found on major collector, arterial and commercial streets. Street classifications (i.e. minor collector and major collector) shall be determined by the specifying agency.

717.2 MATERIALS:

717.2.1 Asphalt-Rubber Binder (ARB): The blended ARB shall meet the criteria list below. The ARB may be blended in a dedicated blending and storage unit connected to the hot plant or at the asphalt binder supplier's facility.

717.2.1.1 Asphalt Cement: Asphalt cement shall conform to the requirements of Section [711](#).

717.2.1.2 Crumb Rubber: Crumb Rubber shall meet the gradation requirements as shown in Table [717-1](#) below when tested in accordance with Arizona Test Method 714.

Sieve Size	Percent Passing
2.00 mm (#10)	100
1.18 mm (#16)	65 - 100
600 µm (#30)	20 - 100
300 µm (#50)	0 - 45
75 µm (#200)	0 - 5

The crumb rubber shall have a specific gravity of 1.15 ± 0.05 and shall be free of wire or other contaminating materials, and shall contain not more than 0.5 percent fabric. Calcium carbonate, up to four percent by weight of the crumb rubber, may be added to prevent the particles from sticking together.

Crumb rubber shall be derived from processing whole scrap tires or shredded tire materials through a process of mechanical grinding at ambient temperature. Use of crumb rubber granules produced from a cryogenic process is prohibited. The tires from which the crumb rubber is produced shall be from automobiles, trucks, or other equipment owned and operated in the United States.

Upon request, a Certificate of Compliance conforming to the requirements of Section [106.2](#) shall be submitted that confirms the crumb rubber complies with the gradation and specific gravity of Section [717](#), and is free of wire or other contaminating materials. The Certificate shall also attest:

- The processing does not produce, as a waste product, casings or other round tire material that can hold water when stored or disposed of above the ground.
- The crumb rubber is produced through a process of mechanical grinding at ambient temperature.
- The tires from which the crumb rubber is produced were from automobiles, trucks, or other equipment owned and operated in the United States.

SECTION 717

717.2.1.3 ARB Proportions and Properties: Ground crumb rubber in ARB shall be a minimum of 18 percent by weight of total binder.

ARB shall be Type 1 unless otherwise specified and conform to the requirements of Table [717-2](#).

TABLE 717-2			
PHYSICAL PROPERTIES OF ARB			
Property	Requirement		
	Type 1	Type 2	Type 3
Grade of base asphalt cement	PG 64-16	PG 58-22	PG 52-28
Rotational Viscosity*; 350° F, Pascal seconds	1.5-4.0	1.5-4.0	1.5-4.0
Penetration; 39° F (4° C), 200g, 60 sec. (ASTM D5); dmm, min	10	15	25
Softening Point; (ASTM D36); °F, min.	135	130	125
Resilience; 77°F (ASTM D5329); %, min	25	20	15
* The Viscometer used must be a hand held rotational viscometer, such as a Rion (formerly Haake) Model VT – 04, or an equivalent, using Rotor No. 1. The rotor, while in the off position, shall be completely immersed in the binder at a temperature from 350° to 355° F for a minimum heat equilibrium period of 60 seconds, and an average viscosity determined from three separate constant readings (± 0.5 pascal-seconds) taken within a 30 second time frame with the viscotester level during testing and turned off between readings. Continuous rotation of the rotor may cause thinning of the material immediately in contact with the rotor, resulting in erroneous results.			

717.2.1.4 ARB Design: At least two weeks prior to paving, the Contractor shall submit an ARB design prepared by an ADOT approved laboratory. Such design shall meet the requirements specified herein. The design shall show the values obtained from the required tests, along with the following information: percent, grade and source of the asphalt cement used; and percent, gradation and source(s) of the crumb rubber used, as well as the ARB blending location: on-site or at the asphalt binder supplier’s facility.

717.2.2 Aggregate: Coarse and fine aggregates shall conform to the applicable requirements of Tables [717-3](#) and [717-4](#) below. Coarse mineral aggregate shall consist of crushed gravel, crushed rock, or other approved inert material with similar characteristics, or a combination thereof, conforming to the requirements of these specifications.

Coarse aggregate is material retained above the Number 8 sieve and fine aggregate is material passing the Number 8 sieve. Aggregates shall be free of deleterious materials, clay balls, and adhering films or other material that prevent thorough coating with the asphalt cement. Mineral aggregate shall conform to the following requirements when tested in accordance with the applicable test methods.

TABLE 717-3		
MIX DESIGN GRADATION REQUIREMENTS WITH MINERAL ADMIXTURE		
Overlay Thickness	1" & 1- 1/2"	2"
Sieve Size	Percent Passing	Percent Passing
1" (25 mm)	100	100
3/4" (19 mm)	100	95-100
1/2" (12.5 mm)	95-100	78-92
3/8" (9.5 mm)	78-92	61-75
No. 4 (4.75 mm)	28-45	30-40
No. 8 (2.36 mm)	15-25	15-25
No. 30 (600 µm)	5-15	5-15
No. 200 (75 µm)	3.0-7.0	2.0-6.0

The combined aggregate properties shall conform to the requirements of Table [717-4](#).

SECTION 717

TABLE 717-4		
COARSE/FINE AGGREGATE REQUIREMENTS		
Characteristics	Test Method	Requirements
Fractured Faces, % (Plus No. 8)	ARIZ-212	85, 1 fracture 80, 2 or more
Uncompacted Voids, %	ARIZ-247	45.0 (High Traffic Volume) 42.0 (Low Traffic Volume)
Sand Equivalent (Minus No. 4)	AASHTO T-176	65 minimum
Plasticity Index	AASHTO T-89 & T-90	Non Plastic
L.A. Abrasion, % Loss	AASHTO T-96	9 max. @ 100 Rev. 40 max. @ 500 Rev.
Combined Bulk Specific Gravity	AI MS-2	2.35-2.85
Combined Water Absorption, %	AI MS-2	0-2.5

717.2.3 Mineral Admixture: Mineral admixture used in ARAC shall be dry hydrated lime conforming to the requirements of ASTM [C1097](#) or Portland cement conforming to ASTM [C150](#) for Type II, or ASTM [C595](#) for Type IP. The minimum mineral admixture content will be 1.0percent, by weight of total aggregate.

717.3 MIX DESIGN REQUIREMENT:

717.3.1 General: The mix design for ARAC shall be prepared by a laboratory that is accredited through the AASHTO Accreditation Program (AAP) in Hot Mix Asphalt Aggregates and Hot Mix Asphalt. The laboratory shall be under the direct supervision of a Civil Engineer, registered by the State of Arizona, and who is listed by ADOT as a “Qualified Asphalt Concrete Mix Design Engineer” within ADOT’s list of approved laboratories.

The date of the design shall not be older than two years from the date of submittal, unless supportive documentation is provided and approved by the Engineer.

The mix design method used shall be in accordance with the Marshall Mix procedure, 75 blows, as described in Arizona Test Method 832 “Marshall Mix Design Method for Asphaltic Concrete (Asphalt Rubber) [AR-AC]” with the exceptions that:

- (1) Mineral admixture shall be considered part of the total weight of aggregate and all combined specific gravity and combined absorption calculations for aggregates and mineral admixture will be done in accordance with Asphalt Institute’s Manual MS-2.
- (2) Course aggregate shall be separated from the fine aggregate on the #8 sieve.

Mix designs are subject to approval by the Engineer.

717.3.2 Mix Design Criteria: The mix shall comply with the criteria in Table [717-5](#).

TABLE 717-5		
MARSHALL MIX DESIGN CRITERIA		
Criteria	Low Volume Traffic	High Volume Traffic
ARB Content		
1” and 1-1/2” Overlay Thickness	8.4% minimum	8.0% minimum
2” Overlay Thickness	N/A	7.0% minimum
Mixture Air Voids, %	3.5-4.5	4.5-5.5
Voids in Mineral Aggregate, %	19.0 min	19.0 min
Tensile Strength Ratio, ASTM D4867	65% minimum	65% minimum
Marshall Stability, pounds minimum	800	800
Marshall Flow, 0.01 inch minimum	16	16

The mix design report shall include the following elements as a minimum.

- (1) The name and address of the testing organization and the person responsible for the mix design report.
- (2) The mix plant identification and/or location, as well as the supplier or producer name.

SECTION 717

- (3) The traffic condition (low or high traffic) and lift thickness.
- (4) A description of all products that are incorporated in the ARAC along with the sources of all products, including the base asphalt cement, crumb rubber, mineral aggregate, and admixtures.
- (5) The results of all testing, determinations, etc., such as: specific gravity and gradation, water absorption, sand equivalent, loss on abrasion, fractured coarse aggregate particles, Tensile Strength Ratio (ASTM D4867), Marshall bulk density, stability and flow, asphalt absorption, percent air voids, voids in mineral aggregate, and mineral admixture content. Historical abrasion values may be supplied on existing sources. The submittal should include a plot of the gradation on the Federal Highway Administration's 0.45 Power Gradation Chart and plots of the compaction curves.
- (6) The laboratory mixing and compaction temperature ranges for the ARB used within the mix design.
- (7) A specific recommendation for design ARB content and any limiting conditions that may be associated with the use of the design, such as minimum percentages of crushed or washed fine aggregate.
- (8) The supplier's product code, the laboratory Engineer's seal (signed and dated), and the date the design was completed.
- (9) The ARB design.

The mix design shall be submitted to the Agency or Engineer by the Contractor/Supplier for which it was developed as part of his project submittals. Once the mix design has been approved by the agency or Engineer, the Contractor and/or his supplier shall not change plants nor utilize additional mixing plants without prior approval of the Engineer. Any changes in the plant operation, the producer's pit, the ARB, or any other item that will cause an adjustment in the mix, shall be justification for a new mix design to be submitted.

- *End of Section* -

SECTION 719

POLYMER MODIFIED ASPHALT CONCRETE

719.1 DESCRIPTION:

The work under this section shall consist of furnishing, proportioning and mixing all the ingredients necessary to produce a polymer modified asphalt concrete (PMAC) material.

719.2 MATERIALS:

719.2.1 Binder The binder used in PMAC shall meet the requirements of Table 711-2 as specified by the engineer.

719.2.2 Aggregate: Coarse and fine aggregates shall conform to the applicable requirements of Tables 719-1 and 719-2 below. Coarse mineral aggregate shall consist of crushed gravel, crushed rock, or other approved inert material with similar characteristics, or a combination thereof, conforming to the requirements of these specifications.

Coarse aggregate is material retained above the Number 8 sieve and fine aggregate is material passing the Number 8 sieve. Aggregates shall be free of deleterious materials, clay balls, and adhering films or other material that prevent thorough coating with the asphalt cement. Mineral aggregate shall conform to the following requirements when tested in accordance with the applicable test methods.

TABLE 719-1	
MIX DESIGN GRADATION REQUIREMENTS WITH MINERAL ADMIXTURE	
Sieve Size	Percent Passing
1" (25 mm)	100
¾" (19 mm)	100
½" (12.5 mm)	90-100
⅜" (9.5 mm)	75-90
No. 8 (2.36 mm)	40-50
No. 40 (425 µm)	10-20
No. 200 (75 µm)	2.0-10.0

The combined aggregate properties shall conform to the requirements of Table 719-2.

719.2.3 Mineral Admixture: Mineral admixture used in PMAC shall be dry hydrated lime conforming to the requirements of ASTM [C1097](#) or Portland cement conforming to ASTM [C150](#) for Type II, or ASTM [C595](#) for Type IP. The minimum mineral admixture content will be 1.0 percent, by weight of total aggregate. Mineral admixture shall be considered part of the total weight of aggregate and all combined specific gravity and combined water absorption calculations for aggregates and mineral admixture will be done in accordance with the latest edition of the Asphalt Institute’s Manual MS-2 (AI MS-2).

TABLE 719-2		
COARSE/FINE AGGREGATE REQUIREMENTS		
Characteristics	Test Method	Requirements
Fractured Faces, % (Plus No. 8)	ARIZ-212	85, 1 fracture 80, 2 or more
Uncompacted Voids, %	AASHTO T-304, Method A	45.0
Sand Equivalent (Minus No. 4)	AASHTO T-176	50 minimum
Plasticity Index	AASHTO T-89 & T-90	Non Plastic
L.A. Abrasion, % Loss	AASHTO T-96	9 max. @ 100 Rev. 40 max. @ 500 Rev.
Combined Bulk Specific Gravity	AI MS-2	2.35-2.85
Combined Water Absorption, %	AI MS-2	0-2.5

719.3 MIX DESIGN REQUIREMENT:

719.3.1 General: The mix design for PMAC shall be prepared by a laboratory that is accredited through the AASHTO Accreditation Program (AAP) in Hot Mix Asphalt Aggregates and Hot Mix Asphalt. The laboratory shall be under the direct supervision of a Civil Engineer, registered by the State of Arizona, and who is listed by ADOT as a “Qualified Asphaltic

SECTION 719

Concrete Mix Design Engineer” within ADOT’s latest list of approved laboratories. The latest list of approved laboratories is available on ADOT’s web page www.azdot.gov. The date of the design shall not be older than one year from the date of submittal, unless supportive documentation is provided and approved by the Engineer.

The mix design report shall include the following elements as a minimum.

- (1) The name and address of the testing organization and the person responsible for the mix design report.
- (2) The mix plant identification and/or location, as well as the supplier or producer name.
- (3) A description of all products that are incorporated in the asphalt concrete along with the sources of all products, including admixtures and asphalt binder, and their method of introduction.
- (4) The supplier and grade of asphalt binder, the source and type of mineral aggregate, and the percentage of asphalt binder and mineral admixture used.
- (5) The mix design report shall identify this as a Marshall 75-blow mix design
- (6) The results of all testing, determinations, etc., such as: specific gravity and gradation of each component, water absorption, sand equivalent, loss on abrasion, fractured coarse aggregate particles, Tensile Strength Ratio (ASTM [D4867](#)), Marshall stability and flow, asphalt absorption, percent air voids, voids in mineral aggregate, and bulk density. Historical abrasion values may be supplied on existing sources. The submittal should include a plot of the gradation on the Federal Highway Administration’s 0.45 Power Gradation Chart, plots of the compaction curves and the results of moisture sensitivity testing.
- (7) The laboratory mixing and compaction temperature ranges for the supplier and grade of asphalt binder used within the mix design, and specific gravity at 77°F.
- (8) A specific recommendation for design asphalt binder content and any limiting conditions that may be associated with the use of the design, such as minimum percentages of crushed or washed fine aggregate.
- (9) The supplier’s product code, the laboratory Engineer’s seal (signed and dated), and the date the design was performed.

The mix design shall be submitted to the Agency or Engineer by the Contractor/Supplier for which it was developed as part of his project submittals. Once the mix design has been approved by the agency or Engineer, the Contractor and/or his supplier shall not change plants nor use additional mixing plants without prior approval of the Engineer. A new mix design shall be submitted when any changes occur in the plant operation, the producer’s pit, the asphalt binder, including modifiers in the asphalt binder, or any other item that will cause an adjustment in the mix.

719.3.2 Mix Design Criteria: The mix design shall be performed by the Marshall Mix Design method. A minimum of 4 points will be used to establish the mix design results. The oven aging period for Marshall mix design samples shall be 2 hours.

719.3.2.1 Marshall Mix Design: The Marshall Mix Design shall be performed in accordance with the requirements of the latest edition of the Asphalt Institute’s Manual, MS-2 “Mix Design Methods for Asphalt Concrete.” The mix shall use the compactive effort of 75 blows per side of specimen, unless specified otherwise by the engineer. The mix shall comply with the criteria in Table [719-3](#).

The mix design for PMAC shall be prepared by a laboratory that is accredited through the AASHTO Accreditation Program (AAP) in Hot Mix Asphalt Aggregates and Hot Mix Asphalt. The laboratory shall be under the direct supervision of a Civil Engineer, registered by the State of Arizona, and who is listed by ADOT as a “Qualified Asphalt Concrete Mix Design Engineer” within ADOT’s list of approved laboratories.

The date of the design shall not be older than two years from the date of submittal, unless supportive documentation is provided and approved by the Engineer.

Mix designs are subject to approval by the Engineer.

SECTION 719

TABLE 719-3		
MARSHALL MIX DESIGN CRITERIA		
Criteria	Requirements	Designated Test
	1/2" Mix	Method
1. Binder Content, Minimum	6.1%	---
2. Voids in Mineral Aggregate: %, min	14	AI MS-2
3. Effective Voids: %, Range	4.0±0.2	AI MS-2
4. Absorbed asphalt: %, Range*	0-1.0	AI MS-2
5. Dust to Eff. Asphalt Ratio, Range **	0.6-1.4	AI MS-2
6. Tensile Strength Ratio: % Min.	65	ASTM D4867
7. Dry Tensile Strength: psi, Min.	100	ASTM D4867
8. Stability: pounds, Minimum	2,500	ASTM D6926
9. Flow: 0.01-inch, Range, Minimum	8	ASTM D6927
10. Mineral Aggregate Grading	---	AASHTO T-27 & T11

* Unless otherwise approved by the Engineer.

** The ratio of the mix design composite gradation target for the No. 200 sieve, including admixture, to the effective asphalt content shall be within the indicated range

- End of Section -

This Page is Reserved For Future Use

SECTION 725

PORTLAND CEMENT CONCRETE

725.1 GENERAL:

Portland cement concrete shall be composed of cementitious materials, fine and coarse aggregates, water, and, if specified or allowed, certain chemical admixtures and additives.

TABLE 725-1		
CONCRETE CLASSES - MINIMUM REQUIREMENTS		
Class of Concrete	Minimum Cementitious Materials Content (lbs. per cubic yard)	Minimum Compressive Strength (1) at 28 Days (psi)
AA	600	4000
A	520	3000
B	470	2500
C	420	2000

(1) In accordance with section [725.8](#).

725.2 CEMENTITIOUS MATERIALS:

Cementitious materials to be used or furnished under this specification shall be:

Portland cement, meeting the requirements of ASTM [C150](#)

Type II, low alkali, when no other specific type is specified

Type III, low alkali, for high early strength, when applicable or specified

Type V, low alkali, when specified in the special provisions for applications requiring high sulfate resistance

Portland Pozzolan Cement ASTM [C595](#)

Type IP (MS), when no other specific type is specified

Supplementary Cementitious Materials (SCM) shall not be used as an additional cementitious materials replacement in concrete in combination with Portland Pozzolan Cement.

Cementitious materials shall be sampled and tested as prescribed in the applicable ASTM specifications. Upon request, the Contractor shall obtain and deliver to the Engineer a Certification of Analysis or Certificate of Compliance conforming to the requirements of Section [106.2](#) signed by the material manufacturer, identifying the cementitious material and stating that the cementitious material delivered to the batching site has been tested in accordance with the cited specifications and complies with the cited specifications. The cost of furnishing tested cementitious materials shall be considered as included in the contract price and no additional allowance will be made therefore.

When suitable facilities, as recommended by the Concrete Plant Manufacturer's Bureau, and approved by the Engineer, are available for handling and weighing bulk cementitious materials, such facilities shall be used. Otherwise the cementitious material shall be delivered in original unopened sacks that bear the name or brand of the manufacturer. The type of cementitious material, and the weight contained in each sack shall be plainly marked thereon.

Cementitious materials shall be stored in such manner as to permit ready access for the purpose of inspection and identification, and so as to be suitably protected against damage by contamination or moisture. Should any lot of bulk cementitious material be delivered to the site show evidence of contamination, the Engineer may require that such lot be removed from the site.

725.2.1 Supplementary Cementitious Materials (Pozzolans): Supplementary Cementitious Materials to be used in concrete or furnished under this specification shall conform to the appropriate ASTM requirements as follows:

Fly ash or natural pozzolan

ASTM [C618](#) and [C311](#)

Silica Fume

ASTM [C1240](#)

SECTION 725

Up to 25 percent by weight of the Table [725-1](#) minimum cementitious materials requirements may be an approved fly ash or natural pozzolan. Additional pozzolanic material in excess of the minimum Table [725-1](#) requirements may be incorporated into a concrete mix design to achieve enhanced performance, upon approval of the Engineer.

Upon request, the Contractor shall obtain and deliver to the Engineer a Certification of Analysis or Certification of Compliance signed by the pozzolan supplier identifying the pozzolanic material and stating the pozzolan delivered to the batching site complies with the appropriate specifications. The cost of furnishing tested pozzolan shall be considered as included in the contract price and no additional allowance will be made therefore.

Pozzolanic materials shall be handled and stored in the same manner as other cementitious materials. When facilities for handling a bulk pozzolan are not available, the pozzolan shall be delivered in original unopened sacks bearing the name and brand of the supplier, the type and source of the pozzolan, and the weight contained in each sack plainly marked thereon.

725.3 AGGREGATES:

Coarse and fine aggregate shall conform to the applicable requirements of ASTM [C33](#). Coarse aggregate grading requirements shall conform to the appropriate rock size designation in the Grading Requirements for Coarse Aggregate, Table 2. Fine aggregate grading requirements shall conform to the Fine Aggregate Grading section.

The average value of 3 successive sand equivalent samples shall not be less than 70 when tested in accordance with ASTM [D2419](#). No individual sample shall have a sand equivalent less than 65.

The loss by abrasion in the Los Angeles Abrasion Machine, determined as prescribed in ASTM [C131](#), shall not exceed 10 percent, by weight, after 100 revolutions nor 40 percent after 500 revolutions.

Prior to the delivery of the aggregates and whenever required during concrete production, the Contractor shall make stockpiles available to the Engineer for testing. All required samples shall be furnished at the expense of the Contractor, and the cost of sampling and testing shall be at the expense of the Contracting Agency.

Reclaimed Concrete Materials (RCM) and Reclaimed Asphalt Pavement (RAP) as defined in [Section 701](#) shall not be used in Portland Cement Concrete without the prior approval of the Engineer.

725.4 WATER:

The water used for mixing concrete shall be potable or shall meet the requirements of ASTM [C1602](#), when tested by a qualified independent testing laboratory.

725.5 ADMIXTURES AND ADDITIVES:

Admixtures or additives of any type, except as otherwise specified, shall not be used unless identified in the approved mix design or authorized by the Engineer.

Water reducing admixtures incorporated into the approved concrete mix design shall meet the requirements of ASTM [C494](#) for the appropriate type.

Air entraining admixtures incorporated into the approved concrete mix design shall meet the requirements of ASTM [C260](#).

Pigments incorporated into the approved concrete mix design for integrally colored concrete shall meet the requirements of ASTM [C979](#).

Fibers incorporated into the approved concrete mix shall meet the requirements of ASTM [C1116](#).

Any admixtures used shall be included in the price for that item.

SECTION 725

725.6 MIX DESIGN PROPORTIONING:

A concrete mix design carrying the producer's designated mix number for each type of concrete being furnished under these specifications shall be submitted to the Engineer at least once each year for approval. Each design shall utilize the proper proportioning of ingredients to produce a concrete mix that is homogeneous and sufficiently workable to provide a consistent and durable concrete product that meets the specified compressive strength and other properties as required by the application.

A concrete mix design submittal shall include the mix identification number and the applicable proportions, weights, and quantities of individual materials incorporated into the mix including the size and source of concrete aggregates, the type and source of cement and fly ash or SCM, and the brand and designation of chemical admixtures or other additives.

In the event there is a modification to the mix design proportions:

(A) Modifications that do not require a new mix design submittal/approval:

- (1) Modifications which do not result in batch target weights for the fine aggregate or combined coarse aggregates changing by more than 5 percent from the original approved mix design.
- (2) Modifications to the percentage of coarse aggregate fractions that do not change the total coarse aggregate volume.
- (3) Modifications to dosages of chemical or air-entraining admixtures, within the manufacturer's recommendations.
- (4) The incorporation or elimination of chemical admixtures which are listed on the mix design to effect a change in the time-of-set (retarders or accelerators).

(B) Modifications that require a new mix design submittal/approval and may require performance verification:

- (1) Modification to the class of concrete per Table [725-1](#).
- (2) Modification to the type/class/source of cement, fly ash, natural pozzolan, or silica fume.
- (3) Modification to the percentage of fly ash, natural pozzolan, or silica fume.
- (4) Modification to a coarse aggregate size designation.
- (5) Modification of the type of chemical admixture, or the incorporation or elimination, of an air-entraining admixture.
- (6) Modification of coarse or fine aggregate source.

725.7 MIXING:

All proportioning/batching/mixing equipment shall comply with the standards of the Concrete Plant Manufacturer's Bureau and the certification requirements of the Arizona Rock Products Association or National Ready Mixed Concrete Association. The proportioning shall consist of combining the specified sizes of aggregates with cementitious materials, admixtures/additives, and water as herein provided. No method which may cause the segregation or degradation of materials shall be used.

Weighing and metering devices used for the purpose of proportioning materials shall fulfill requirements as to accuracy and tolerance prescribed by the Weights and Measures Division of the State of Arizona and shall be sealed and certified in accordance with the procedures established by this agency. This certification shall not be over 12 months old and shall be renewed whenever required by the Engineer. When portable plants are set up at a new or temporary location, the scales and scale assembly shall be inspected and certificate issued regardless of the date when the scales were last tested. The Engineer may require the Contractor to run a quick scale check at any time with certified weights furnished by the Contractor and order the scale recertified if necessary.

Any admixture/additive shall be measured accurately by mechanical means into each batch by equipment or in a method pre-approved by the Engineer.

The equipment for measuring and supplying the water in the mixer shall be so constructed and arranged that the amount of water to be added to the mixture can be measured, in gallons or by weight. The amount of water shall be varied in accordance with the percentage of free moisture in the material and the requirements of the workability of the aggregate.

SECTION 725

Machine mixing will be required in all cases unless pre-approved by the Engineer. Regardless of the method employed, mixing shall be commenced as soon as possible after the cementitious material is placed in contact with the aggregates or water. All concrete mixers shall be of such design and construction, and so operated, as to provide a thoroughly and properly mixed concrete in which the ingredients are uniformly distributed.

725.7.1 Paving and Stationary Mixers: Paving and stationary mixers shall comply with the standards of the Concrete Plant Manufacturer's Bureau and the certification requirements of the Arizona Rock Products Association or the National Ready Mixed Concrete Association.

Mixers shall be maintained in proper and serviceable working condition, and any part or portion thereof that is out of order, or becomes worn to such extent as to detrimentally affect the quality of mixing, shall be promptly repaired or replaced.

The proper proportions of aggregate, cementitious materials, admixtures/additives and water for each batch of concrete shall be placed in the mixer, and shall be mixed for a period of not less than 50 seconds after all such materials are in the drum.

The rotating speed at which the mixer shall be operated shall conform to that recommended by the manufacturer.

The total volume of materials mixed in any one batch shall neither exceed the water level capacity of the mixer nor the manufacturer's catalog rated capacity of the mixer.

725.7.2 Transit Mixers: Transit mixers shall meet the requirements of the Truck Mixer Manufacturer's Bureau and the certification requirements of the Arizona Rock Products Association or the National Ready Mixed Concrete Association. Ready mix concrete and shall comply with ASTM [C94](#) except as herein specified.

Each mixer and agitator shall have attached thereto in a prominent place a metal plate or plates, installed by the manufacturer, on which is plainly marked the capacity of the drum in terms of the volume of mixed concrete and the speed of rotation for the agitating and mixing speeds of the mixing drum or blades.

Each mixer shall have an identification number painted on the truck in such a location that it can be easily read from the batching platform.

The total volume of materials introduced into the mixer for mixing purposes shall not exceed the manufacturer's guaranteed mixing capacity. If the concrete so mixed does not meet the uniformity requirements of this section, the amount of materials charged into the mixer shall be reduced.

The rotation speed at which the mixer shall be operated shall conform to that recommended by the manufacturer.

Each batch of concrete placed in the mixer shall be mixed for not less than 70 nor more than 100 revolutions of the drum or blades, at the speed designated by the manufacturer of the equipment as mixing speed. Additional mixing shall be at the agitating speed designated by the manufacturer of the equipment. The revolving of the drum shall be continuous until the concrete is completely emptied from the drum. Before any portion of the materials for any batch of concrete is placed therein, the drum of the mixer shall be completely emptied of the previously mixed batch.

At the time of delivery to the job site, the Engineer shall be provided with a legible delivery ticket which shall contain the following information:

Date and Truck Number.

Name of the Supplier.

Name of the Contractor.

Specific designation of job (name and location).

Number of cubic yards in the batch.

Time the transit mixer is loaded.

SECTION 726

CONCRETE CURING MATERIALS

726.1 GENERAL:

Curing materials shall consist of waterproof paper, polyethylene film or liquid membrane-forming compounds which, when applied to fresh concrete, will inhibit moisture loss and reduce temperature rise during the curing period. All curing materials and methods shall be approved by the Engineer prior to use. Wet coverings such as burlap, cotton mats, or other moisture-retaining fabrics also may be used, or may be required by special provisions.

726.2 MATERIALS:

(A) Waterproof paper, or polyethylene film, shall conform ASTM [C171](#).

(B) Liquid membrane-forming compounds shall conform ASTM [C309](#). Type 1 compound with either a Class A or Class B vehicle shall be used for concrete structures, except bridge decks, approach slabs, and portland cement concrete pavement. Type 2 white pigmented compound, with either a Class A or Class B vehicle shall be used for portland cement concrete pavement, bridge decks and approach slabs.

(C) Burlap cloth made from jute or kenaf shall conform to AASHTO M-182.

- *End of Section* -

SECTION 727

STEEL REINFORCEMENT

727.1 GENERAL:

The following specifications set forth the requirements for bar reinforcement, wire reinforcement, and wire mesh reinforcement. The reinforcement shall conform accurately to the dimensions and details indicated on the plans or otherwise prescribed and before being placed in any concrete work, shall be thoroughly cleaned of all loose rust, mill scale, mortar, oil, dirt, or coating of any character, which would be likely to destroy, reduce, or impair its proper binding with the concrete.

No reinforcing steel will be accepted under this specification until it has been approved by the Engineer. When required by the Engineer, the Contractor or supplier shall furnish a spot sample taken on the project and notify the Engineer as to when and where they will be available. Such samples shall be furnished at the expense of the Contractor or supplier, but the cost of any testing that may be required will be borne by the Contracting Agency. Samples shall only be taken in the presence of the Engineer. The Contractor shall furnish 3 certified mill test reports or a Certificate of Compliance for each heat or size of steel which can be clearly identified with the lot. When such information has been furnished, placing of the steel will not be held up until results of spot samples have been received. Unless otherwise specified, all reinforcing steel bars shall be deformed intermediate grade 40 billet steel in conformance to ASTM [A615](#).

In testing bar reinforcement, only the theoretical cross-sectional area will be used in all computations.

Reinforcing steel shall be furnished in the sizes, shapes, and lengths shown on the plans. Bending of steel shall conform to the requirements of Section [505.5.2](#).

The various grades of steel shall not be used interchangeably in structures.

727.2 WIRE REINFORCEMENT:

Wire reinforcement shall in all respects fulfill requirements prescribed in ASTM A1064.

727.3 WELDED WIRE REINFORCEMENT:

Welded wire reinforcement shall conform to ASTM A1064. The wire size number and the wire spacing will be specified in the special provisions or shown on the plans. The welded wire reinforcement shall be so constructed as to retain its original shape and form during necessary handling. The effective cross-sectional area of the metal shall be equal to that specified or indicated on the plans.

727.4 WIRE TIES:

Wire for ties shall be black, annealed, not lighter than 16 gage.

- *End of Section* -

SECTION 728

CONTROLLED LOW STRENGTH MATERIAL

728.1 GENERAL:

Controlled Low Strength Material (CLSM) is a mixture of cementitious materials, aggregates, admixtures\additives, and water that, as the cementitious materials hydrate, forms a soil replacement. CLSM is a self-compacting, flowable, cementitious material primarily used as a backfill, structural fill, or a replacement for compacted fill or unsuitable native material. Placement and usage of each type of CLSM is described in Section [604](#).

728.2 MATERIALS:

Cementitious materials shall conform to Section [725.2](#).

Coarse aggregate shall conform to ASTM [C33](#) grading size No. 57. The size and gradation of fine aggregates (sand) shall conform to ASTM [C33](#). Alternate materials meeting the applicable requirements of Section [701](#) or [702](#) such as combinations of other aggregates, Aggregate Base Course (ABC) or Reclaimed Concrete Material (RCM) may be used to replace the required coarse and fine aggregate as long as the approved mix design meets the requirements of Table [728-1](#) and is approved by the Engineer.

Water shall conform to Section [725.4](#).

728.3 PROPORTIONING OF MIXTURES AND PRODUCTION TOLERANCES:

Proportioning of the mixture shall comply with Section [725.6](#) and Table [728-1](#). The CLSM shall have consistency, workability, plasticity, and flow characteristics such that the material when placed is self-compacting. A minimum of 40% coarse aggregate shall be used. A mix design shall be submitted for the Engineer's approval prior to the excavation for which the material is intended for use. Sampling shall be in accordance with ASTM [D5971](#). The flow consistency shall be tested in accordance with ASTM D6103. Unit weight (when applicable) shall be obtained by ASTM [D6023](#). Compressive strength shall be tested in accordance with ASTM [D4832](#).

CONTROLLED LOW STRENGTH MATERIAL REQUIREMENTS	
Portland Cement Content, Sack/cu yd	Flow, inches
1/2 Sack	9±2
1 Sack	9±2
1 1/2 Sack	9±2

Note for Table [728-1](#):

- (1) CLSM mixes meeting the table requirements will not generally be placeable by means of a concrete pump or may not provide the needed workability for certain conditions. When pumpable mixes or increased workability are required, the addition of fly ash or a natural pozzolan in excess of the required Portland Cement Content may be used.
- (2) Ready-mixed structural concrete or grout shall not be used in lieu of CLSM without prior approval from the Engineer and shall be subject to rejection.

728.4 MIXING:

CLSM mixing shall comply with Section [725.7](#) Mixing shall continue until the cementitious material and water are thoroughly dispersed throughout the material. Mixes shall be homogenous, readily placeable and uniformly workable.

- End of Section -

SECTION 729

EXPANSION JOINT FILLER

729.1 PREMOLDED JOINT FILLER:

Expansion joint filler materials shall consist of preformed strips of a durable resilient compound and comply with ASTM [D5971](#), [D1752](#), or [D2628](#), as specified by the Contracting Agency or as approved by the Engineer.

729.2 POUR TYPE JOINT FILLERS FOR PORTLAND CEMENT CONCRETE PAVING (PCCP):

Pour type joint fillers shall comply with ASTM D3406 or as approved by the Engineer. Joint sealant shall not contain any coal tar materials. The following requirement shall be added to paragraphs 7.1 of ASTM D3406:

The minimum ambient temperature during application and ambient temperatures under various storage conditions shall be clearly marked on the container.

729.3 TEST REPORT AND SHIPMENT CERTIFICATE:

When requested by the Engineer, each shipment shall be accompanied by a Certificate of Compliance that the material complies with the above specifications.

- End of Section -

SECTION 772

TABLE 772-1					
FENCE MEMBER SIZES & WEIGHTS					
USE	FENCE FABRIC HEIGHT (Feet)	NPS DESIGNATOR	OUTSIDE DIAMETER (Inches)	WEIGHT (Lb/Lf Minimum)	
				TYPE A Schedule 40	TYPE B and C
FENCE POSTS					
End, corner, slope, pull and strain posts	Less than 6	2	2.375	3.65	3.12
	6 and over but less than 9	2 1/2	2.875	5.79	4.64
	9 and over but not over 12	3 1/2	4.000	9.11	6.56
Line posts	not over 6	1 1/2	1.900	2.72	2.28
	over 6 but less than 9	2	2.375	3.65	3.12
	9 and over but not over 12	2 1/2	2.875	5.79	4.64
GATE POSTS					
Single swing gates 6 feet or less in width or double swing gates 12 feet or less	less than 6	2	2.375	3.65	3.12
	6 and over but not over 12	3 1/2	4.000	9.11	6.56
Single swing gates over 6 feet but not over 13 feet in width or double swing gates over 12 feet but not over 26 feet in width	—	3 1/2	4.000	9.11	6.56
Single swing gates over 13 feet but not over 18 feet in width of double swing gates over 26 feet but not over 36 feet in width	—	6	6.625	18.97	—
Single swing gates over 18 feet in width or double swing gates over 36 feet in width	—	8	8.625	28.55	—
OTHER MEMBERS					
Top rail and braces	—	1 1/4	1.666	2.27	1.84
Frame for gates	—	1 1/2	1.900	2.72	2.28
Stiffeners for gates	—	1 1/4	1.666	2.27	1.84

Notes to Table 772-1:

- All unit weights shall be subject to the standard mill tolerance of ±5 percent.
- Posts shall be fitted with tops designed so as to fit securely over the posts and carry a top rail where specified. They shall have a total length of not less than the depth of the concrete footings, as specified, plus the length required above ground. Where no top rail is required, pipe posts shall be fitted with suitable caps.
- Top rail shall be furnished in random lengths of approximately 20 feet where required.

SECTION 772

772.5 TRUSS OR TENSION RODS:

Truss or tension rods used in trussing gate frames and line posts adjacent to end, corner, slope or gate posts shall be adjustable 3/8 inch diameter galvanized steel rod. When used in trussing line posts, adjustment shall be provided by means of galvanized, turnbuckle or other suitable tightening devices.

772.6 FITTINGS:

Fittings shall conform to ASTM [F626](#).

Fittings, hardware, nuts and bolts shall be galvanized.

Couplings to connect the individual lengths of top rail shall be of the outside sleeve type at least 7 inches long. The bore of the sleeves shall be sufficiently true to maintain adjacent lengths of rail in alignment.

Extension arms for barbed wire on pipe posts shall be of 13 gage steel or heavier, single piece construction and a type that can be attached to the tops of the posts. Extension arms shall carry 3 wires at approximately 5 1/2 inch centers in a plane approximately 45 degrees from the vertical, inclined as shown on the plans or as directed by the Engineer.

772.7 BARBED WIRE:

Barbed wire shall be 4 point pattern; composed of 2 strands of 12 1/2 gage galvanized steel wire with barbs spaced 5 inches apart and shall conform to ASTM [A121](#).

- *End of Section* -

SECTION 796

to hydrodynamic forces while allowing the passage of fluids into or across a geotextile and to prevent inter-migration of adjacent soil layers of vastly different particle sizes and particle distributions.

Filtration and separation fabrics shall be nonwoven or woven fabric consisting only of long chain polymeric filaments such as polypropylene or polyester formed or woven into a stable network such that the filaments retain their relative position to each other. The fabric material shall additionally conform to the physical properties shown in Table [796-2](#).

TABLE 796-2			
FILTRATION & DRAINAGE GEOSYNTHETIC PROPERTIES			
Property	Class A ⁽¹⁾	Class B ⁽²⁾	Test Method
Grab tensile strength: lbs.	180 min.	80 min.	ASTM D4632
Seam strength: lbs.	160 min.	70 min.	ASTM D4632
Puncture strength: lbs.	80 min.	25 min.	ASTM D4833
Trapezoidal tear: lbs	50 min.	25 min.	ASTM D4533
Apparent opening size: US Standard sieve size	>50	>50	ASTM D4751
Ultraviolet Stability: %	50 min.	50 min.	ASTM D4355

- (1) Class A - Use where installation stresses are more severe than for Class B application (i.e. very coarse sharp angular aggregate or high compaction requirements).
- (2) Class B – Use with smooth graded surface having no sharp angular projections and sharp angular aggregate.

796.2.3 Erosion Control: Erosion control fabrics are used below areas to receive aggregate or riprap slope protection and act as filter/separators to provide sustained permeability while maintaining structural stability.

Erosion control fabrics shall be a woven monofilament fabric or a nonwoven fabric consisting only of long chain polymeric filaments such as polypropylene or polyester formed into a stable network that the filaments retain their relative position to each other. The fabric material shall additionally conform to the physical properties shown in Table [796-3](#).

TABLE 796-3			
EROSION CONTROL GEOSYNTHETIC PROPERTIES			
Property	Class A	Class B	Test Method
Grab tensile strength: lbs.	270 min.	200 min.	ASTM D4632
Elongation at break: %	45min., 115 max.	15 min., 115 max.	ASTM D4632
Puncture strength: lbs.	110 min	75 min.	ASTM D4833
Burst strength: psi	430 min.	320 min.	ASTM D3786
Trapezoidal tear: lbs	75 min.	50 min.	ASTM D4533
Permittivity: second ⁻¹	0.07 min.	0.07 min.	ARIZ-730 ⁽¹⁾
Apparent opening size: US Standard sieve size	30 – 140	30 - 140	ASTM D4751
Ultraviolet Stability: %	70 min.	70 min.	ASTM D4355

- (1) Arizona Department of Transportation test method.

796.2.4 Soil or Base Reinforcement: Geogrid geosynthetic materials are used for improving the stability of weak soils or reinforcing aggregate bases. Geogrids are defined as biaxial or triaxial polymeric grids formed by a regular network of integrally connected polymer tensile elements with apertures of sufficient size to permit significant mechanical interlock with the surrounding soil, aggregate, or other fill materials to function primarily as reinforcement.

SECTION 796

The geogrid structure shall be dimensionally stable and able to retain its geometry under manufacture, transport and installation. Geogrids shall be integrally formed and deployed as a single layer; comprised of 100 percent polypropylene or high-density polyethylene. Geogrids shall additionally conform to the physical properties shown in Table [796-4](#).

TABLE 796-4			
REINFORCEMENT GEOGRID PROPERTIES			
Property	Type 1	Type 2	Test Method
Aperture size: inches	1 min.	1-3/8 min.	ID callipered
Ultimate Tensile Strength: lb/ft	850 min.	1300 min.	ASTM D4945
Flexural Rigidity: Mg-cm	250,000 min.	750,000 min.	ASTM D1388
Tensile Strength @ 2% Strain: lb/ft MD ⁽¹⁾	270 min.	410 min.	ASTM D6637
Tensile Strength @ 2% Strain: lb/ft CMD ⁽²⁾	380 min.	620 min.	ASTM D6637
Tensile Strength @ 5% Strain: lb/ft MD ⁽¹⁾	550 min.	810 min.	ASTM D6637
Tensile Strength @ 5% Strain: lb/ft CMD ⁽²⁾	720 min.	1340 min.	ASTM D6637
Junction Efficiency: % Ultimate Tensile Strength	75 min.		GRI-GG2 ⁽³⁾
Ultraviolet Stability: % Retained Strength	70 min.		ASTM D4355

(1) MD = Test in the machine direction along roll length

(2) CMD = Test in the cross-machine (transverse) direction across roll width

(3) Geosynthetic Research Institute test method

796.3 TEST AND CERTIFICATION REQUIREMENTS:

Upon request, a Certificate of Compliance shall be submitted to the Engineer for material to be used. Samples of materials shall be submitted for testing. Each geosynthetic material lot or shipment is to be approved by the Engineer before the material is incorporated into the work.

Testing methods and results shown in the Certificate of Compliance shall conform to the listed specifications for the proposed geosynthetic. Manufacturer's supporting documentation including, but not limited to, product information sheets, installation procedures and recommendations, recommended use, and project references shall be submitted to the Engineer for product evaluation and approval.

- End of Section -

INDEX

- Painting, [530-1](#)
 - Application, [530-1](#)
 - Surface Preparation, [530-2](#)
 - Testing, [530-3](#)
 - Weather Conditions, [530-1](#)
- Parkway Grading, [424-1](#)
- Partial Payments, [109-5](#)
- Partial Use or Occupancy, [105-6](#)
- Patented Devices, Materials and Processes, [107-1](#)
- Pavement
 - Asphalt Concrete, [321-1](#), [711-1](#)
 - Decorative, [342-1](#)
 - Exposed Aggregate [343-1](#)
 - Geosynthetics, [796-1](#)
 - Portland Cement Concrete, [324-1](#)
 - Sewer Line, [615-4](#)
- Pavement Matching and Surfacing Replacement, [336-1](#)
- Paving Asphalt, [711-1](#)
 - Temperatures, [711-1](#)
 - Test Report and Certification, [711-2](#)
- Payments
 - Actual Cost Work, [109-3](#)
 - Assignments, [109-2](#)
 - Final, [109-6](#)
 - for Delay, [109-7](#)
 - Improvement District Projects, [109-5](#)
 - Mobilization/Demobilization, [109-7](#)
 - Partial, [109-5](#)
 - Scope of, [109-1](#)
- Permits, [107-1](#)
- Pilot Cars or Flagman, [401-1](#)
- Pipe
 - Cast-in-Place Curing and Backfill, [620-2](#)
- Pipe Installation for
 - Sewer Lines, [615-1](#)
 - Sprinkler Irrigation System, [440-2](#)
 - Storm Sewers, [618-1](#)
 - Subdrainage, [605-1](#)
 - Water Lines, [610-1](#)
- Placement and Construction of Aggregate Base Course, [310-1](#)
- Placement and Construction of Asphalt Concrete Pavement, [321-1](#)
 - Acceptance, [321-6](#)
 - Application of Tack Coat, [321-1](#)
 - Materials and Manufacture, [321-1](#)
 - Measurement, [321-2](#)
 - Mix Design, [321-1](#)
 - Mix Production, [321-2](#)
 - Placement, [321-3](#)
 - Quality Control, [321-6](#)
 - Referee, [321-12](#)
 - Transportation, [321-3](#)
 - Weather and Moisture Conditions, [321-1](#)
- Placement and Construction of Asphalt Emulsion
 - Slurry Seal Coat, [332-1](#)
 - Equipment, [332-1](#)
 - Mixing and Application, [332-2](#)
 - Preparation of the Surface, [332-1](#)
 - Protection of Uncured Surface, [332-2](#)
 - Rolling, [332-2](#)
 - Weather Limitations, [332-2](#)
- Placement and Construction of Asphalt-Rubber Asphalt Concrete, [325-1](#)
 - Acceptance, [325-5](#)
 - Application of Tack Coat, [325-2](#)
 - Materials, [325-1](#)
 - Mix Production, [325-2](#)
 - Placement, [325-3](#)
 - Quality Control, [325-4](#)
 - Transportation, [325-3](#)
 - Weather and Moisture Conditions, [325-1](#)
- Placement, Construction. of Cement Treated Subgrade, [311-1](#)
 - Construction Methods, [311-1](#)
 - Equipment, [311-1](#)
 - Materials, [311-1](#)
- Placement, Construct.of Hot Asphalt-Rubber Seal, [335-1](#)
 - Construction, [335-1](#)
 - Equipment, [335-1](#)
 - Materials, [335-1](#)
 - Measurement, [335-2](#)
 - Mixing, [335-1](#)
- Placement of Controlled Low Strength Material, [604-1](#)
- Placement and Construction of Polymer Modified Asphalt Concrete [326-1](#)
- Plans
 - Materials [604-1](#)
- Performance Testing [604-2](#)
- Placement [604-1](#)
- Planting
 - and Landscaping, [430-1](#)
- Pneumatically Placed Mortar, [525-1](#)
 - Curing, [525-2](#)
 - Dry Mix Process, [525-1](#)
 - Equipment, [525-2](#)
 - Finishing, [525-2](#)
 - Forms and Ground Wires, [525-2](#)
 - Joints, [525-2](#)
 - Reinforcing Steel, [525-1](#)
 - Surface Preparation, [525-2](#)
 - Testing, [525-2](#)
 - Wet Process, [525-1](#)
- Polymer Modified Asphalt Concrete [719-1](#)
- Polyethylene Pipe
 - High Density, [738-1](#)
- Polypropylene Pipe & Fittings for Gravity Storm Drain & Sanitary Sewer, [740-1](#)
- Polypropylene Pipe and Fittings for Storm Drain,

INDEX

- Irrigation and Sanitary Sewer, [740-1](#)
- Polyethylene Pipe for Water Distribution, [755-1](#)
- Portland Cement Concrete Street Pavement, [324-1](#)
- Portland Cement Concrete, [725-1](#)
 - Pavement, [324-1](#)
- Portland Cement Treated Base, [705-1](#)
- Power of Attorney, [103-2](#)
- Precast Prestressed Concrete Members, [506-1](#)
 - Anchorage and Distribution, [506-3](#)
 - Bonding and Grouting, [506-5](#)
 - Concrete, [506-1](#)
 - Enclosures, [506-3](#)
 - Handling, [506-6](#)
 - Prestressing, [506-4](#)
 - Prestressing Steel, [506-2](#)
 - Samples for Testing, [506-5](#)
- Precast Safety Curbs, [410-1](#)
- Precoated Chip Seal
 - Asphalt Grade, [330-2](#)
 - Construction Methods, [330-1](#)
 - Temperatures, [330-2](#)
- Preservative Seal for Asphalt Concrete [334-1](#),
[718-1](#)
- Preservatives
- Prime Coat, [756-1](#)
 - Wood, [779-1](#)
- Property and Landscape Protection and Restoration, [107-3](#)
- Property Marks and Monuments, [107-3](#)
- Proposal
 - Addenda, [102-2](#)
 - Consideration of, [103-1](#)
 - Disqualified Bidders [102-3](#)
 - Irregular, [102-2](#)
 - Preparation, [102-2](#)
 - Public Opening, [102-3](#)
 - Rejected, [102-2](#)
 - Revision of, [102-3](#)
 - Submission of, [102-3](#)
 - Successful Bidders [102-3](#)
 - Withdrawal of, [102-3](#)
- Proposal Guarantee
 - Amount, [103-2](#)
 - Forfeiture of, [102-2](#), [103-4](#)
 - Return of, [103-1](#)
- Public
 - Convenience, [107-2](#)
 - Property, [107-1](#)
 - Safety, [107-2](#)
- Public Officials
 - Personal Liability of, [107-5](#)
- PVC Sewer Pipe and Fittings, [745-1](#)
- Quantities
 - in Proposal, [102-1](#)
 - Increase or Decrease, [109-3](#)
 - Measurement of, [109-1](#)
- Payment, [109-5](#)
- Reclaimed Water Line Construction, [616-1](#)
 - Above Ground Pipe, [616-2](#)
 - Below Ground Pipe, [616-2](#)
 - Identification, [616-1](#)
 - Installation, [616-1](#)
 - Valve and Manhole Covers, [616-3](#)
 - Valves and Risers, [616-2](#)
- Reinforced Concrete Pipe, [735-1](#)
 - Acceptance Mark, [735-4](#)
 - Curing of Pipe, [735-2](#)
 - Curves, Bends and Closures, [735-1](#)
 - Downgrading of Pipe, [735-4](#)
 - Manufacturer's Qualifications, Equipment
Require., [735-2](#)
 - Materials, [735-1](#)
 - Quality, [735-1](#)
 - Sanitary Sewer Pipe, [735-4](#)
 - Tests and Acceptance, [735-2](#)
- Reinforcing Steel, [727-1](#)
- Rejected Materials, [106-1](#)
- Removal of
 - Defective Materials, [105-5](#)
 - Salvage Items, [201-2](#)
 - Unacceptable Work, [105-5](#)
 - Unauthorized Work, [105-5](#)
- Removal of Existing Improvements, [350-1](#)
- Rental Equipment, [109-2](#)
- Reports
 - Archaeological, [107-1](#)
 - Blasting Survey, [107-3](#)
 - Extra Work, [109-3](#)
 - Final Payments, [109-6](#)
 - Partial Payments, [109-5](#)
 - Site Conditions, [109-3](#)
- Responsibility, Contractor's, [107-5](#)
- Retaining Walls, [505-1](#)
- Revision of Proposal, [102-3](#)
- Right-of-Way
 - and Traffic Control, [401-1](#)
 - Railroad, [105-3](#)
- Riprap, [703-1](#)
 - Riprap Construction, [220-1](#)
 - Rivets, [770-1](#)
- Road-Mixed Surfacing, [320-1](#)
 - Application of Liquid Asphalt, [320-1](#)
 - Materials, [320-1](#)
 - Mixing, [320-1](#)
 - Prime Coat, [320-1](#)
 - Spreading Aggregate, [320-1](#)
 - Spreading and Compaction, [320-2](#)
- Roadway Excavation, [205-1](#)
 - Overshooting, [205-1](#)
 - Slides and Slipouts, [205-1](#)
 - Slopes, [205-1](#)
 - Surplus Material, [205-2](#)

**UNIFORM STANDARD
DETAILS**

for

**PUBLIC WORKS
CONSTRUCTION**

**SPONSORED and DISTRIBUTED
by the**



2017 REVISION TO THE 2015 EDITION

 ARIZONA

100 SERIES: GENERAL INFORMATION

Detail	Revised	Title
101	2011	GENERAL INFORMATION
110-1	2011	PLAN SYMBOLS (SYMBOLS)
110-2	2011	PLAN SYMBOLS (LINE TYPES)
112	1998	DIMENSIONING FOR ROAD IMPROVEMENT PLANS
120	2015	SURVEY MARKER
122	2011	PAVEMENT MARKER FOR FIRE HYDRANTS
130	2003	BARRICADES
131	1998	STREET SIGN BASE
140	2009	BOLLARD
141	2009	HAZARD MARKER
145	2016	SAFETY RAIL
150	1998	PRECAST SAFETY CURB
160	2013	6' CHAIN LINK FENCE AND GATE

200 SERIES: STREET INFORMATION

Detail	Revised	Title
200-1	2016	TRENCH BACKFILL AND SURFACE REPLACEMENT
200-2	2016	TRENCH BACKFILL AND SURFACE REPLACEMENT
201	2014	ASPHALT PAVEMENT EDGE DETAILS
202	1998	ALLEY DETAILS (PAVED AND UNPAVED)
203	1998	SCUPPERS
204	1998	EQUIPMENT CROSSING
205	2006	PAVED TURNOUTS
206-1	2007	CONCRETE SCUPPER
206-2	2007	CONCRETE SCUPPER
206-3	2007	CONCRETE SCUPPER (ISOMETRIC VIEW)
210	2012	RESIDENTIAL SPEED HUMP
211	1998	STANDARD TRENCH PLATING DETAIL
212	2015	UTILITY POTHOLE REPAIR
220-1	2007	CURB AND GUTTER TYPES A, B, C AND D
220-2	2007	CURB AND GUTTER TYPES E AND F
221	2014	CURB AND GUTTER TRANSITION TYPE A TO TYPE C, INTEGRAL ROLL CURB, GUTTER AND SIDEWALK
222	2008	SINGLE CURB - TYPES A, B AND TERMINATION
223	1998	MEDIAN NOSE TRANSITION
224	1998	JOINT FOR DRAINAGE INLETS AND MANHOLE COVERS
225	2016	CONCRETE PAVERS
230	2014	SIDEWALKS
234	2012	CURB MODIFICATION AT DETECTABLE WARNING
235-1	2012	CURB RAMPS (TYPE A)
235-2	2012	CURB RAMPS (TYPE B)
235-3	2012	CURB RAMPS (TYPE C)
235-4	2011	CURB RAMPS (TYPE D)
235-5	2011	CURB RAMPS (TYPE E)
236-1	2017*	DUAL CURB RAMP (RADIAL, 25'-35' R) ATTACHED SIDEWALK
236-2	2017*	DUAL CURB RAMP (RADIAL, 25'-35' R) DETTACHED SIDEWALK
236-3	2017*	DUAL CURB RAMP (RADIAL, 20' R) ATTACHED SIDEWALK

200 SERIES: STREET INFORMATION (CONTINUED)

Detail	Revised	Title
237-1	2017*	DUAL CURB RAMP (DIRECTIONAL, 25'-35' R) ATTACHED SIDEWALK
237-2	2017*	DUAL CURB RAMP (DIRECTIONAL, 25'-35' R) DETTACHED SIDEWALK
237-3	2017*	DUAL CURB RAMP (DIRECTIONAL, 20' R) ATTACHED SIDEWALK
240	2010	VALLEY GUTTER
250-1	2014	DRIVEWAY ENTRANCES WITH DETACHED SIDEWALK
250-2	2013	DRIVEWAY ENTRANCES WITH SIDEWALK ATTACHED TO CURB
251	2017*	RETURN TYPE DRIVEWAYS
252	2005	BUS BAYS
260	2013	ALLEY ENTRANCE (WITH VERTICAL CURB AND GUTTER)
262	2012	WING TYPE ALLEY ENTRANCE (W/ COMBINED CURB & GUTTER)
263	2002	WING TYPE ALLEY ENTRANCE (W/ ROLL TYPE CURB & GUTTER)
270	2017*	ROUND FRAME AND COVER (AND GRADE ADJUSTMENTS)
271	2017*	SQUARE FRAME AND COVER (AND GRADE ADJUSTMENTS)

300 SERIES: WATER INFORMATION

Detail	Revised	Title
301	1998	BLOCKING FOR WATER GATE AND BUTTERFLY VALVES
302-1	1998	JOINT RESTRAINT WITH TIE RODS (DRAWING)
302-2	1998	JOINT RESTRAINT WITH TIE RODS (NOTES)
303-1	1998	JOINT RESTRAINT FOR DUCTILE IRON AND POLYETHYLENE WRAPPED DUCTILE IRON WATER PIPES (DRAWING)
303-2	1998	JOINT RESTRAINT FOR DUCTILE IRON AND POLYETHYLENE WRAPPED DUCTILE IRON WATER PIPES (TABLES)
310	2017*	STEEL WATER METER BOX COVER
315	2017*	POLYMER CONCRETE WATER METER BOX COVER
319	2017*	TRAFFIC RATED BOX AND COVER
320	2017*	NON TRAFFIC RATED WATER METER BOXES
321	1998	STANDARD WATER METER VAULT
340	2002	INSTALLING TAPPING SLEEVES AND VALVES
342	1998	CONCRETE PRESSURE PIPE TAPPING SLEEVE
345-1	1998	3", 4", 6" WATER METER
345-2	1998	4", 6" WATER METER WITH ON-SITE HYDRANTS
346	1998	FIRE LINE DETECTOR CHECK VAULT
360-1	2013	DRY BARREL FIRE HYDRANT INSTALLATION
360-2	2013	WET BARREL FIRE HYDRANT INSTALLATION
360-3	2013	FIRE HYDRANT INSTALLATION DETAILS
362	1999	LOCATIONS FOR NEW FIRE HYDRANTS
370	1998	VERTICAL REALIGNMENT OF WATER MAINS
380	1998	THRUST BLOCKS FOR WATER LINES
381	1998	ANCHOR BLOCKS FOR VERTICAL BENDS
389	2001	CURB STOP WITH VALVE BOX AND COVER
390	1998	CURB STOP WITH FLUSHING PIPE
391-1	2017*	VALVE BOX INSTALLATION AND GRADE ADJUSTMENT
391-2	2017*	VALVE BOX INSTALLATION AND GRADE ADJUSTMENT
392	2015	DEBRIS CAP INSTALLATION
393	2017*	WATER VALVE EXTENSION

* NEWLY REVISED.

DETAIL NO.

100-1



STANDARD DETAIL
ENGLISH

INDEX (PAGE 1 OF 2)

REVISED

01-01-2017

DETAIL NO.

100-1

400 SERIES: SEWER INFORMATION

Detail	Revised	Title
403-1	1998	PIPE SUPPORT ACROSS TRENCHES
403-2	1998	PIPE SUPPORT ACROSS TRENCHES
403-3	1998	ALTERNATIVE TO PIPE SUPPORT
404-1	2006	WATER AND SANITARY SEWER SEPARATION/PROTECTION
404-2	2006	WATER AND SANITARY SEWER SEPARATION/PROTECTION
404-3	2006	WATER AND SANITARY SEWER SEPARATION/PROTECTION
405	1998	BROKEN SEWER LINE REPLACEMENT
420-1	2015	CONCRETE SANITARY SEWER MANHOLE
420-2	2015	PRE-CAST CONCRETE MANHOLE BASE
420-3	2015	CONCRETE MANHOLE BASE
421	2015	OFFSET MANHOLE 8" TO 30" PIPE
422	2015	MANHOLE FRAME AND COVER ADJUSTMENT
423-1	2012	24" CAST IRON MANHOLE FRAME AND COVER
423-2	2012	30" CAST IRON MANHOLE FRAME AND COVER
424-1	2012	24" CAST IRON WATERTIGHT MANHOLE FRAME AND COVER
424-2	2012	30" CAST IRON WATERTIGHT MANHOLE FRAME AND COVER
425	1998	24" ALUMINUM MANHOLE FRAME AND COVER
426	2007	DROP SEWER CONNECTIONS
427	1998	STUB OUT AND PLUGS
429	2015	INDUSTRIAL WASTE CONTROL VAULT WITH MANHOLE
440-1	2007	TYPE 'A' SEWER BUILDING CONNECTION - ELECTRONIC BALL MARKERS (STANDARD)
440-2	2007	TYPE 'B' SEWER BUILDING CONNECTION - TWO-WAY CLEANOUT AND METER BOX AT R/W
440-3	2007	TYPE 'C' SEWER BUILDING CONNECTION - ONE-WAY CLEANOUT AND METER BOX
440-4	2006	SEWER SERVICE CURB CROSSING STAMP DETAIL
441	2001	SEWER CLEANOUT

500 SERIES: IRRIGATION AND STORM DRAIN INFORMATION

Detail	Revised	Title
501-1	2012	HEADWALL
501-2	2012	HEADWALL
501-3	1998	HEADWALL 42" TO 84" PIPE
501-4	1998	HEADWALL IRRIGATION 18" TO 60" PIPE
501-5	2014	HEADWALL DROP INLET
502-1	1998	TRASH RACK
502-2	2004	TRASH RACK
503	1998	IRRIGATION STANDPIPE
504	1998	CONCRETE BLOCK JUNCTION BOX
505	1998	CONCRETE PIPE COLLAR
506	1998	IRRIGATION VALVE INSTALLATION
507	2017*	ENCASED CONCRETE PIPE (FOR SHALLOW INSTALLATION)
510	1998	CORRUGATED METAL PIPE AND INSTALLATION

500 SERIES: IRRIGATION AND STORM DRAIN INFORMATION (CONTINUED)

Detail	Revised	Title
520	1998	STORM DRAIN MANHOLE BASE (48" AND SMALLER)
521	1998	STORM DRAIN MANHOLE BASE (51" OR LARGER)
522	2015	STORM DRAIN MANHOLE SHAFT
523-1	1998	PRESSURE MANHOLE
523-2	1998	PRESSURE MANHOLE
524	1998	STORM DRAIN LATERAL PIPE CONNECTIONS
530	1998	3'-6" CURB OPENING CATCH BASIN - TYPE 'A'
531	1998	5'-6" CURB OPENING CATCH BASIN - TYPE 'B'
532	1998	8'-0" CURB OPENING CATCH BASIN - TYPE 'C'
533-1	1998	CATCH BASIN TYPE 'D'
533-2	1999	APRON FOR TYPE 'D' CATCH BASIN
533-3	2007	FRAME AND GRATE FOR TYPE 'D' CATCH BASIN
533-4	2007	7'-0" CURB OPENING CATCH BASIN TYPE 'D' - GRATE DETAILS
534-1	1998	CATCH BASIN TYPE 'E'
534-2	1998	CATCH BASIN TYPE 'E' (DETAILS)
534-3	1998	CATCH BASIN TYPE 'E' (DETAILS)
534-4	1998	CATCH BASIN TYPE 'E' (DETAILS)
534-5	1998	ALTERNATE GRATE STYLES, SUMP LOCATION
535	2009	CATCH BASIN TYPE 'F' (FOR USE WITHOUT CURB)
536-1	1999	COMMON DETAILS AND SECTIONS FOR CURB OPENING CATCH BASINS
536-2	1998	ALTERNATIVE COVER FOR CURB OPENING CATCH BASINS
537	2002	CATCH BASIN TYPE 'G'
538	1998	CATCH BASIN TYPE 'H'
539	1998	GRATES FOR CATCH BASINS, TYPE G AND H
540-1	1998	CATCH BASIN GRATES
540-2	1998	CATCH BASIN GRATES
541	2005	CATCH BASIN SUBGRADE DRAIN
545	1998	END SECTION - REINFORCED CONCRETE PIPE
550	1998	SPILLWAY INLET AND OUTLET
552	2015	FORD CROSSING WITH CUT-OFF WALLS
555	2010	EROSION PROTECTION/GABIONS

* NEWLY REVISED.

DETAIL NO.




100-2STANDARD DETAIL
ENGLISH**INDEX (PAGE 2 OF 2)**

REVISED

01-01-2017

DETAIL NO.

100-2

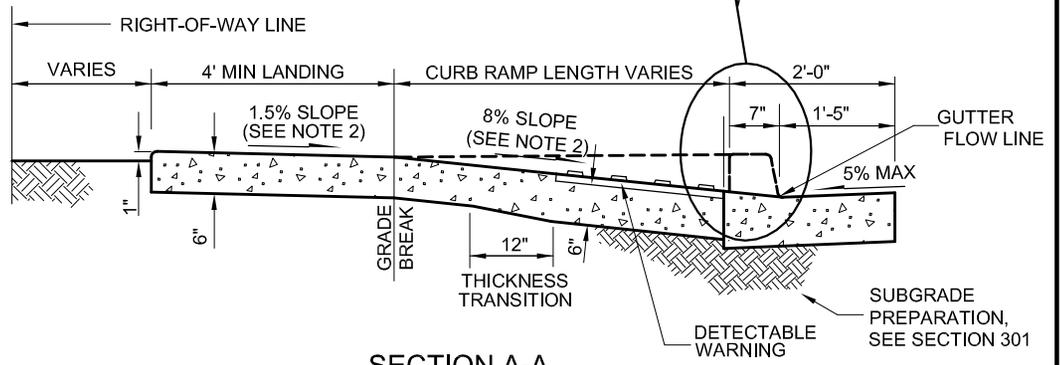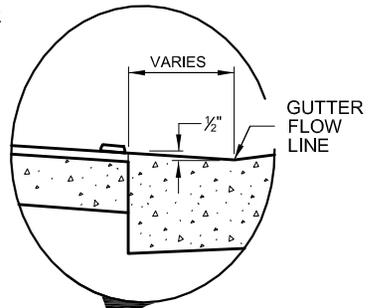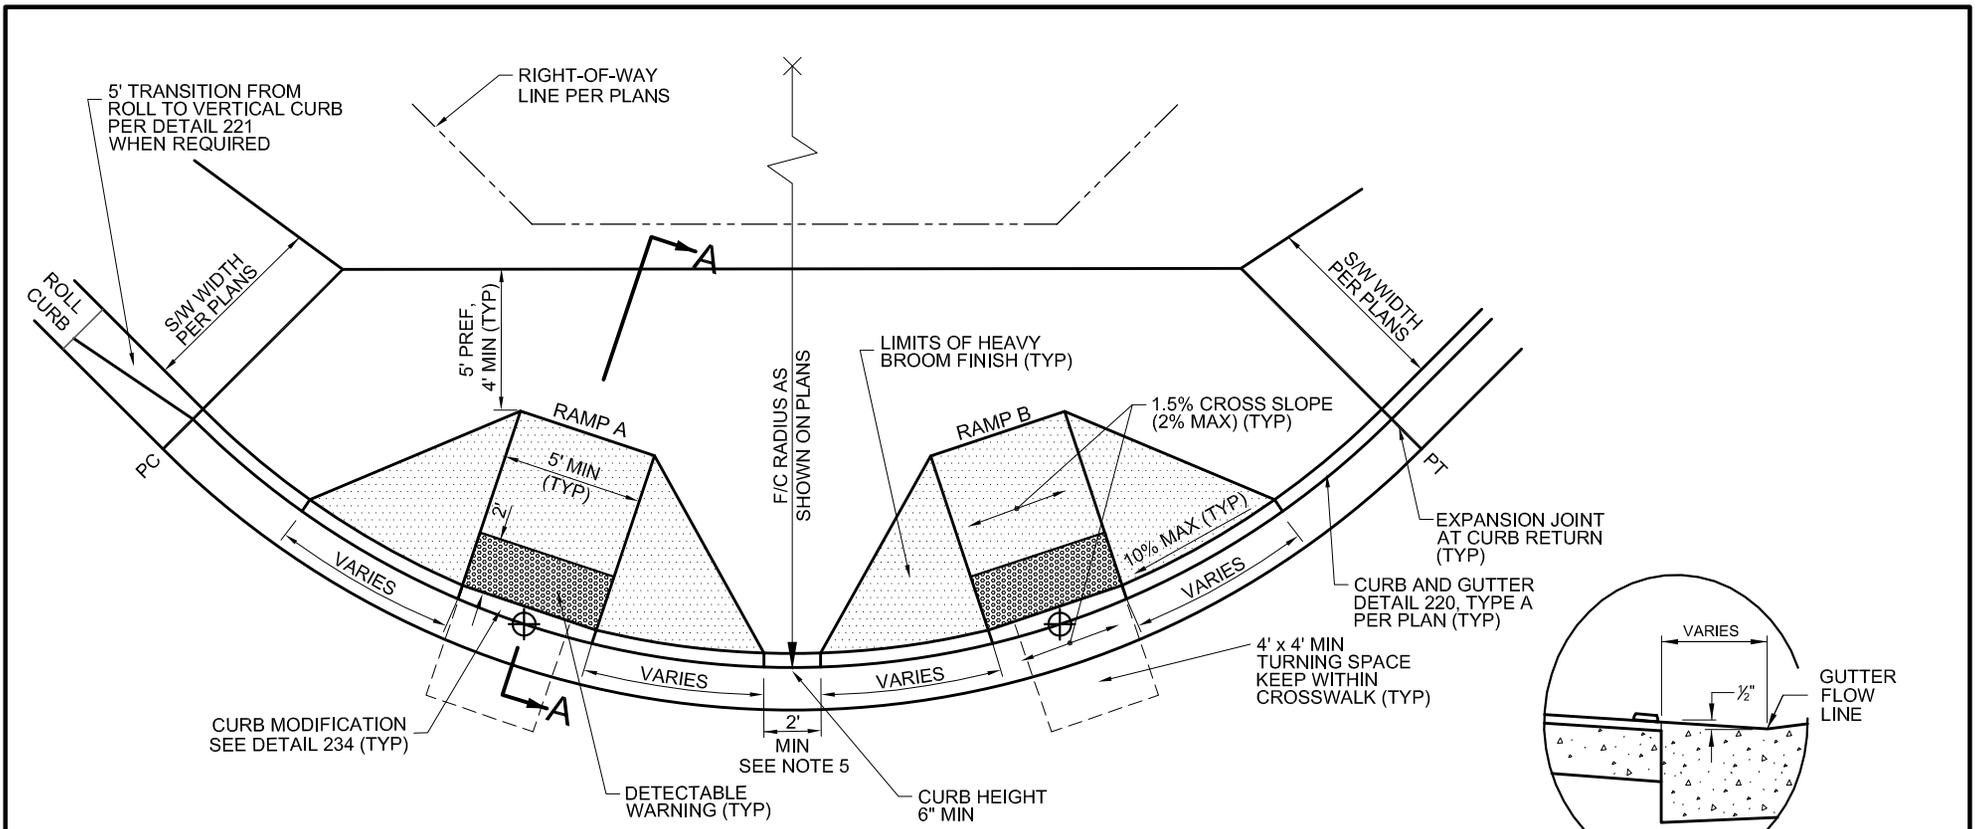




LEGEND

⊕ RAMP CONTROL POINT AT FACE-OF-CURB SEE PLANS (TYP)

NOTES:

1. CLASS 'A' CONCRETE PER SECTION 725, PC TO PT.
2. CONSTRUCTION INCLUDING EXPANSION JOINTS AND MAXIMUM SLOPES SHALL CONFORM TO SECTION 340.
3. WALKWAY SURFACE TO MATCH 1.5% SLOPE FROM TOP OF CURB.
4. DETECTABLE WARNING IS TO COMPLY WITH THE JURISDICTIONAL AGENCY'S REQUIREMENTS.
5. DISTANCE BETWEEN RAMPS MAY BE ADJUSTED TO IMPROVE ALIGNMENT WITH RECEIVING RAMP WHEN ALLOWED BY THE JURISDICTIONAL AGENCY.
6. SPECIAL DESIGN IS REQUIRED FOR GUTTER GRADES GREATER THAN 2%.

SECTION A-A

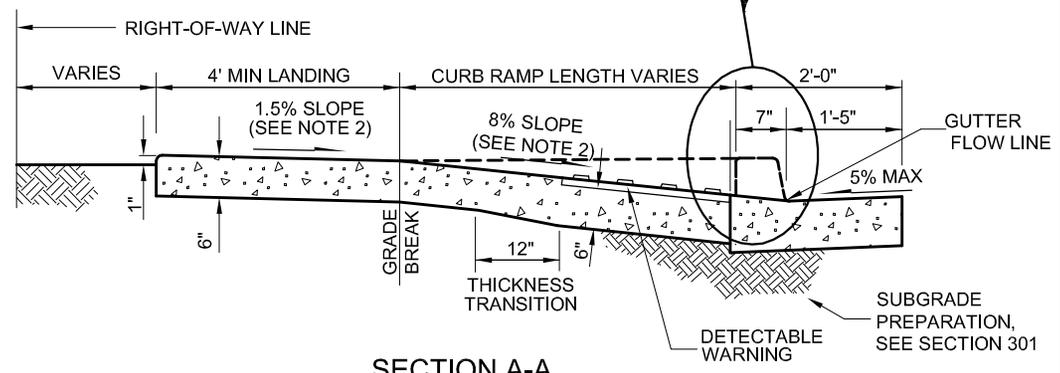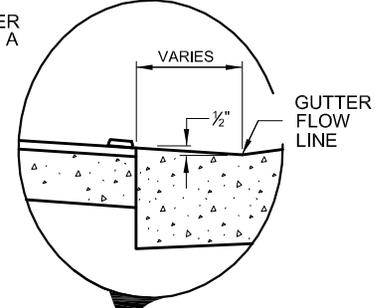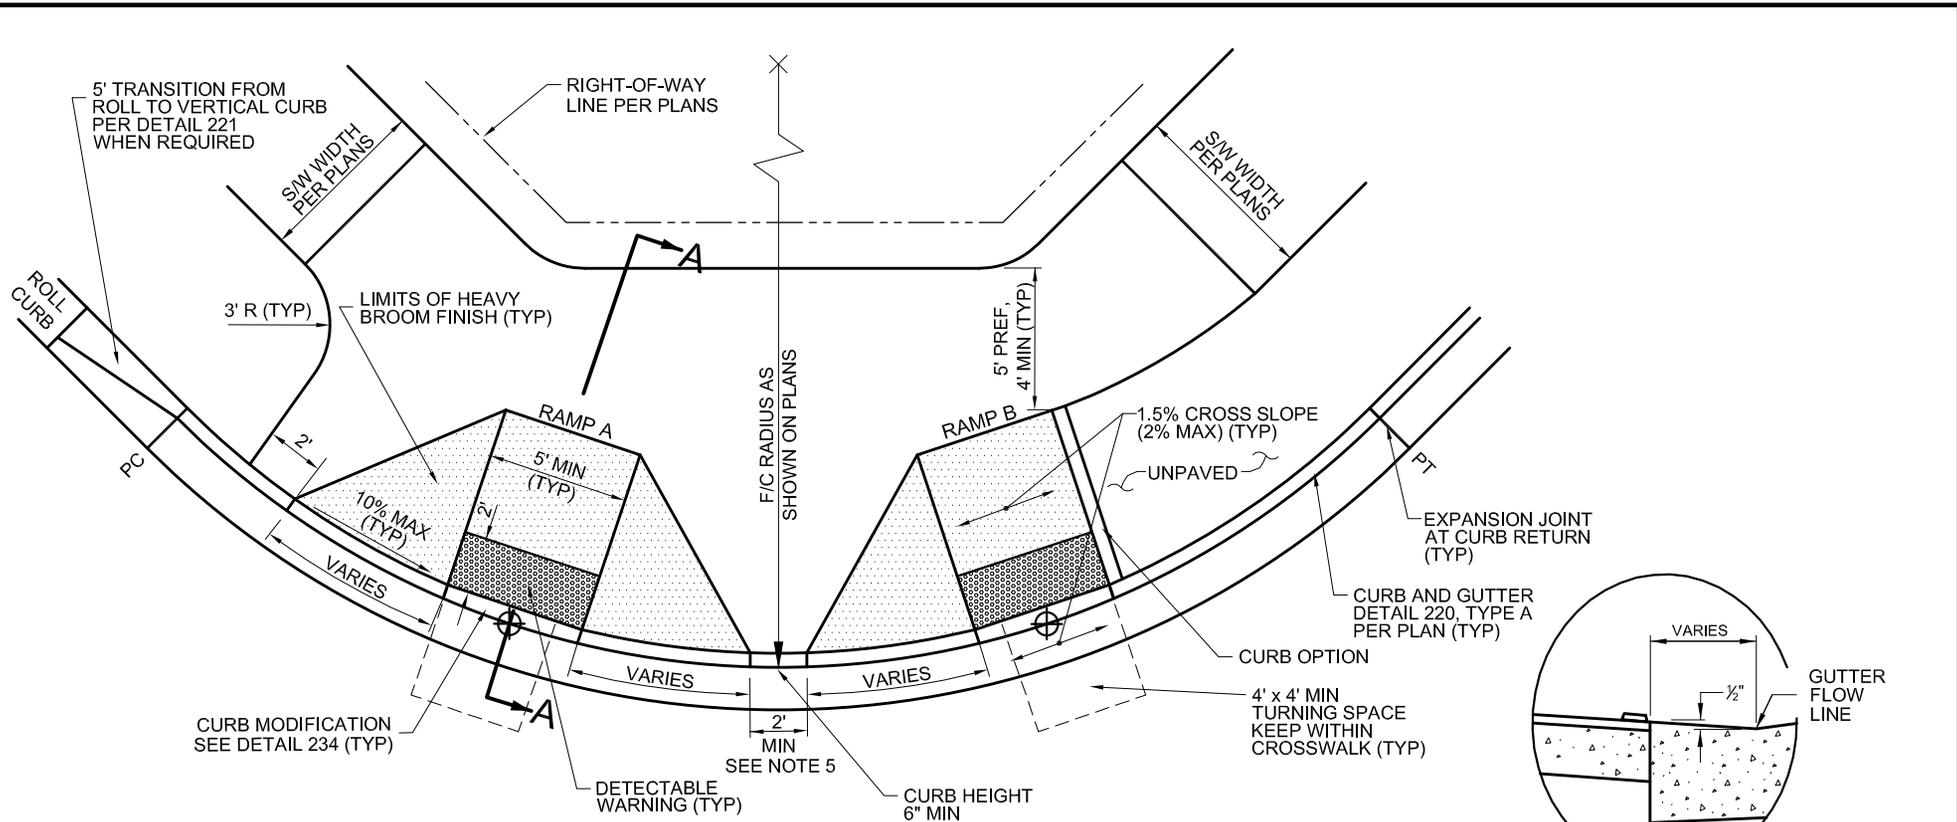

LEGEND




⊕ RAMP CONTROL POINT AT FACE-OF-CURB SEE PLANS (TYP)

NOTES:

1. CLASS 'A' CONCRETE PER SECTION 725, PC TO PT.
2. CONSTRUCTION INCLUDING EXPANSION JOINTS AND MAXIMUM SLOPES SHALL CONFORM TO SECTION 340.
3. WALKWAY SURFACE TO MATCH 1.5% SLOPE FROM TOP OF CURB.
4. DETECTABLE WARNING IS TO COMPLY WITH THE JURISDICTIONAL AGENCY'S REQUIREMENTS.
5. DISTANCE BETWEEN RAMPS MAY BE ADJUSTED TO IMPROVE ALIGNMENT WITH RECEIVING RAMP WHEN ALLOWED BY THE JURISDICTIONAL AGENCY.
6. SPECIAL DESIGN IS REQUIRED FOR GUTTER GRADES GREATER THAN 2%.

SECTION A-A

DETAIL NO. 236-2	MARICOPA ASSOCIATION of GOVERNMENTS	STANDARD DETAIL ENGLISH	DUAL CURB RAMP (RADIAL, 25' - 35' R) DETACHED SIDEWALK	REVISED 01-01-2017	DETAIL NO. 236-2
----------------------------	--	-----------------------------------	---	-----------------------	----------------------------

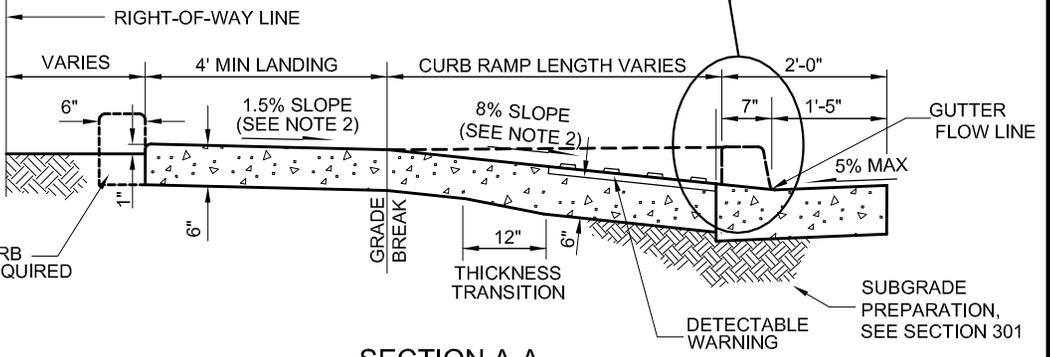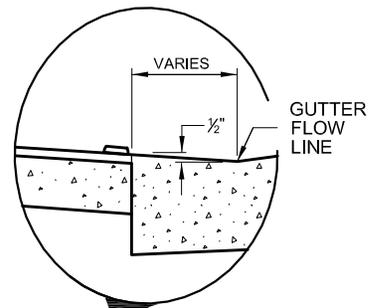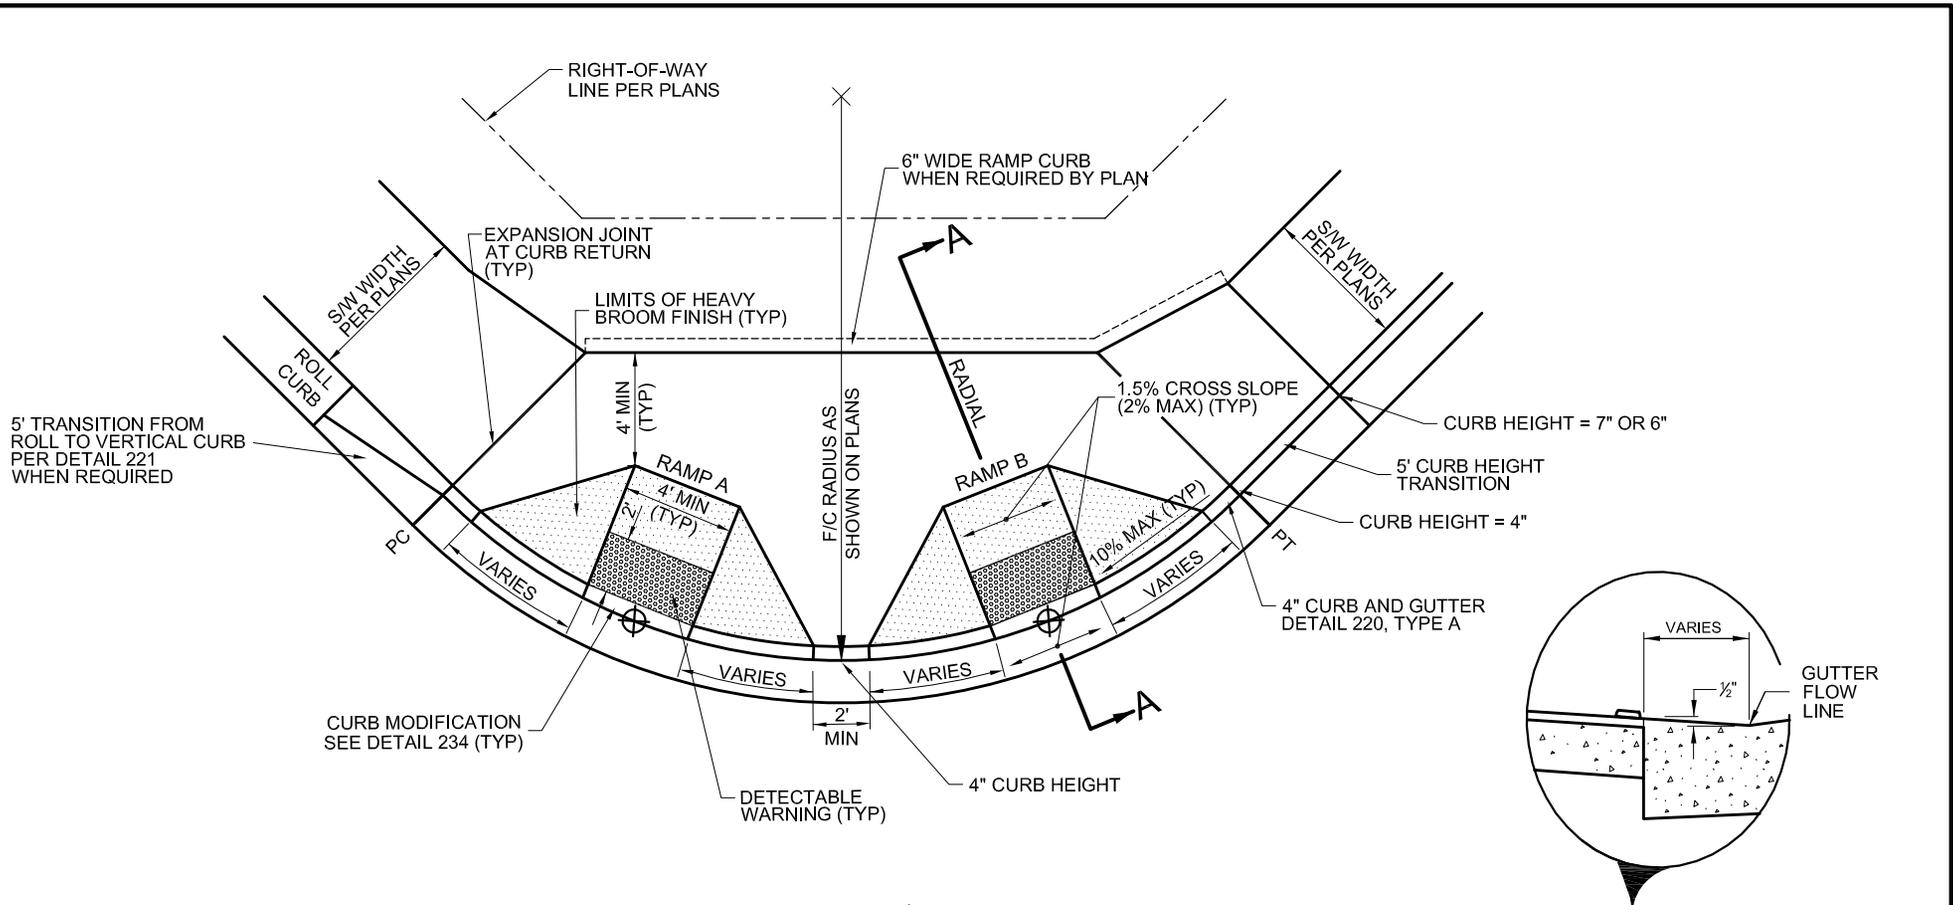


LEGEND

⊕ RAMP CONTROL POINT AT FACE-OF-CURB SEE PLANS (TYP)

NOTES:

1. CLASS 'A' CONCRETE PER SECTION 725, PC TO PT.
2. CONSTRUCTION INCLUDING EXPANSION JOINTS AND MAXIMUM SLOPES SHALL CONFORM TO SECTION 340.
3. WALKWAY SURFACE TO MATCH 1.5% SLOPE FROM TOP OF CURB.
4. DETECTABLE WARNING IS TO COMPLY WITH THE JURISDICTIONAL AGENCY'S REQUIREMENTS.
5. SPECIAL DESIGN IS REQUIRED FOR GUTTER GRADES GREATER THAN 2%.

DETAIL NO. 236-3	STANDARD DETAIL ENGLISH	DUAL CURB RAMP (RADIAL, 20' R) ATTACHED SIDEWALK	REVISED 01-01-2017	DETAIL NO. 236-3
----------------------------	--------------------------------	---	-----------------------	----------------------------


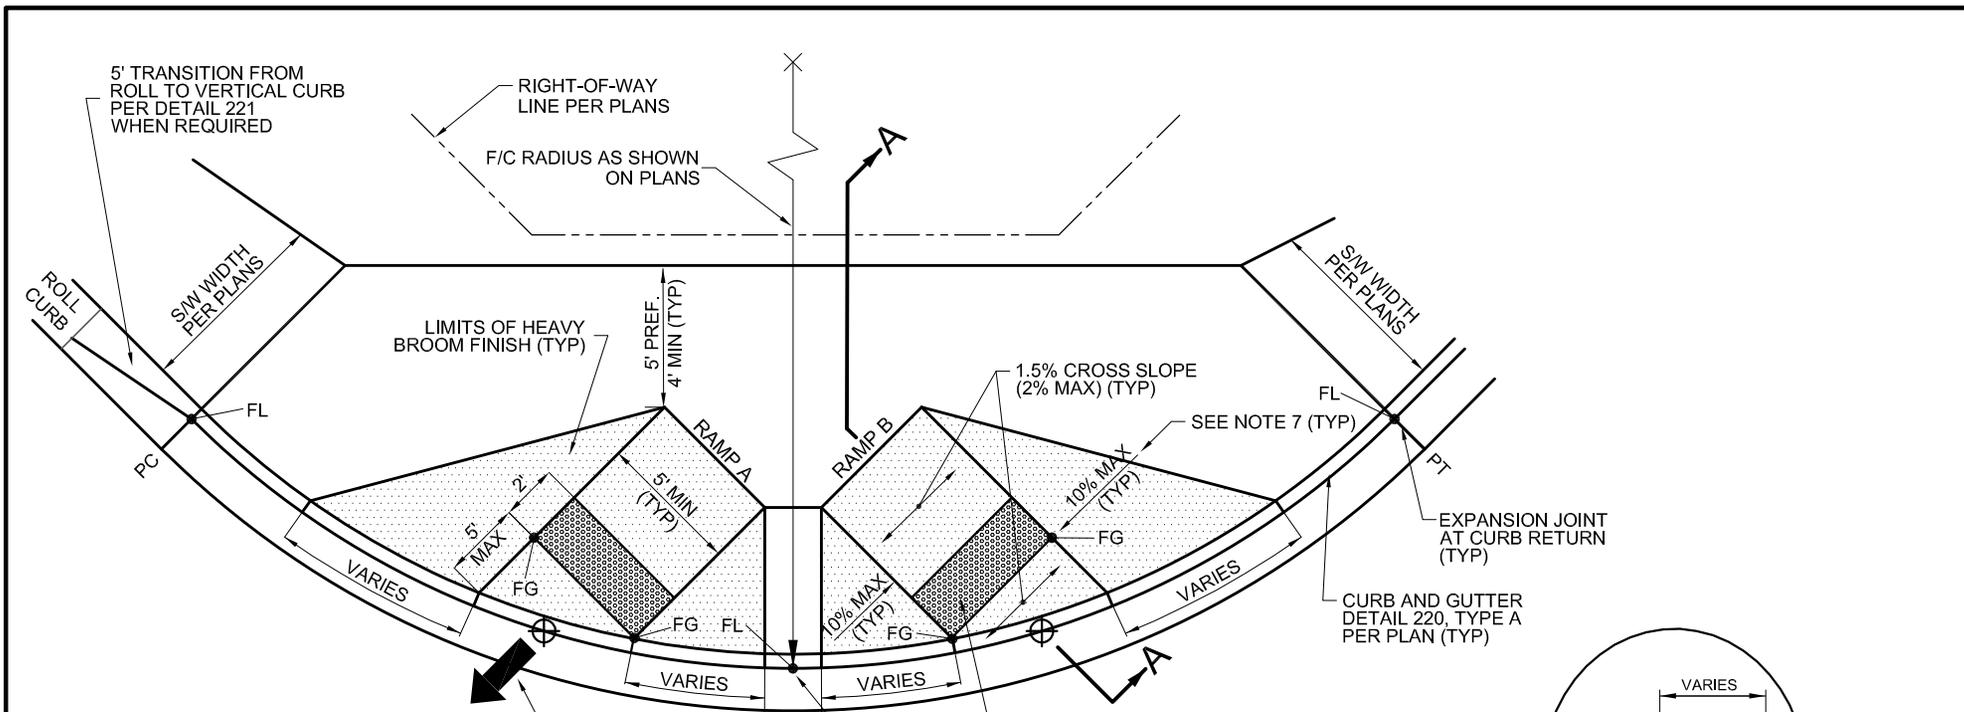


LEGEND

- ⊕ RAMP CONTROL POINT AT FACE-OF-CURB SEE PLANS (TYP)
- DESIGN ELEVATION SEE PLANS
FL = FLOW LINE, FG = FINISHED GRADE

NOTES:

1. CLASS 'A' CONCRETE PER SECTION 725, PC TO PT.
2. CONSTRUCTION INCLUDING EXPANSION JOINTS AND MAXIMUM SLOPES SHALL CONFORM TO SECTION 340.
3. WALKWAY SURFACE TO MATCH 1.5% SLOPE FROM TOP OF CURB.
4. DETECTABLE WARNING IS TO COMPLY WITH THE JURISDICTIONAL AGENCY'S REQUIREMENTS.
5. DISTANCE BETWEEN RAMPS MAY BE ADJUSTED TO IMPROVE ALIGNMENT WITH RECEIVING RAMP WHEN ALLOWED BY THE JURISDICTIONAL AGENCY.
6. SPECIAL DESIGN IS REQUIRED FOR GUTTER GRADES GREATER THAN 2%.
7. WING SLOPE SHALL NOT EXCEED 10% MEASURED PERPENDICULAR TO RAMP.
8. RAMP ALIGNMENT SHOULD CONNECT CONTROL POINT TO CONTROL POINT OF RECEIVING RAMP WITHIN 5 FEET.

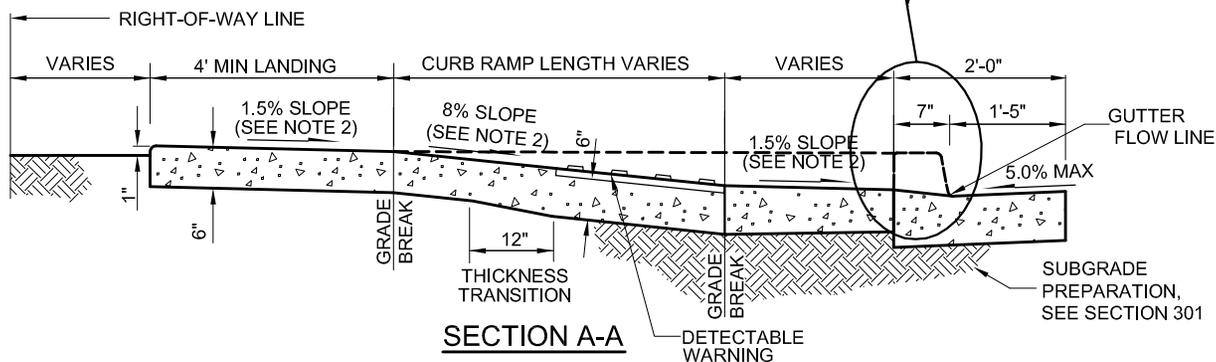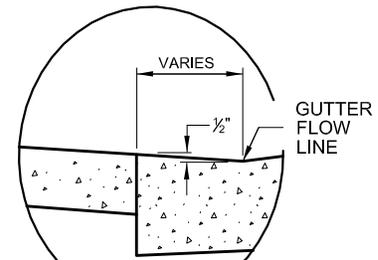

DETAIL NO.
237-1




STANDARD DETAIL
ENGLISH

**DUAL CURB RAMP (DIRECTIONAL, 25' - 35'R)
ATTACHED SIDEWALK**

REVISED
01-01-2017

DETAIL NO.
237-1

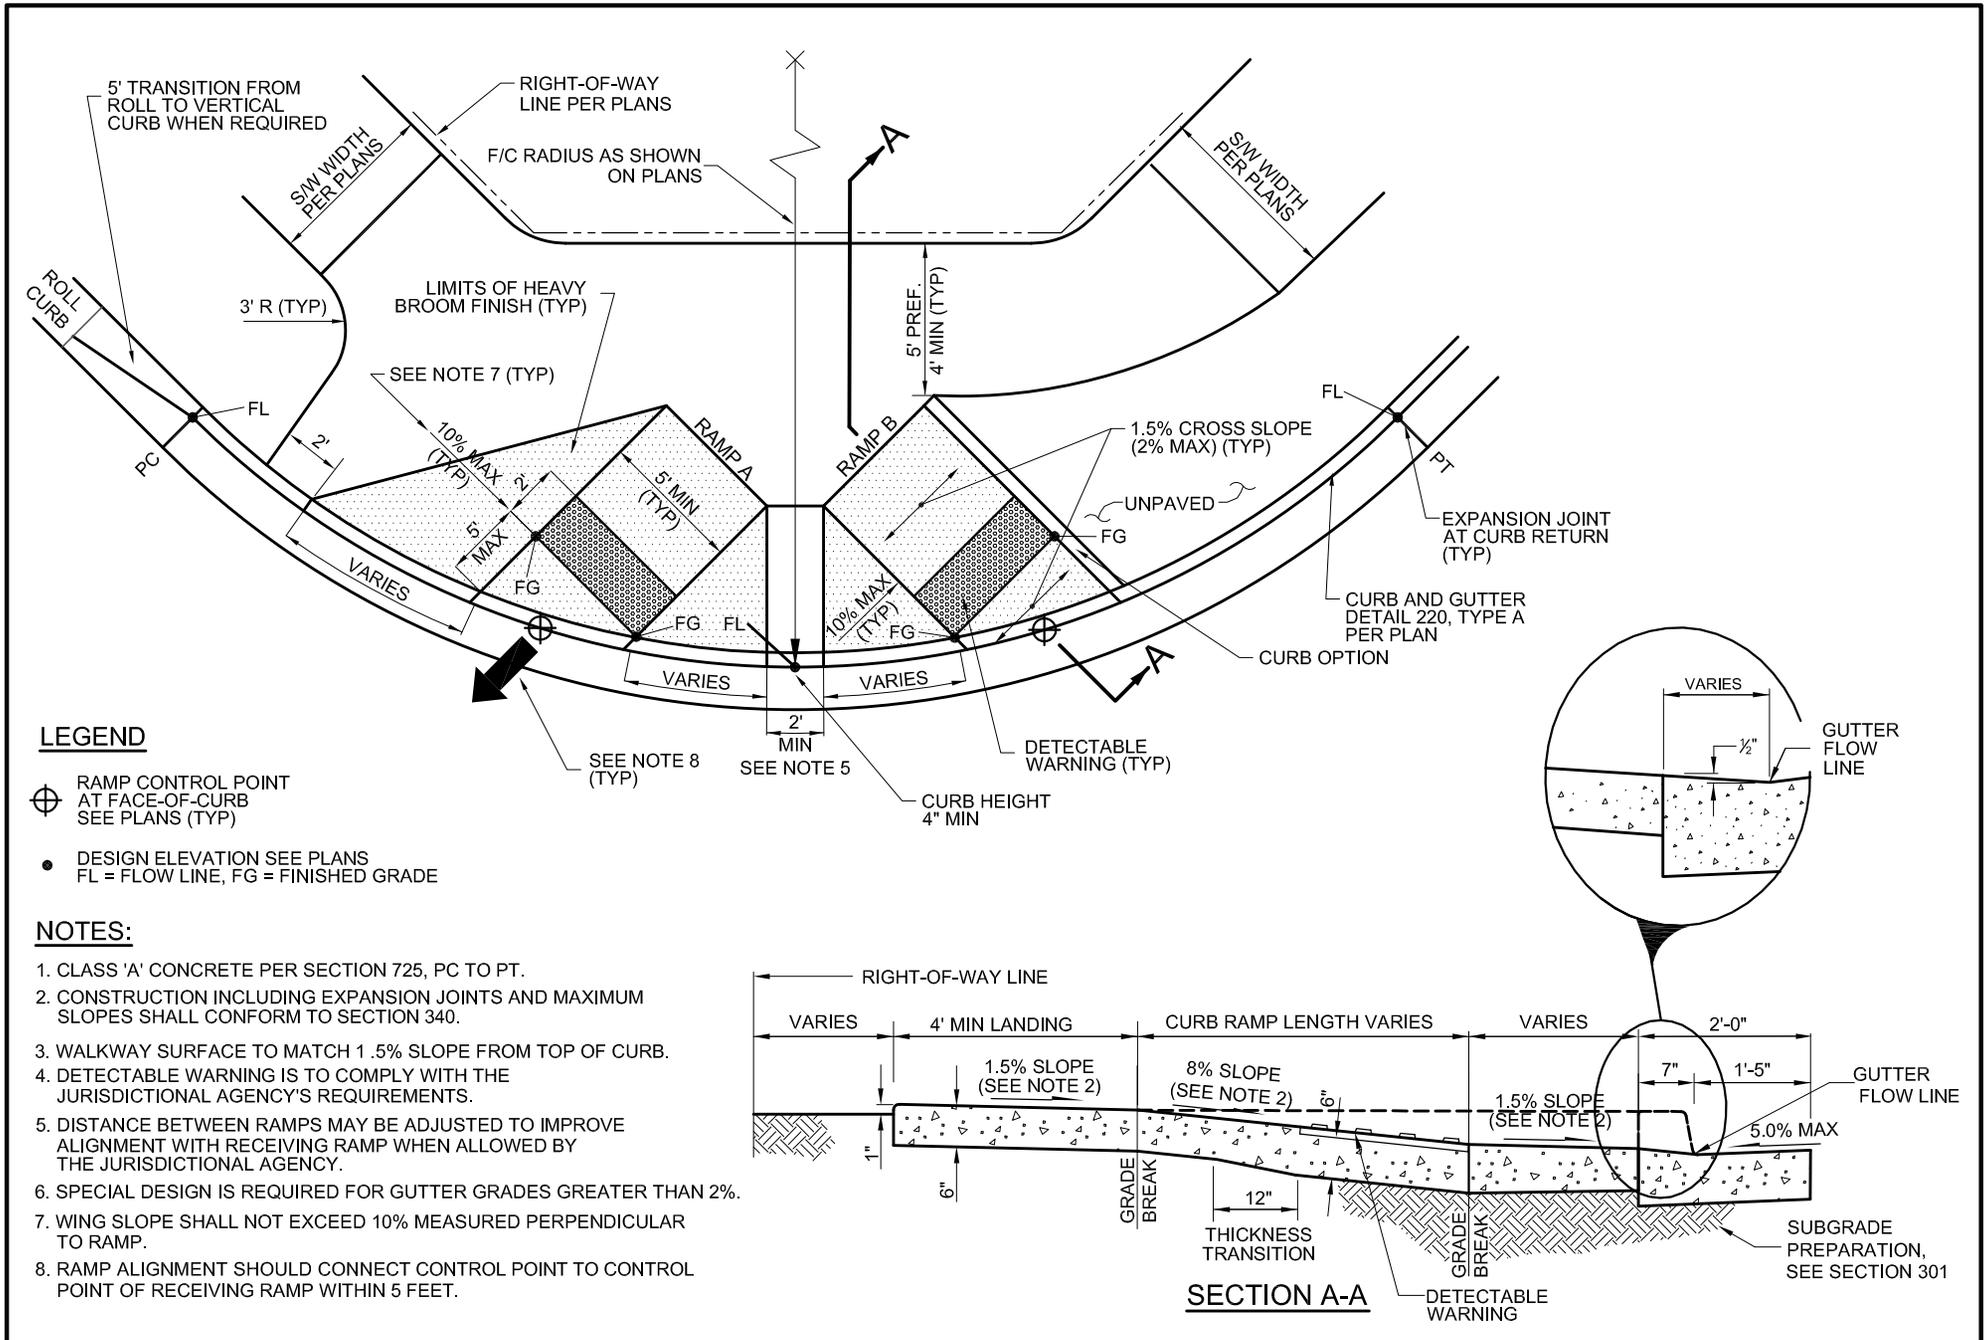


LEGEND

- ⊕ RAMP CONTROL POINT AT FACE-OF-CURB SEE PLANS (TYP)
- DESIGN ELEVATION SEE PLANS
FL = FLOW LINE, FG = FINISHED GRADE

NOTES:

1. CLASS 'A' CONCRETE PER SECTION 725, PC TO PT.
2. CONSTRUCTION INCLUDING EXPANSION JOINTS AND MAXIMUM SLOPES SHALL CONFORM TO SECTION 340.
3. WALKWAY SURFACE TO MATCH 1.5% SLOPE FROM TOP OF CURB.
4. DETECTABLE WARNING IS TO COMPLY WITH THE JURISDICTIONAL AGENCY'S REQUIREMENTS.
5. DISTANCE BETWEEN RAMPS MAY BE ADJUSTED TO IMPROVE ALIGNMENT WITH RECEIVING RAMP WHEN ALLOWED BY THE JURISDICTIONAL AGENCY.
6. SPECIAL DESIGN IS REQUIRED FOR GUTTER GRADES GREATER THAN 2%.
7. WING SLOPE SHALL NOT EXCEED 10% MEASURED PERPENDICULAR TO RAMP.
8. RAMP ALIGNMENT SHOULD CONNECT CONTROL POINT TO CONTROL POINT OF RECEIVING RAMP WITHIN 5 FEET.

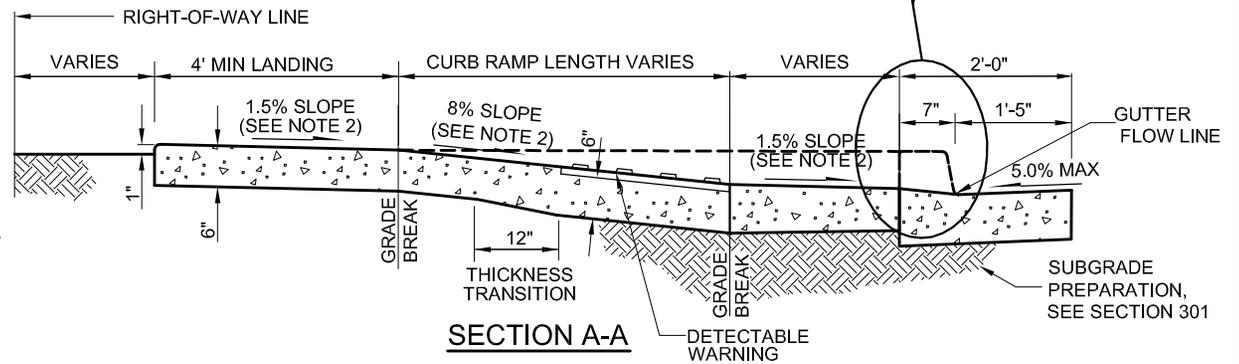

DETAIL NO.
237-2






STANDARD DETAIL
ENGLISH

**DUAL CURB RAMP (DIRECTIONAL, 25' - 35'R)
DETACHED SIDEWALK**

PROPOSED
01-01-2017

DETAIL NO.
237-2

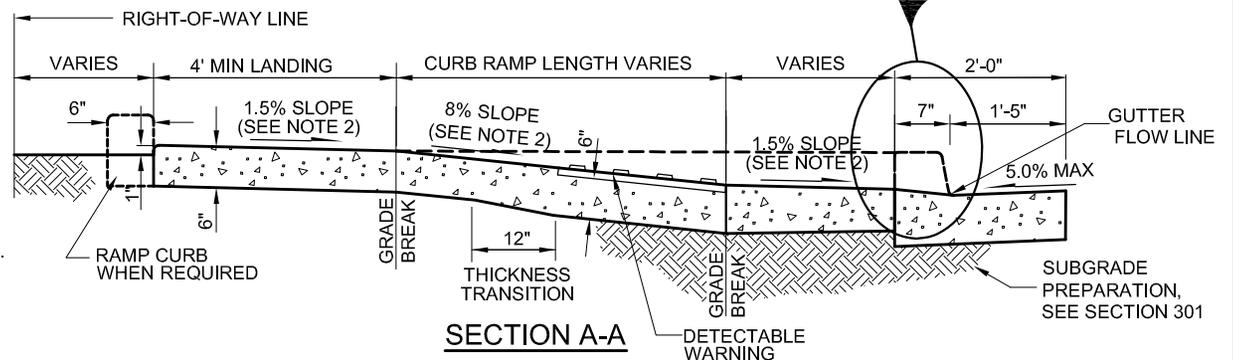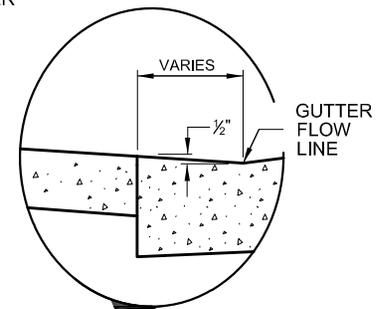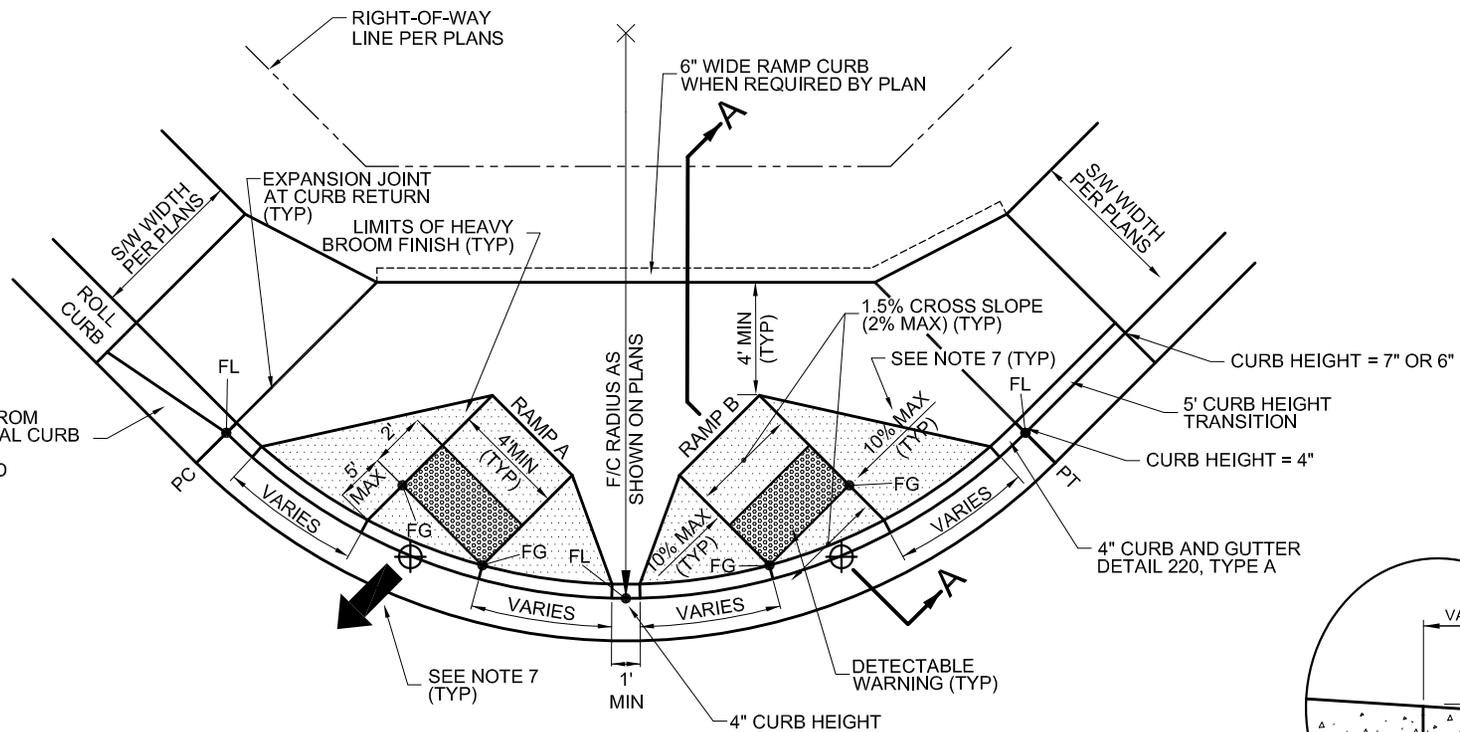

LEGEND

- ⊕ RAMP CONTROL POINT AT FACE-OF-CURB SEE PLANS (TYP)
- DESIGN ELEVATION SEE PLANS
FL = FLOW LINE, FG = FINISHED GRADE

NOTES:

1. CLASS 'A' CONCRETE PER SECTION 725, PC TO PT.
2. CONSTRUCTION INCLUDING EXPANSION JOINTS AND MAXIMUM SLOPES SHALL CONFORM TO SECTION 340.
3. WALKWAY SURFACE TO MATCH 1.5% SLOPE FROM TOP OF CURB.
4. DETECTABLE WARNING IS TO COMPLY WITH THE JURISDICTIONAL AGENCY'S REQUIREMENTS.
5. SPECIAL DESIGN IS REQUIRED FOR GUTTER GRADES GREATER THAN 2%.
6. WING SLOPE SHALL NOT EXCEED 10% MEASURED PERPENDICULAR TO RAMP.
7. RAMP ALIGNMENT SHOULD CONNECT CONTROL POINT TO CONTROL POINT OF RECEIVING RAMP WITHIN 5 FEET.

DETAIL NO.
237-3




STANDARD DETAIL
ENGLISH



**DUAL CURB RAMP (DIRECTIONAL, 20' R)
ATTACHED SIDEWALK**

REVISED
01-01-2017

DETAIL NO.
237-3

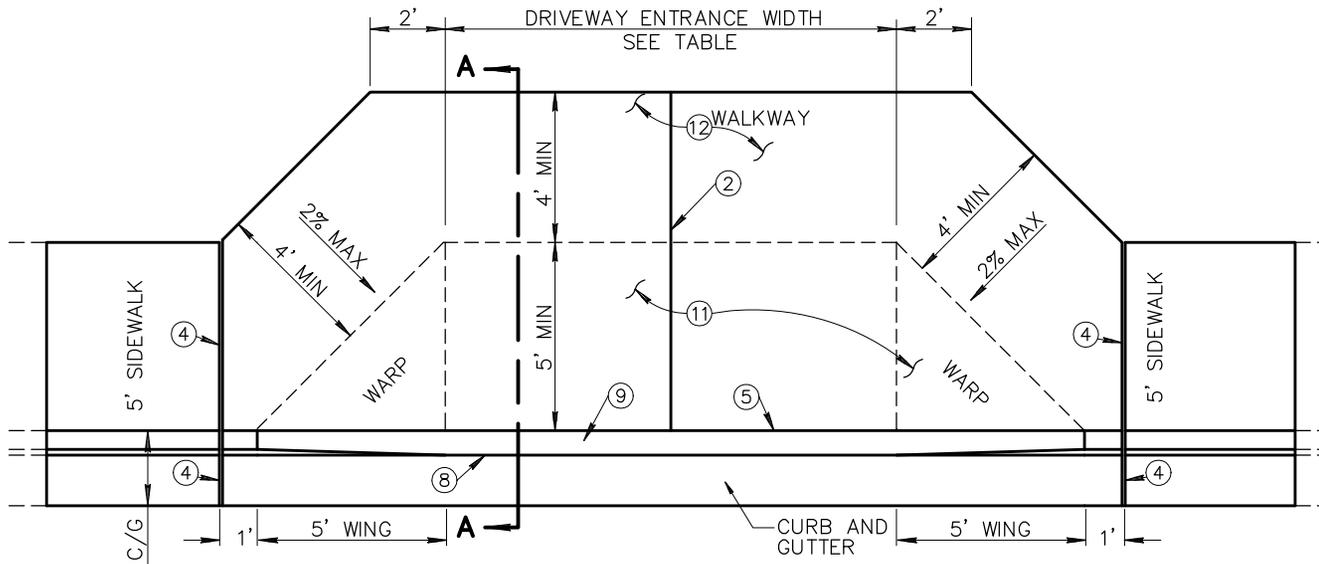

DRIVEWAY WITH SIDEWALK ATTACHED TO CURB

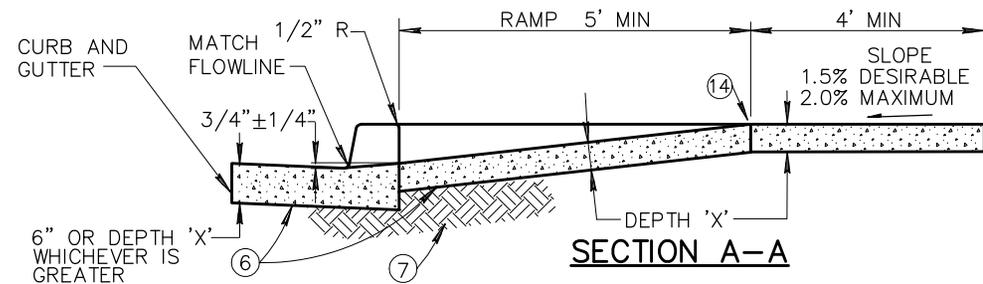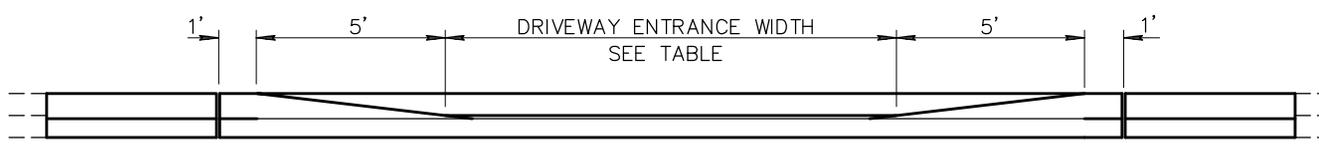

COMMERCIAL AND INDUSTRIAL					RESIDENTIAL				
DRIVEWAY ENTRANCE WIDTH	MIN.	MAX.	CLASS	DEPTH 'X'	DRIVEWAY ENTRANCE WIDTH	MIN.	MAX.	CLASS	DEPTH 'X'
COMMERCIAL	* 16'	40'	A	9"	MAJOR STREET	16'	30'	B	5"
INDUSTRIAL	* 16'	40'	A	9"	COLLECTOR STREET	* 12'	30'	B	5"
* 24' MIN. FOR TWO WAY TRAFFIC					LOCAL STREET	12'	30'	B	5"
					* 16' DESIRABLE				

NOTES:

- DEPRESSED CURB SHALL BE PAID FOR AT THE CONTRACT UNIT PRICE FOR THE TYPE OF CURB USED AT THAT LOCATION.
- CONTRACTION JOINT(S) FOR DRIVEWAY ENTRANCE: WIDTH LESS THAN 22' NONE REQUIRED; WIDTH GREATER THAN 22' AND LESS THAN 30' LOCATE SINGLE JOINT ON D/W CENTERLINE; WIDTH OF 30' OR GREATER LOCATE TWO JOINTS TO EQUALLY DIVIDE THE DRIVEWAY ENTRANCE WIDTH.
- DETAIL GEOMETRICS ARE BASED ON A CURB HEIGHT OF SIX INCHES (6"), AN ATTACHED SIDEWALK WIDTH OF FIVE FEET (5'), AND A DRIVEWAY RAMP LENGTH NOT EXCEEDING SIX FEET (6'). GEOMETRIC MODIFICATIONS MAY BE REQUIRED WHEN CONDITIONS ARE MODIFIED.
- 1/2-INCH EXPANSION JOINTS SHALL COMPLY WITH SECTION 340.
- BACK OF CURB - CONSTRUCTION JOINT.
- CONCRETE CLASS AS NOTED IN TABLE. CONCRETE PER SECTION 725.
- SUBGRADE PREPARATION, SECT. 301.
- FLOW LINE OF GUTTER.
- DEPRESSED CURB.
- SECT. A-A AND ELEVATION: D/W SHOWN WITH VERTICAL CURB AND GUTTER, ROLL TYPE CURB AND GUTTER TREATED SIMILARLY.
- ROUGH BROOM FINISH FULL WIDTH OF RAMP AND WINGS.
- TROWEL AND USE LIGHT HAIR BROOM FINISH FOR WALKWAY AREA.
- 'DRIVEWAY ENTRANCE WIDTH' IS THE DRIVEWAY WIDTH PLUS ADDITIONAL WIDENING REQUIRED BY THE LOCAL JURISDICTION.
- ELEVATION AT TOP OF DRIVEWAY RAMP SHALL BE EQUAL TO OR HIGHER THAN NORMAL CURB ELEVATION.

DETAIL NO.
250-2




STANDARD DETAIL
ENGLISH

**DRIVEWAY ENTRANCES WITH
SIDEWALK ATTACHED TO CURB**

REVISED
01-01-2013

DETAIL NO.
250-2

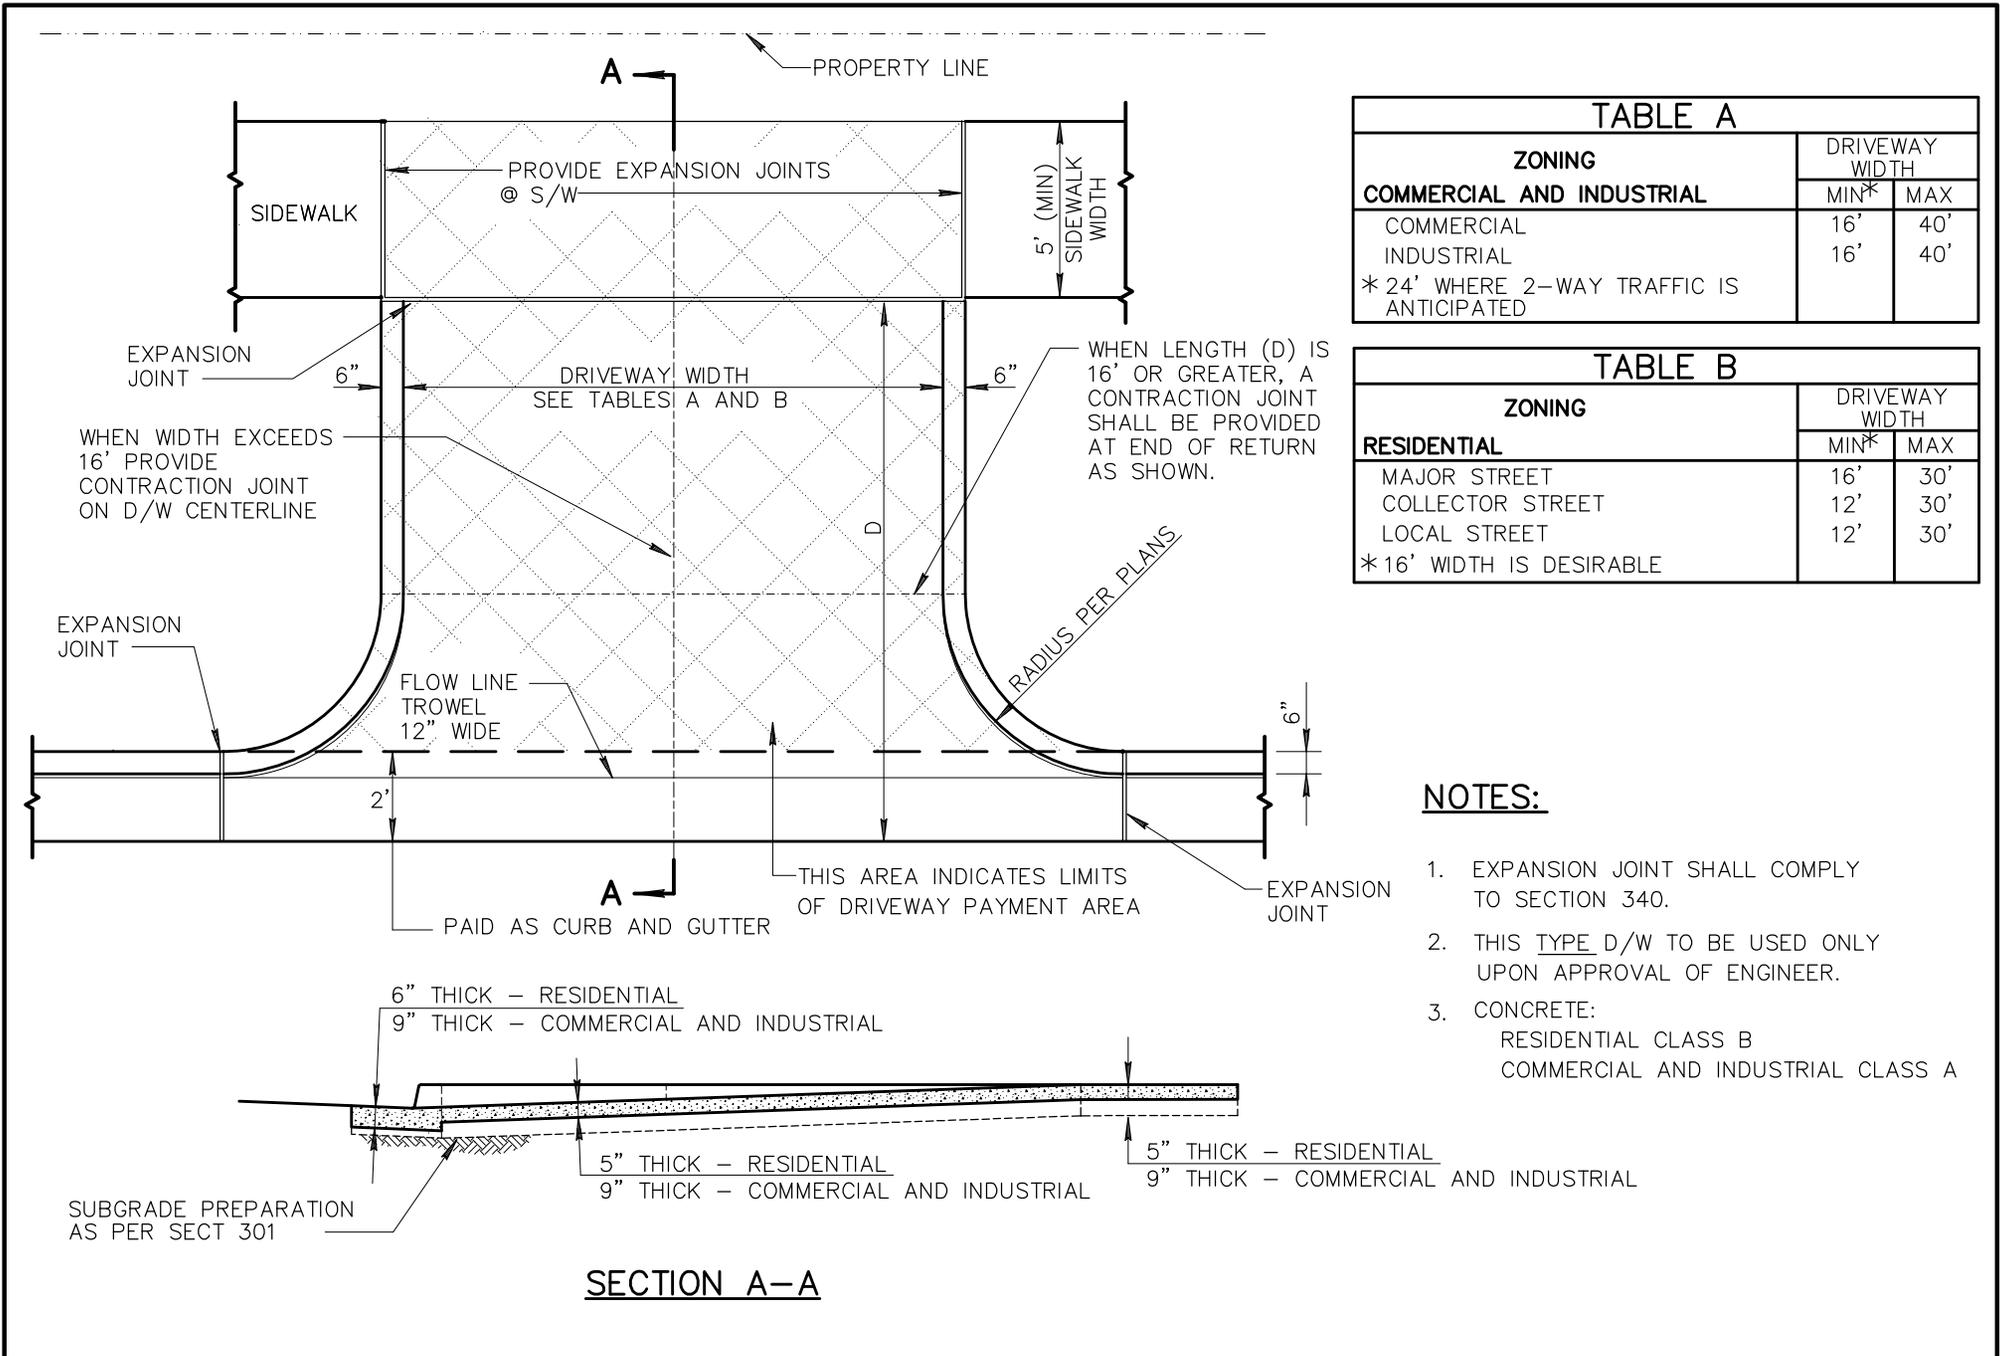

NOTES:

1. EXPANSION JOINT SHALL COMPLY TO SECTION 340.
2. THIS TYPE D/W TO BE USED ONLY UPON APPROVAL OF ENGINEER.
3. CONCRETE:
RESIDENTIAL CLASS B
COMMERCIAL AND INDUSTRIAL CLASS A

SECTION A-A

DETAIL NO.

251



STANDARD DETAIL
ENGLISH



RETURN TYPE DRIVEWAYS

REVISED

01-01-2017


DETAIL NO.

251

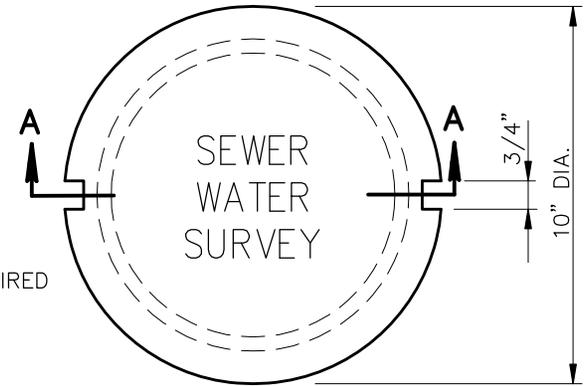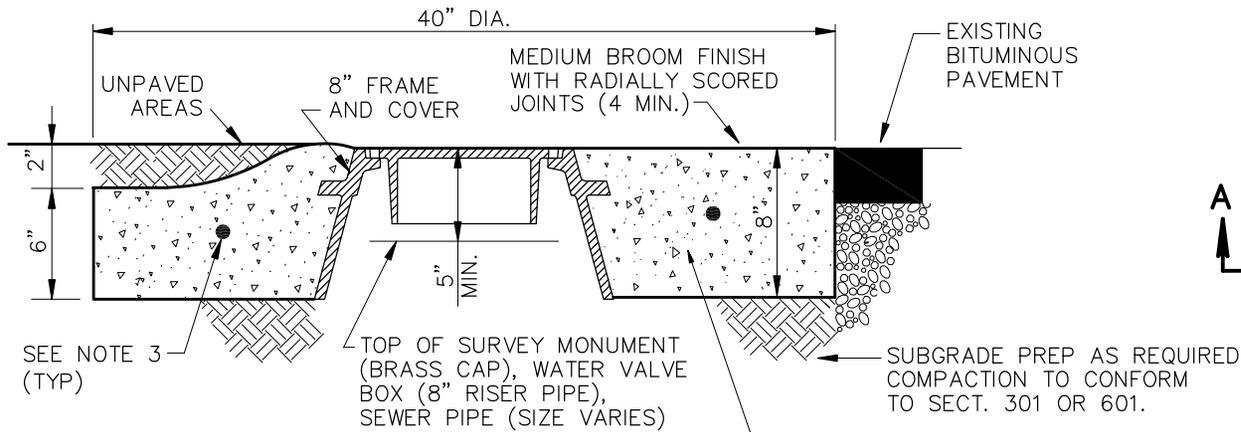


GRADE ADJUSTMENT FOR FRAME AND COVER

CLASS 'AA' CONC. ALL AROUND FRAME PER SECT. 725

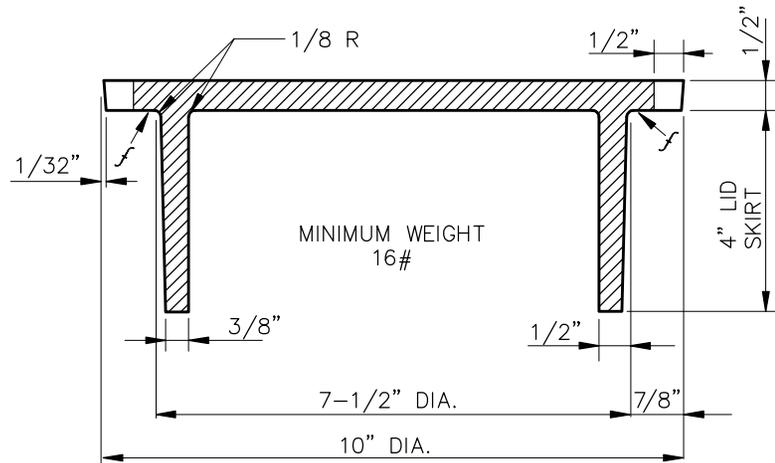

COVER SECTION A-A

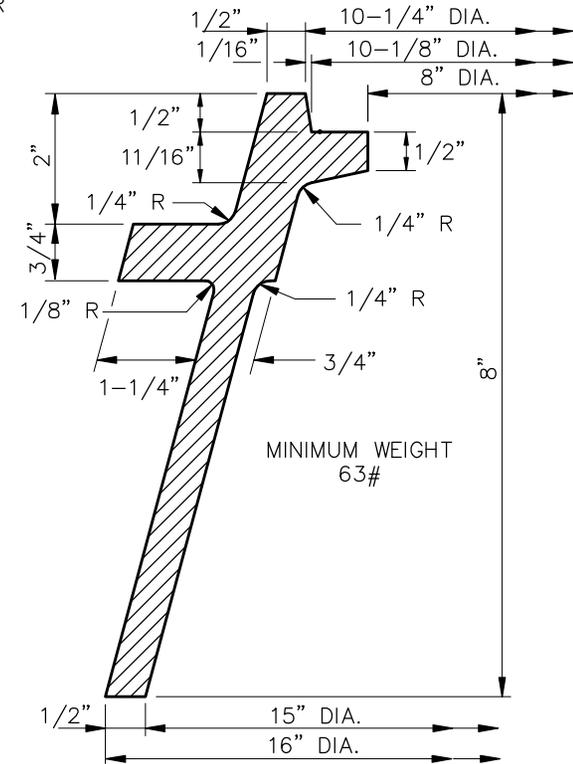

8" C.I. FRAME AND COVER

NOTES:

1. CASTING TO CONFORM TO SECT. 787.
2. LETTERS ON COVER TO BE AS FOLLOWS: "SEWER", "WATER", OR "SURVEY" AS DIRECTED. TOTAL WIDTH OF WORD "SEWER" OR "WATER" 3-3/4", TOTAL WIDTH OF THE WORD "SURVEY" 4-1/2". LETTER SIZE 5/8" X 3/4", RAISED 1/16" ABOVE THE LEVEL OF THE COVER.
3. #4 REINFORCING STEEL HOOP EQUALLY CENTERED HORIZONTALLY & VERTICALLY.
4. \nearrow INDICATES MACHINE FINISHED SURFACE.

DETAIL NO.

270



STANDARD DETAIL
ENGLISH


**ROUND FRAME AND COVER
AND GRADE ADJUSTMENT**

REVISED


01-01-2017

DETAIL NO.


270

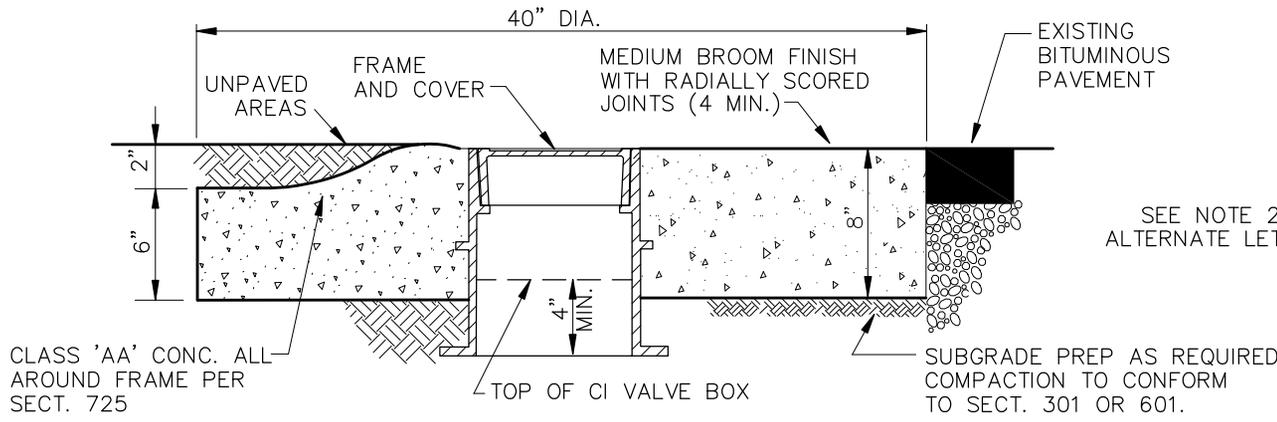



GRADE ADJUSTMENT FOR FRAME AND COVER

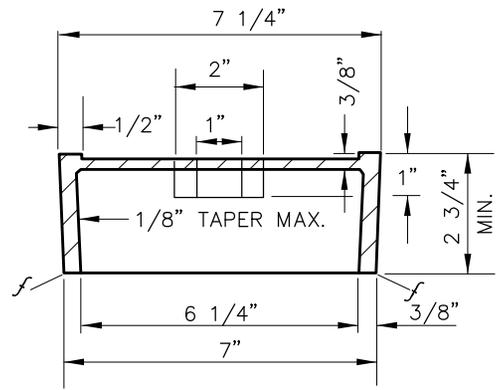

COVER SECTION A-A

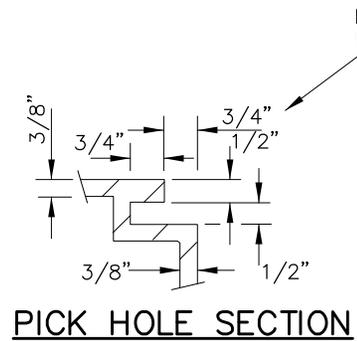



PICK HOLE SECTION

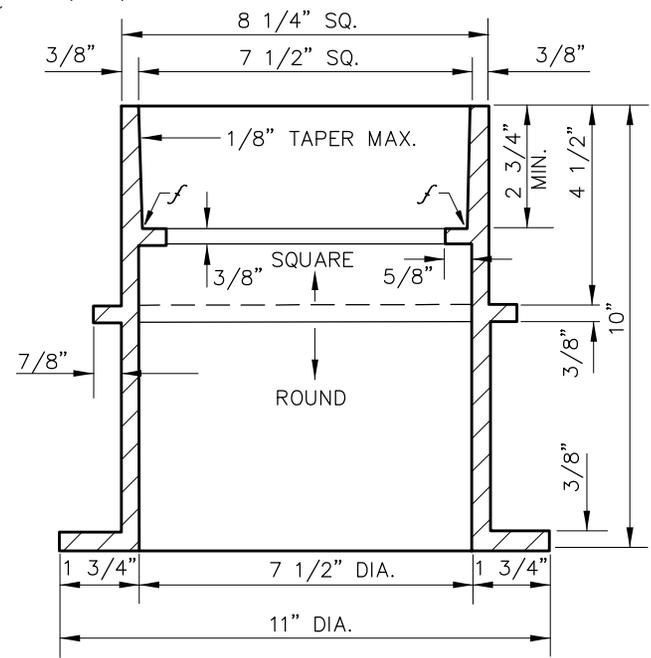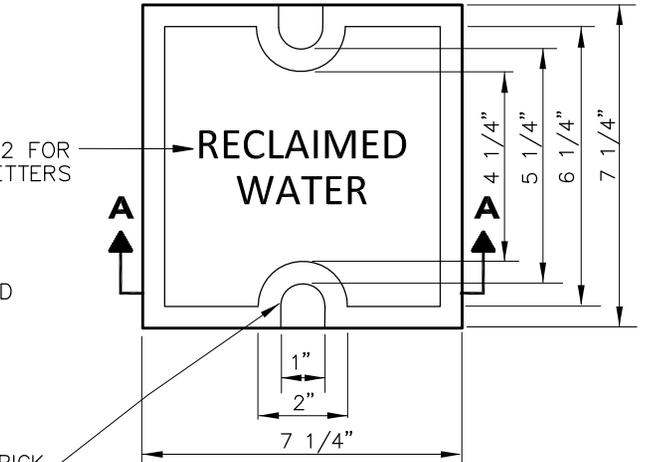




C.I. FRAME AND COVER

NOTES:

1. CASTING TO CONFORM TO SECT. 787.
2. LETTERS ON COVER TO BE AS FOLLOWS, PER AGENCY REQUIREMENTS:
3/4" HIGH "RECLAIMED WATER" OR 1/2" HIGH "NONPOTABLE WATER".
LETTERS TO BE RAISED 1/16".
3. *f* INDICATES MACHINE FINISHED SURFACE.
4. VALVE BOX SHALL HAVE A ROUND BOTTOM TO ACCOMMODATE RISER PIPE.

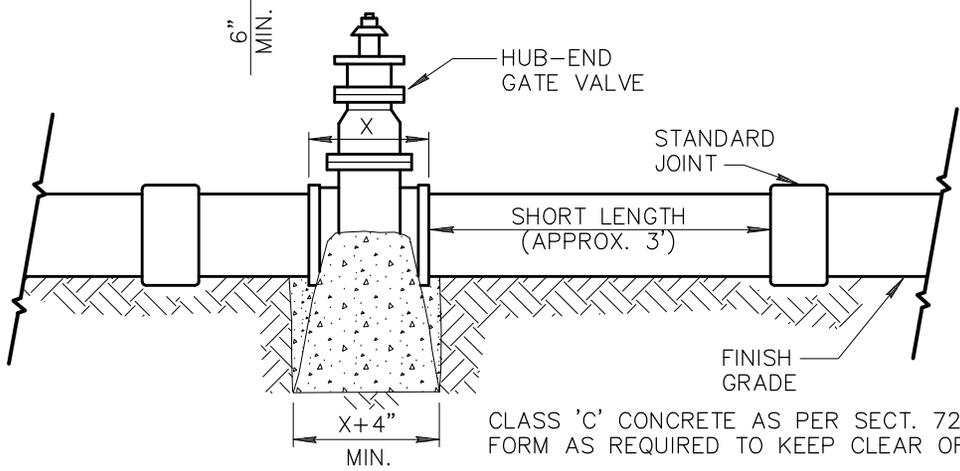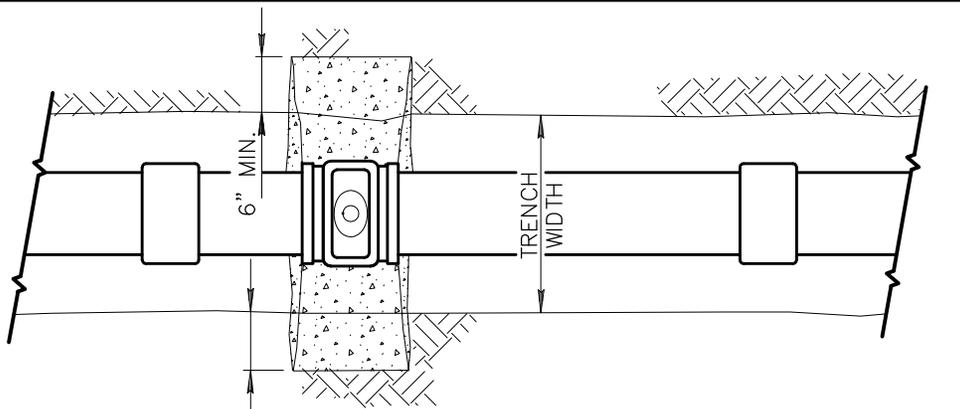


CLASS 'C' CONCRETE AS PER SECT. 725
FORM AS REQUIRED TO KEEP CLEAR OF JOINTS.

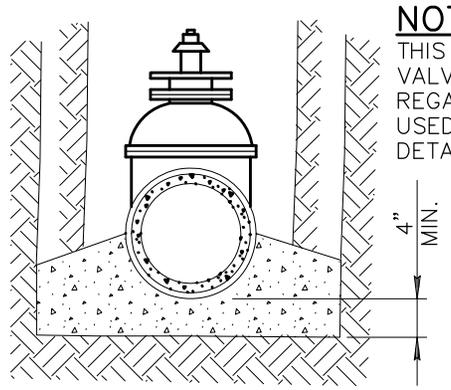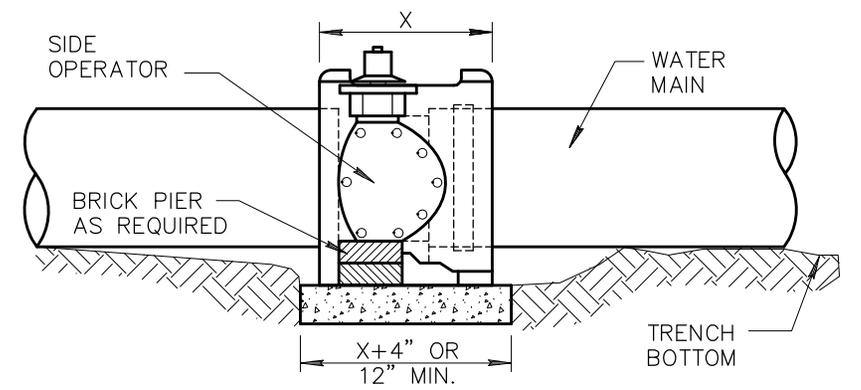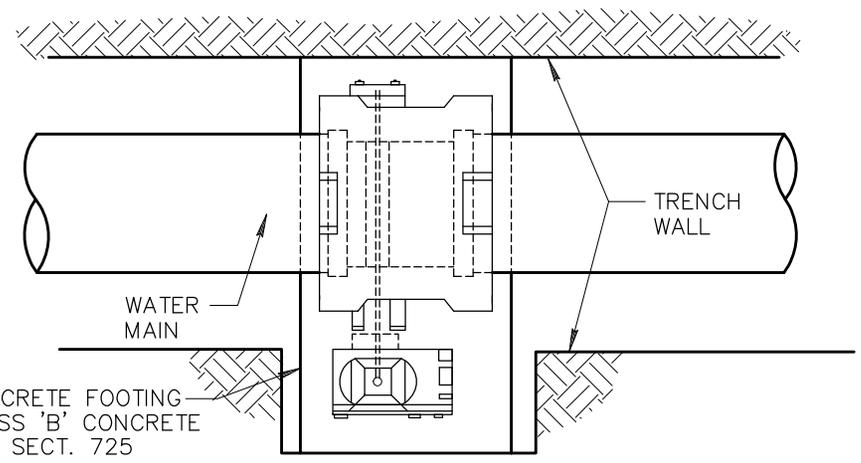

WATER GATE VALVE

NOTE:
THIS DETAIL COVERS WATER GATE VALVES, 4" TO 12" INCLUSIVE REGARDLESS OF TYPE OF PIPE USED. LARGER LINES TO BE DETAILED ON PLANS.

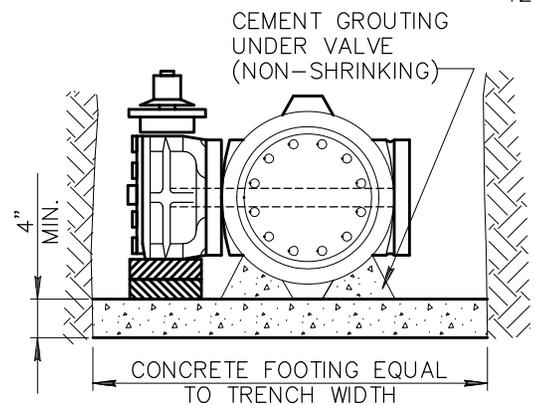

BUTTERFLY VALVE

- NOTES:**
1. THIS DETAIL COVERS BUTTERFLY VALVE INSTALLATION, 3" TO 12" INCLUSIVE, REGARDLESS OF TYPE OF PIPE OR JOINT USED. LARGER LINES TO BE DETAILED ON PLANS.
 2. VALVE BOX AND COVER REQUIRED PER DETAILS 270 AND 391.

DETAIL NO.
301




STANDARD DETAIL
ENGLISH

**BLOCKING FOR
WATER GATE AND BUTTERFLY VALVES**

REVISED
01-01-1998

DETAIL NO.
301

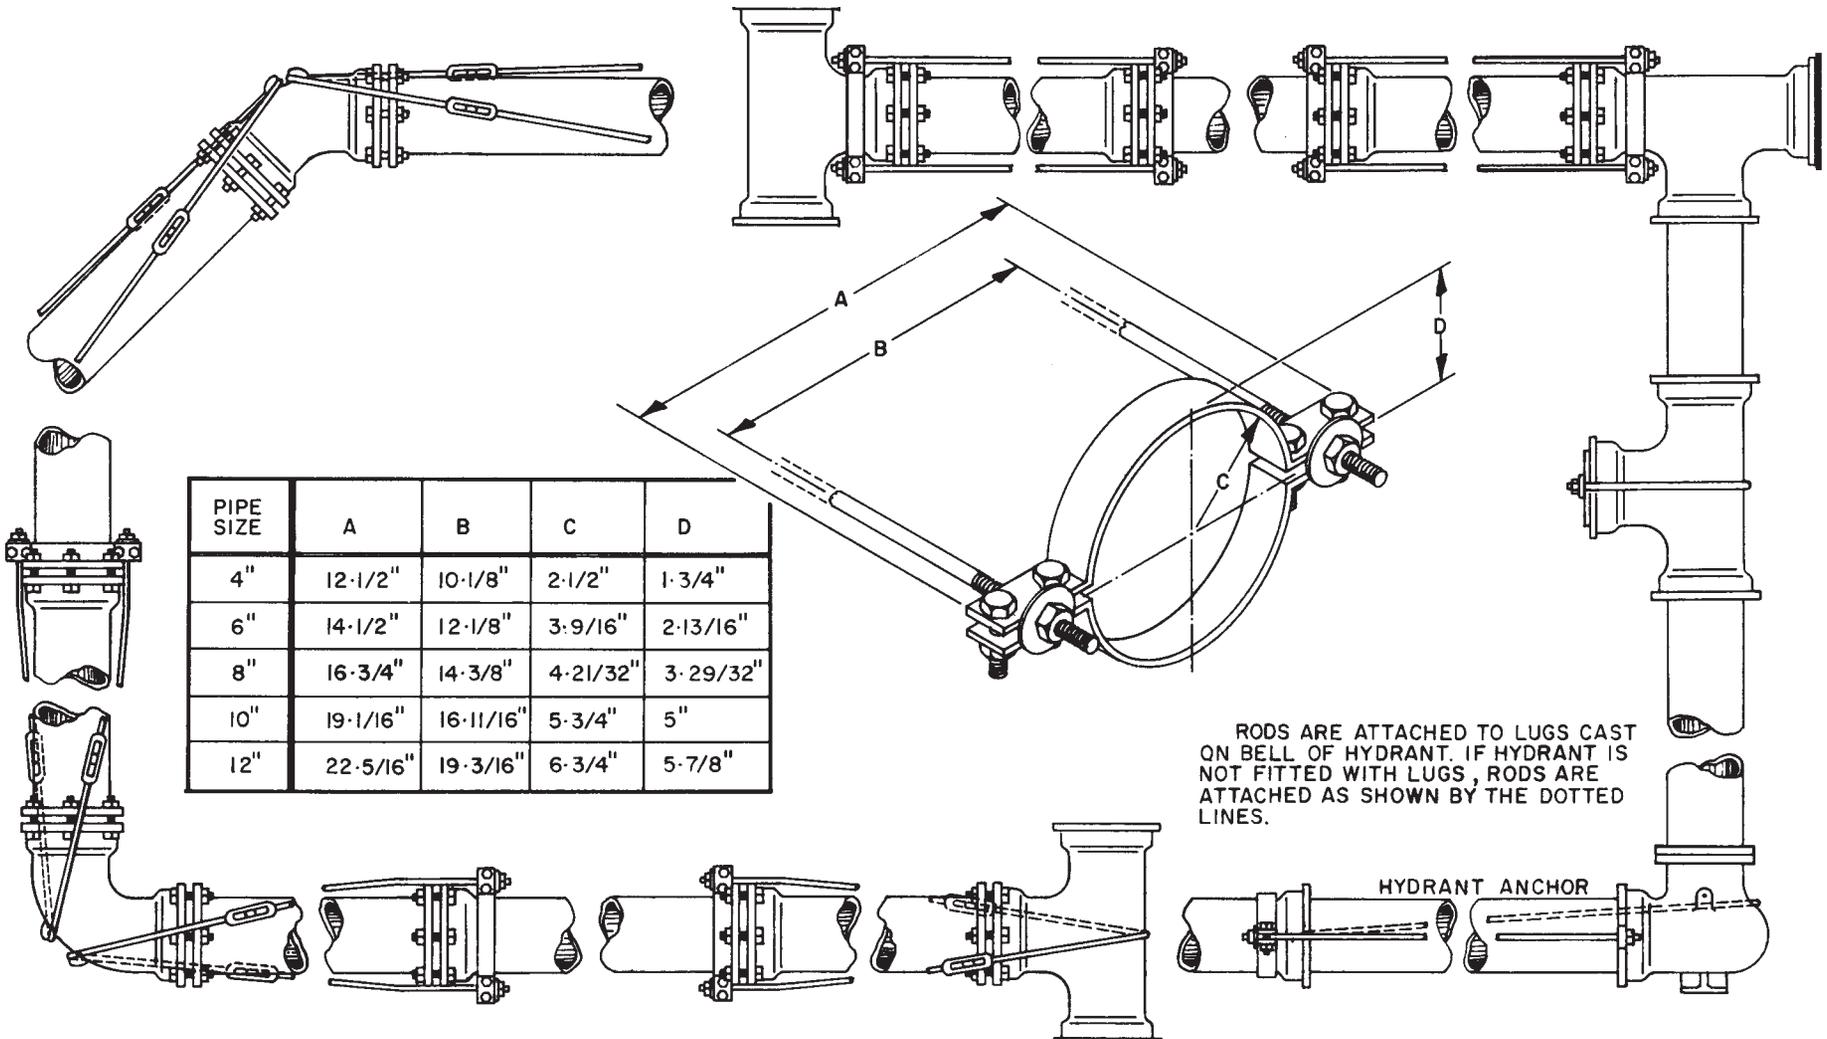

PIPE SIZE	A	B	C	D
4"	12-1/2"	10-1/8"	2-1/2"	1-3/4"
6"	14-1/2"	12-1/8"	3-9/16"	2-13/16"
8"	16-3/4"	14-3/8"	4-21/32"	3-29/32"
10"	19-1/16"	16-11/16"	5-3/4"	5"
12"	22-5/16"	19-3/16"	6-3/4"	5-7/8"

RODS ARE ATTACHED TO LUGS CAST ON BELL OF HYDRANT. IF HYDRANT IS NOT FITTED WITH LUGS, RODS ARE ATTACHED AS SHOWN BY THE DOTTED LINES.

HYDRANT ANCHOR

THIS DETAIL IS FOR USE ONLY ON UNDERGROUND INSTALLATIONS WHERE THE USE OF CONCRETE THRUST BLOCKING PER DETAIL 380 CANNOT BE USED BECAUSE OF OBSTRUCTIONS, OR REQUIREMENTS OF THE SPECIFICATIONS...

- * CLAMPS SHALL BE 1/2 BY 2 INCHES FOR PIPE 4 AND 6 INCHES IN DIAMETER; 5/8 BY 2-1/2 INCHES FOR PIPE 8 AND 10 INCHES; 5/8 BY 3 INCHES FOR PIPE 12 INCHES. BOLT HOLES SHALL BE 1/16 INCH IN DIAMETER LARGER THAN BOLTS.
- * RODS SHALL BE 3/4 INCHES IN DIAMETER FOR PIPES 4,6 AND 8 INCHES IN DIAMETER; 7/8 INCHES FOR PIPE 10 INCHES AND 1 INCH IN DIAMETER FOR PIPE 12 INCHES.
- * BOLTS SHALL BE 5/8 INCHES IN DIAMETER FOR PIPE 4, 6 AND 8 INCHES IN DIAMETER; 3/4 INCHES FOR PIPE 10 INCHES AND 7/8 INCHES IN DIAMETER FOR PIPE 12 INCHES
- * WASHERS MAY BE CAST IRON OR STEEL, ROUND OR SQUARE, DIMENSIONS FOR CAST IRON WASHERS ARE 5/8 BY 3 INCHES FOR PIPE 4, 6, 8 AND 10 INCHES IN DIAMETER AND 3/4 BY 3-1/2 INCHES FOR PIPE 12 INCHES. DIMENSIONS FOR STEEL WASHERS ARE 1/2 BY 3 INCHES FOR PIPE 4, 6, 8 AND 10 INCHES IN DIAMETER AND 1/2 BY 3-1/2 INCHES FOR PIPE 12 INCHES IN DIAMETER. HOLES SHALL BE 1/8 INCH LARGER THAN THE RODS.

FOR PIPE LARGER THAN 12 INCHES IN DIAMETER, RESTRAINT DETAILS SHALL BE SUBMITTED FOR APPROVAL PRIOR TO INSTALLATION.

1. ALL TIE RODS, ROD COUPLINGS, TURNBUCKLES, BOLTS AND NUTS FOR THESE JOINTS SHALL BE OF CARBON STEEL EQUIVALENT TO A.S.T.M. A-307, GRADE B, WITH CADMIUM PLATING IN ACCORDANCE WITH A.S.T.M. A-165. EXCEPT THAT THE MIN. THICKNESS OF THE PLATING SHALL BE .0002 OF AN INCH. CADMIUM PLATED BOLTS SHALL HAVE CLASS 2A THREADS AND THE NUTS, ROD COUPLINGS AND TURNBUCKLES SHALL HAVE 2B THREADS.
2. HIGH STRENGTH, HEAT TREATED CAST IRON TEE-HEAD BOLTS WITH HEXAGON NUTS, ALL IN ACCORDANCE WITH THE STRENGTH REQUIREMENTS OF A.W.W.A. C-111, MAY BE USED IN LIEU OF THE CADMIUM PLATED BOLTS AND NUTS.
3. THE SKETCHES IN THIS SERIES OF FIGURES SHOW ACCEPTABLE METHODS OF PROVIDING ANCHORAGE. THERE IS NO PARTICULAR SIGNIFICANCE TO BE ATTACHED TO WHETHER THE SKETCH SHOWS A BELL AND SPIGOT JOINT OR A STANDARD MECHANICAL JOINT. THE ANCHORING PROCEDURE ILLUSTRATED APPLIES IN MOST CASES TO EITHER TYPE OF JOINT. IN SOME CASES, DIMENSIONS OF THE PARTICULAR PIPE OR HUB AND SPACE AVAILABLE FOR WORKING AROUND THE PARTICULAR JOINT WILL INFLUENCE THE CHOICE OF METHODS USED.
4. IN CERTAIN ASSEMBLIES OF RODS AND CLAMPS SHOWN, RODS RUN FROM A LUG ON THE FITTING (OR A CLAMP BEHIND THE HUB OF A BELL) TO A CLAMP AGAINST A FACE OF A BELL. NOTE THAT THIS ARRANGEMENT ANCHORS ONLY ONE JOINT. THE STABILITY OF THE JOINT WHERE THE CLAMP IS AGAINST THE FACE OF THE BELL DEPENDS ON HAVING SOIL ABOVE A RELATIVELY LONG PIECE OF PIPE ON BOTH SIDES OF THE JOINT. CONSEQUENTLY, IF THE DISTANCE BETWEEN THE FIRST AND SECOND JOINTS IS LESS THAN 12 FEET, THE SECOND JOINT SHOWN SHALL BE ANCHORED BY A CLAMP BEHIND THE HUB OF THE BELL AND RODS TO A CLAMP AT THE FACE OF THE NEXT BELL.
5. COATING TYPE: A.H.D. ASPHALTIC PRIMER 719(A). - ALL EXPOSED METAL.

SHEET 2 OF 2

DETAIL NO.

302-2



STANDARD DETAIL
ENGLISH


JOINT RESTRAINT WITH TIE RODS

REVISED


01-01-1998

DETAIL NO.

302-2

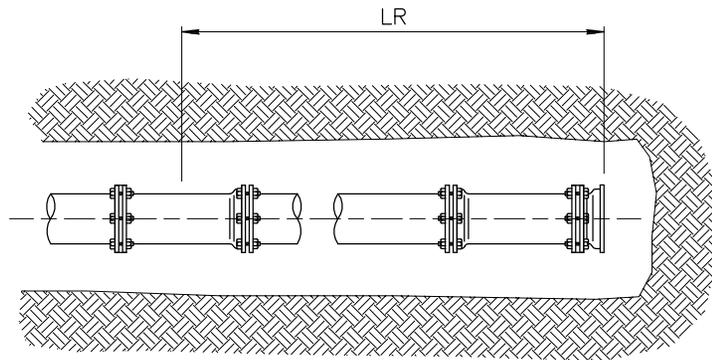


DEAD ENDS

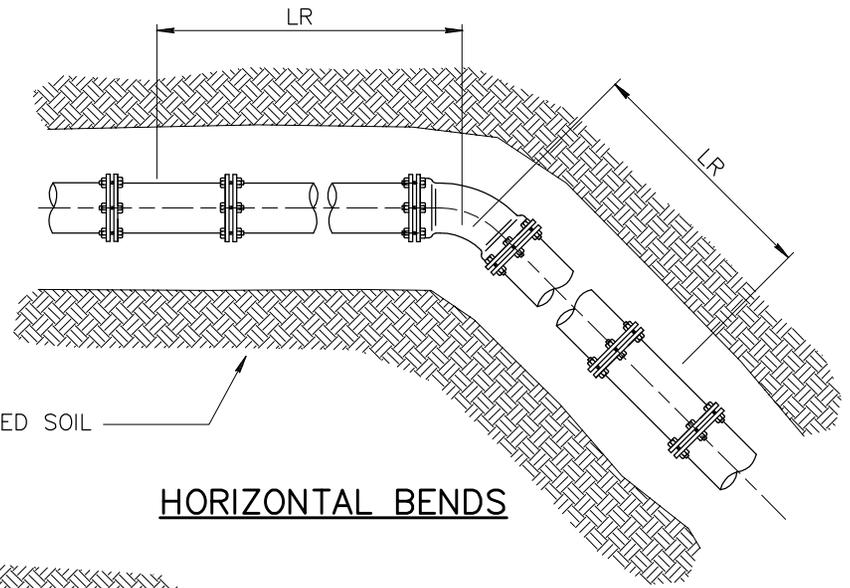


HORIZONTAL BENDS


LRN = SHORTEST LENGTH OF PIPE RESTRAINED TO THE RUN OF THE TEE FITTING (BOTH SIDES OF TEE).

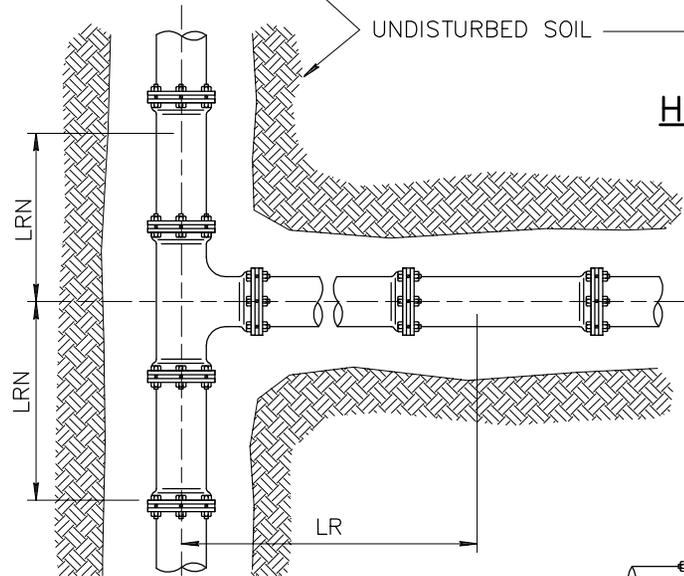

TEES

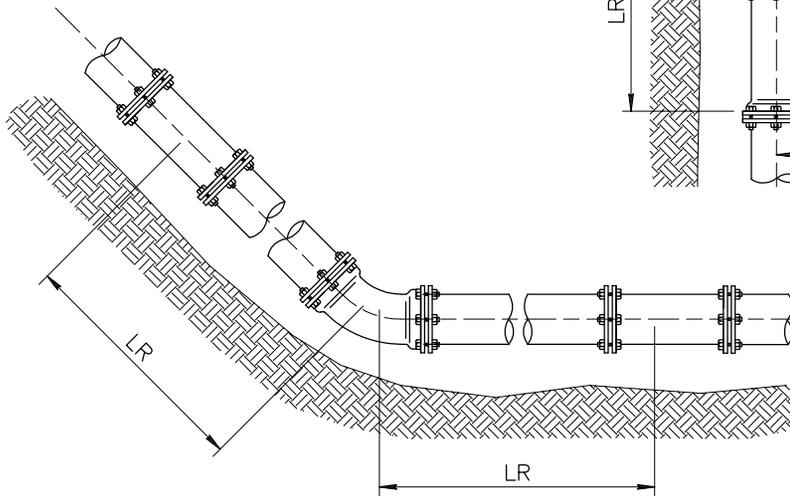

VERTICAL UP BEND

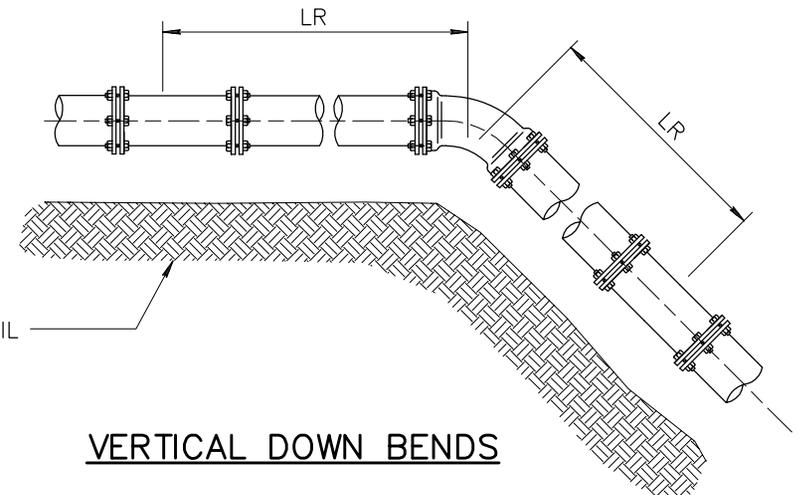

VERTICAL DOWN BENDS

UNDISTURBED SOIL

UNDISTURBED SOIL

RESTRAINED LENGTHS, LR, FOR DUCTILE IRON PIPE												
NOMINAL PIPE SIZE INCHES	HORIZONTAL BENDS			TEES		VERTICAL OFFSETS						DEAD ENDS
						90° BEND FITTINGS		45° BEND FITTINGS		22-1/2° BEND FITTINGS		
	90°	45°	22-1/2°	LRN=0'	LRN=10'	DOWN BEND	UP BEND	DOWN BEND	UP BEND	DOWN BEND	UP BEND	
4	18	7	4	30	8	31	18	13	7	6	3	31
6	25	10	5	43	20	44	25	18	10	9	5	44
8	32	13	6	56	34	58	32	24	13	11	6	58
10	38	16	8	68	45	69	38	29	16	14	8	69
12	45	19	9	80	57	81	45	34	19	16	9	81
14	51	21	10	91	68	92	51	38	21	18	10	92
16	57	24	11	103	79	104	57	43	24	21	11	104
18	62	26	12	113	90	115	62	48	26	23	12	115
20	68	28	14	125	100	126	68	52	28	25	14	126
24	79	33	16	145	121	147	79	61	33	29	16	147

RESTRAINED LENGTHS, LR, FOR DUCTILE IRON PIPE WITH POLYETHYLENE WRAP												
NOMINAL PIPE SIZE INCHES	HORIZONTAL BENDS			TEES		VERTICAL OFFSETS						DEAD ENDS
						90° BEND FITTINGS		45° BEND FITTINGS		22-1/2° BEND FITTINGS		
	90°	45°	22-1/2°	LRN=0'	LRN=10'	DOWN BEND	UP BEND	DOWN BEND	UP BEND	DOWN BEND	UP BEND	
4	26	11	5	69	18	72	26	30	11	14	5	72
6	36	15	7	99	47	102	36	42	15	20	7	102
8	47	19	9	130	78	133	47	55	19	26	9	133
10	56	23	11	157	103	159	56	66	23	32	11	159
12	65	27	13	185	131	187	65	77	27	37	13	187
14	74	31	15	211	156	214	74	89	31	42	15	214
16	82	34	16	238	183	241	82	100	34	48	16	241
18	90	37	18	263	207	266	90	110	38	53	18	266
20	98	41	20	289	233	292	98	121	41	58	20	292
24	113	47	22	337	280	340	113	141	47	68	22	340

NOTES:

1. ALL JOINTS WITHIN THE SPECIFIED LENGTH LR MUST BE RESTRAINED.
ALL LENGTHS ARE GIVEN IN FEET.
2. THE MAXIMUM TEST PRESSURE SHALL NOT EXCEED 200 PSI
3. THE MINIMUM DEPTH OF BURY SHALL BE 3' TO TOP OF PIPE.
4. RESTRAINED LENGTHS MAY BE REDUCED WHEN SUPPORTED BY ENGINEERING CALCULATIONS.

DETAIL NO.

303-2



STANDARD DETAIL
ENGLISH




**JOINT RESTRAINT FOR DUCTILE IRON AND
POLYETHYLENE WRAPPED DUCTILE IRON WATER PIPES**

REVISED

01-01-1998



DETAIL NO.

303-2

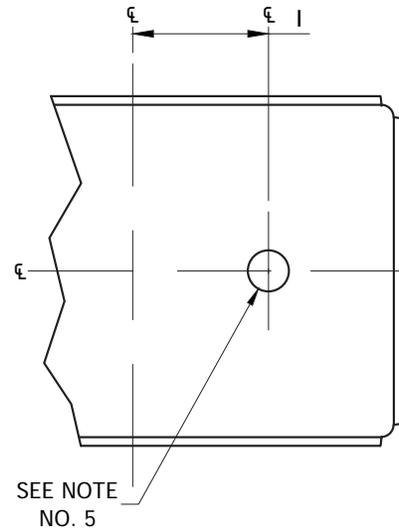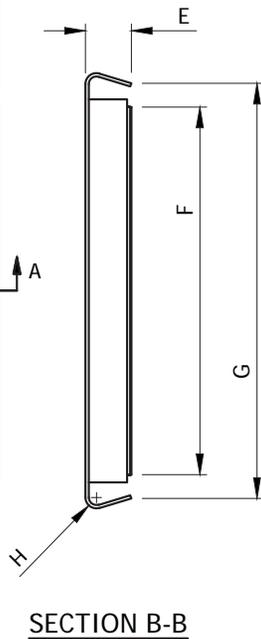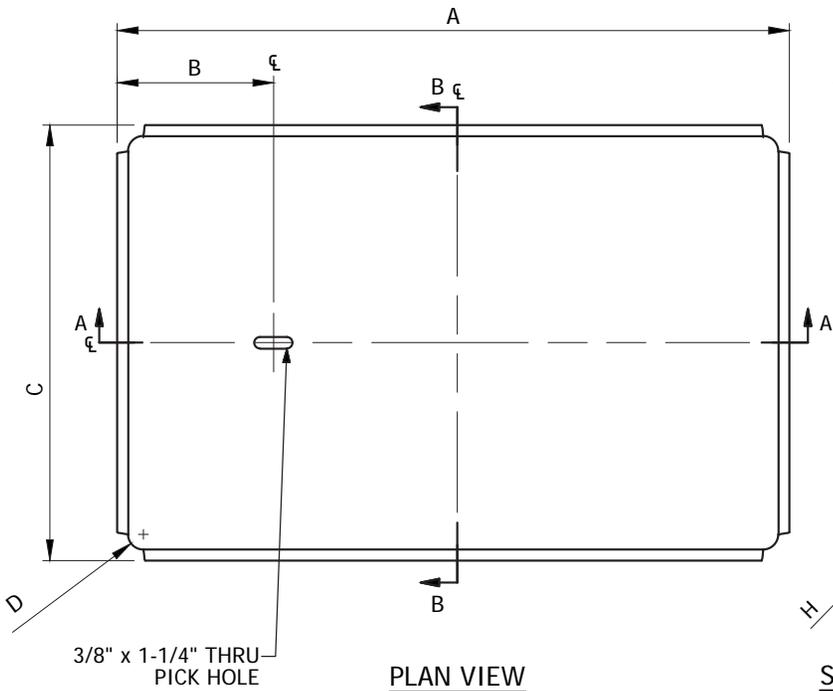

NOTES:

1. STEEL COVER MATERIAL TO BE PER ASTM A786
2. POTABLE WATER COVER PAINTED BLACK AND RECLAIMED WATER COVER PAINTED PANTONE PURPLE 512. USE OIL BASED PAINT ALKALI RESIN PER SECTION 790
3. DIMENSIONS SHOWN SHALL NOT VARY MORE THAN A 1/16 OF AN INCH
4. ALL COVERS MADE OUT OF DIAMOND CHECKER PLATE
5. STANDARD AUTOMATIC METER READER (AMR) HOLE 2" PER AGENCY OR STANDARD SPECIFICATION
6. REFER TO DETAIL 320 FOR VERTICAL LOAD RATING

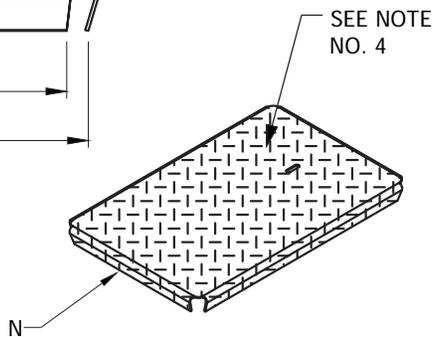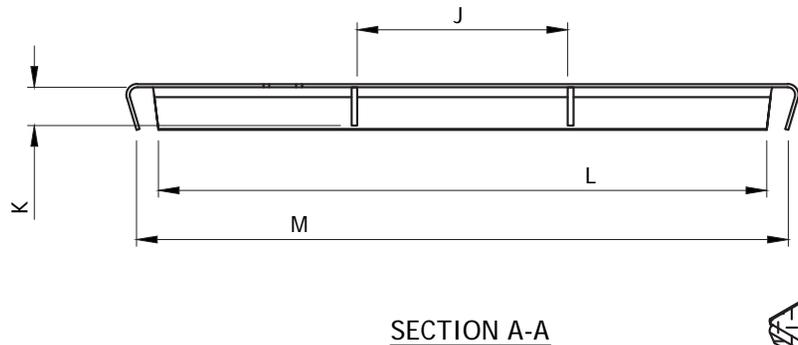

STEEL WATER METER COVER DIMENSIONS				
DIMS	COVER NUMBER			
	1	2	3	4
A	15-3/4"	21-7/8"	26"	30-3/8"
B	3-7/8"	4-1/2"	2-1/8"	4-5/8"
C	9"	14"	15"	19-1/2"
D	1/2"	1/2"	1/2"	1/2"
E	1-1/2"	1-1/2"	2-1/4"	1-1/2"
F	7-1/8"	12"	13"	17-3/4"
G	8-1/4"	13-12"	14-1/8"	19-1/4"
H	1/8"	1/4"	1/8"	1/4"
I	3-3/4"	6-5/8"	9"	12-1/4"
J	NA	6-7/8"	8-1/2"	7-3/8"
K	NA	1-1/4"	1-1/4"	1-1/4"
L	13-7/8"	19-7/8"	24"	28-1/8"
M	15"	21-1/4"	25-1/8"	29-3/4"
N	14 GAUGE	12 GAUGE	12 GAUGE	12 GAUGE

DETAIL NO.
310



STANDARD DETAIL
ENGLISH



STEEL WATER METER BOX COVER

REVISED
01-01-2017

DETAIL NO.
310

NOTES:

1. POTABLE WATER COVER TINTED GRAY AND RECLAIMED WATER COVER TINTED PANTONE PURPLE 512
2. DIMENSIONS SHOWN SHALL NOT VARY MORE THAN A 1/16 OF AN INCH
3. ACCEPTABLE ALTERNATIVES INCLUDE "SHEET MOLDED COMPOUND" (SMC), AND "BULK MOLDED COMPOUND" (BMC). PLASTICS ARE NOT ACCEPTABLE MATERIALS
4. SLOTTED AUTOMATIC METER READING (AMR) HOLE PER AGENCY OR STANDARD SPECIFICATION
5. MARKING PER AGENCY AND/OR UTILITY
6. REFER TO DETAIL 320 FOR VERTICAL LOAD RATING

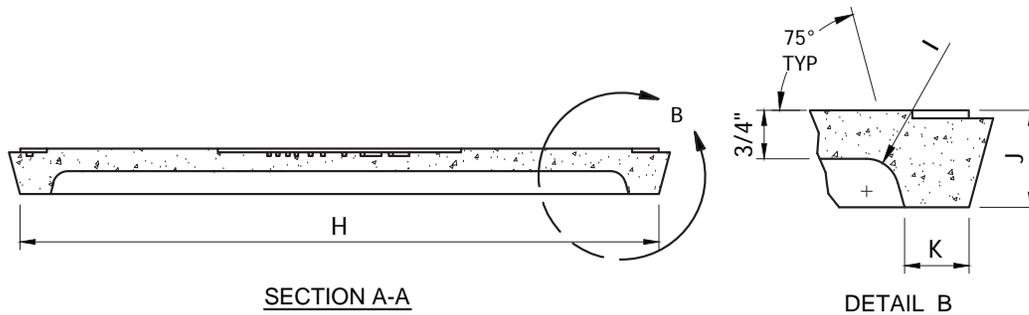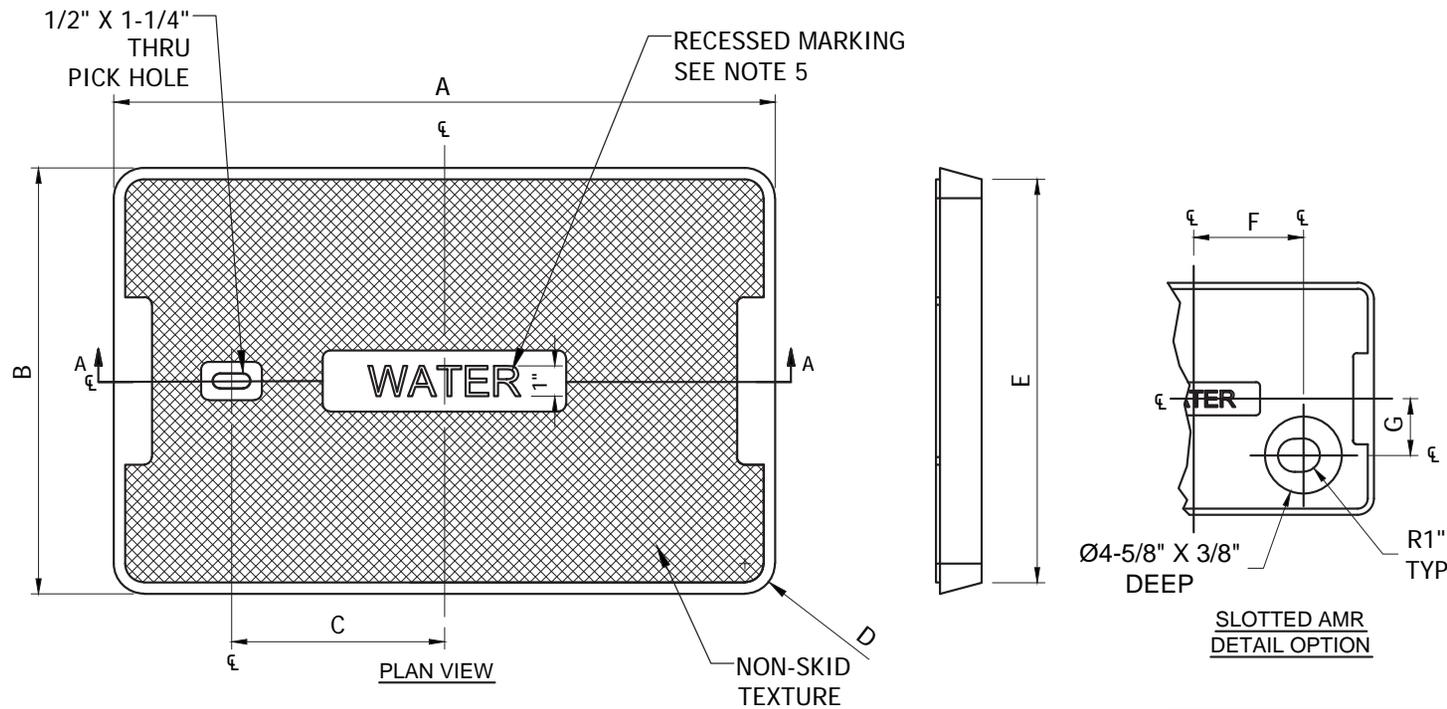

POLYMER CONCRETE COVER DIMENSIONS				
DIMS	COVER NUMBER			
	1	2	3	4
A	15-3/4"	21-7/8"	26"	30-3/8"
B	9"	14"	15"	19-1/2"
C	5"	7"	9"	10"
D	3/4"	1"	3/8"	3/8"
E	8-1/2"	13-1/4"	14-1/8"	19"
F	4-3/8"	6-5/8"	8"	10-3/4"
G	3/4"	3-3/8"	3-3/4"	6-1/4"
H	15-3/8"	21"	25-1/8"	29-1/2"
I	3/8"	1/2"	1"	1/4"
J	1-1/2"	1-1/2"	2-1/4"	1-1/2"
K	3/4"	1"	1"	1"

DETAIL NO.
315




STANDARD DETAIL
ENGLISH


**POLYMER CONCRETE
WATER METER BOX COVER**

REVISED
01-01-2017

DETAIL NO.
315

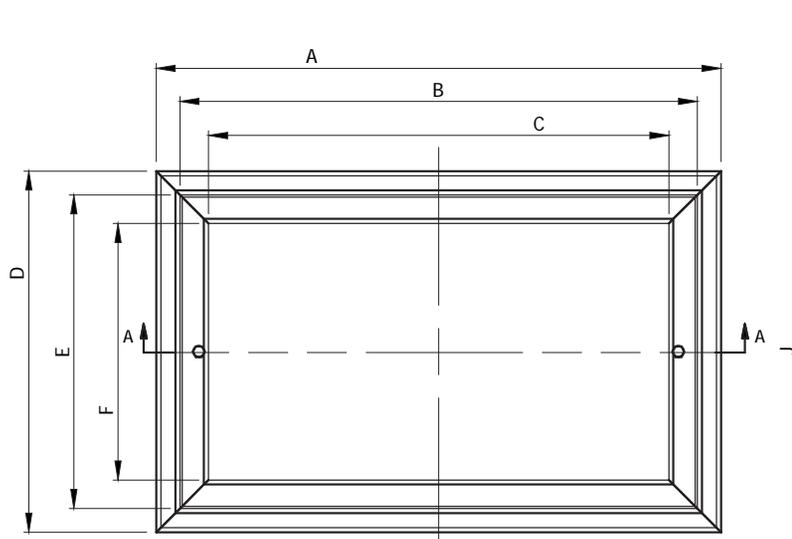

BOX ONLY - TOP VIEW

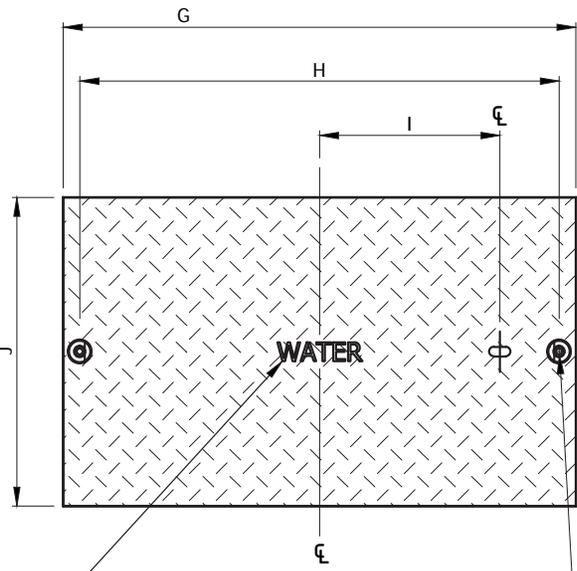


COVER ONLY - TOP VIEW

SEE NOTE NO. 3


Ø1-1/8" X 1/2" DEEP
Ø5/16" THRU
2 PLACES

NOTES:

1. COVER AND BOX COMBINATION SHALL MEET AASHTO H20
2. DIMENSIONS SHOWN SHALL NOT VARY MORE THAN A 1/16 OF AN INCH
3. MARKINGS PER AGENCY AND/OR UTILITY
4. STACKABLE EXTENSION AVAILABLE TO ACHIEVE DEPTH DESIRED
5. GROUND BELOW THE BOX TO BE COMPACTED TO 95% MAXIMUM DENSITY
6. 6" CONCRETE COLLAR IF REQUIRED BY AGENCY

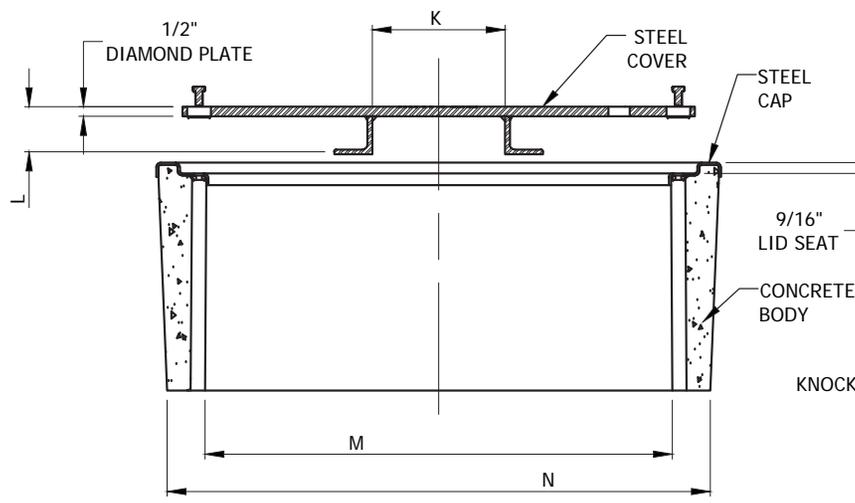


SECTION A-A BODY AND COVER

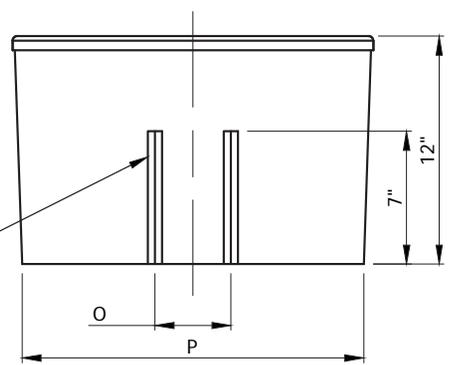


END VIEW


DIMS	BOX NUMBER	
	(1324)	(1730)
A	29-3/4"	36-7/8"
B	27-1/4"	33-1/2"
C	24-1/4"	30"
D	19"	23-3/4"
E	16-1/2"	20-1/2"
F	13-1/2"	17"
G	27"	33-1/4"
H	25-1/4"	31-1/4"
I	9-1/2"	12-1/8"
J	16-1/4"	20-1/4"
K	7"	10-3/4"
L	2-1/2"	3-1/2"
M	24-5/8"	30-5/8"
N	28-5/8"	35-7/8"
O	4"	5-3/4"
P	18"	22-5/8"

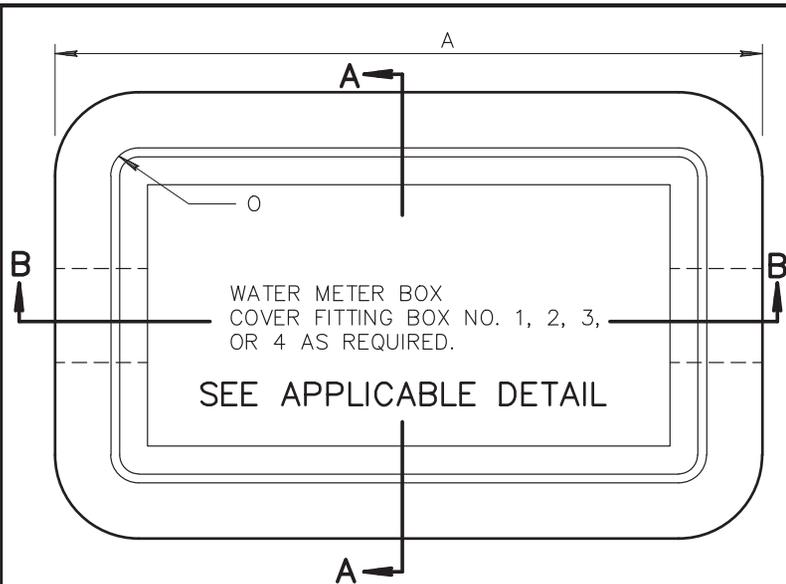

PLAN VIEW

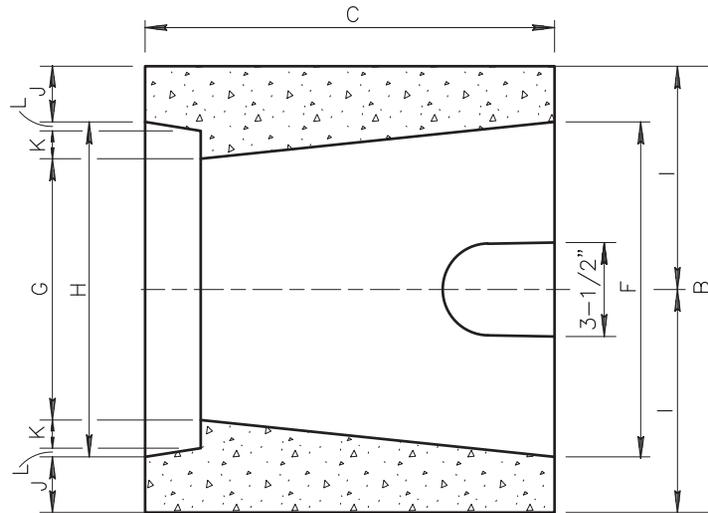

SECTION A-A

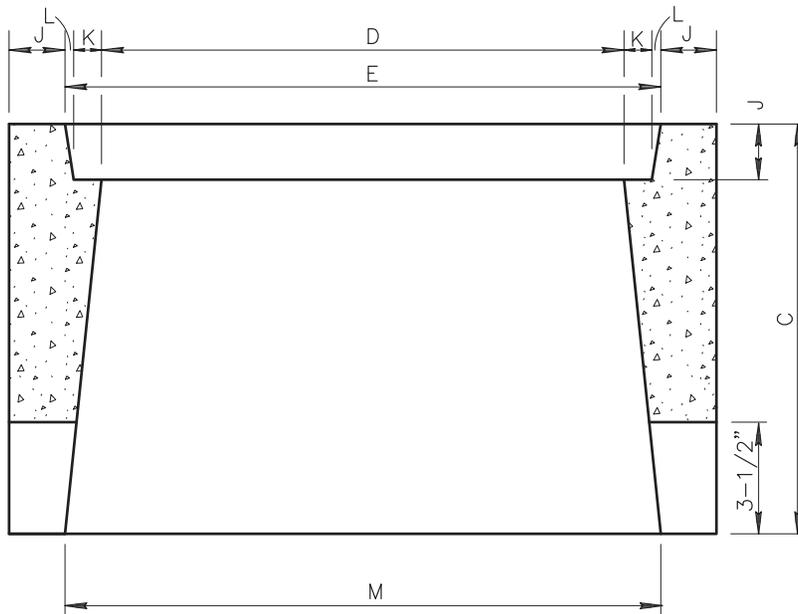

SECTION B-B

METER BOX DIMENSIONS				
DIMS	BOX NUMBER			
	1	2	3	4
A	18-1/2"	25"	28-3/8"	33-1/8"
B	11-3/4"	17-1/4"	17-5/8"	22-3/8"
C	12"	12"	12"	12"
D	14"	20"	24"	27-3/4"
E	16"	22-1/8"	26-1/4"	30-5/8"
F	9-1/4"	14-1/2"	15-1/8"	19-3/4"
G	7"	12-1/2"	13"	17"
H	9-1/4"	14-1/4"	15-1/4"	19-3/4"
I	5-7/8"	8-5/8"	8-7/8"	11-1/8"
J	1-1/2"	1-1/2"	2-1/4"	1-1/2"
K	3/4"	1/2"	3/4"	5/8"
L	1/4"	1/2"	1/2"	5/8"
M	16"	21-7/8"	26"	30-1/2"
O	1/2"	1/2"	1/2"	5/8"
	5/8" OR 3/4" METER	1" METER	1-1/2" METER	2" METER

NOTES:

1. THE METER BOXES SHALL CONFORM TO DIMENSIONS AS SHOWN AND SHALL NOT VARY MORE THAN A 1/16 OF AN INCH
2. THE METER BOXES SHALL BE MADE OF CLASS 'AA' CONCRETE PER SECT. 725. ACCEPTABLE ALTERNATIVE MATERIALS INCLUDE "POLYMER CONCRETE", "SHEET MOLDED COMPOUND" (SMC), "BULK MOLDED COMPOUND" (BMC), AND POLYETHYLENE WITH POLYMER CONCRETE FRAME
3. MINIMUM VERTICAL LOAD RATING PER TIER 5 ANSI/SCTE77 TESTING STANDARD FOR GRADE LEVEL ENCLOSURES AND COVERS
4. FOR LOAD REQUIREMENTS ABOVE 5,000 POUNDS USE DETAIL 319, TRAFFIC RATED BOX AND COVER

DETAIL NO.
320




STANDARD DETAIL
ENGLISH

**NON TRAFFIC RATED
WATER METER BOXES**


REVISED
01-01-2017

DETAIL NO.
320

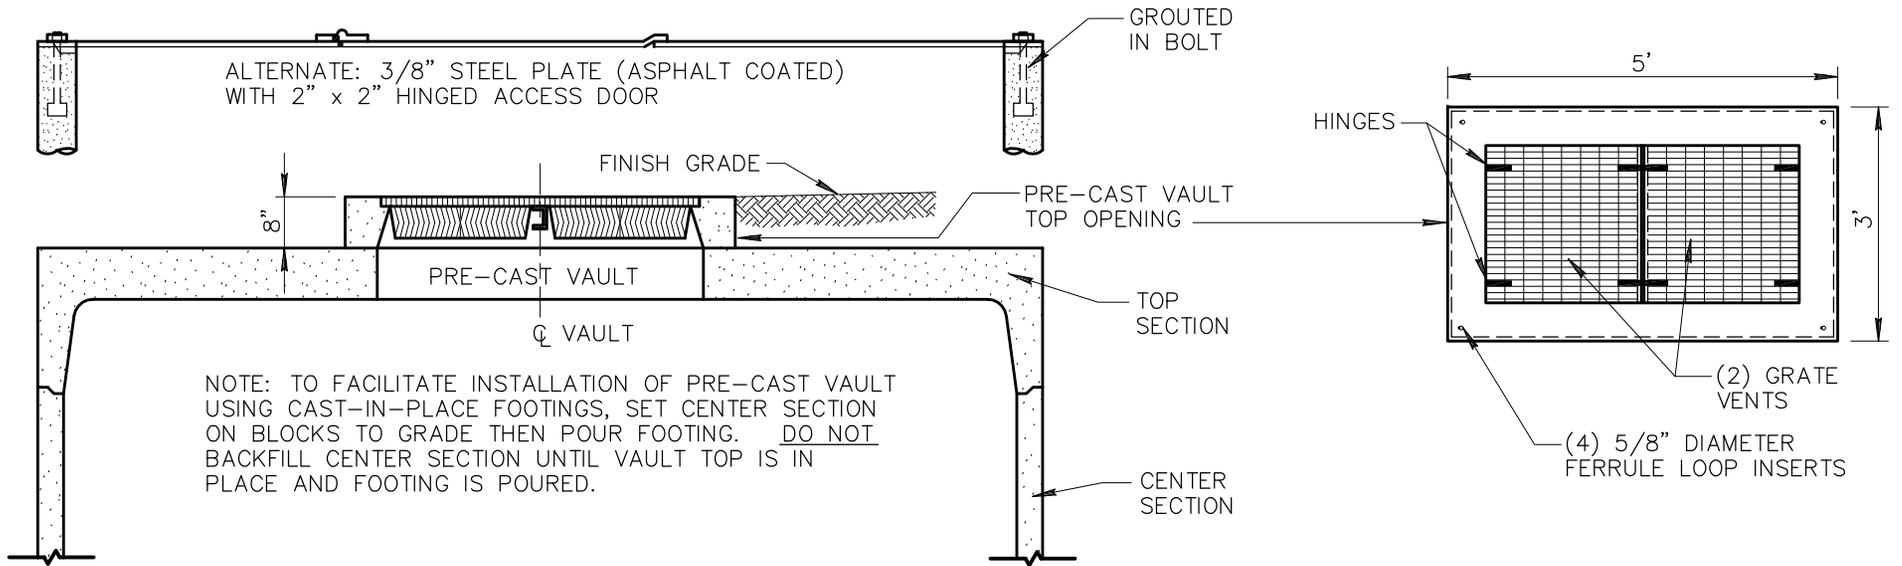



PRE-CAST VAULT SECTION

NOTE: PRECAST REINFORCED VAULT SECTIONS SHALL BE CONSTRUCTED IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATIONS AND DETAILS AS APPROVED BY ENGINEER.

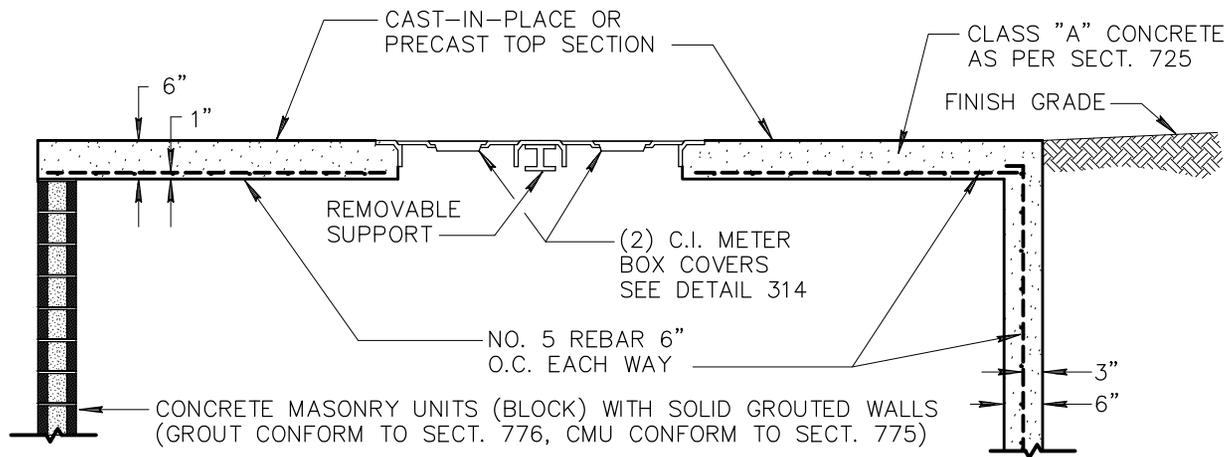

BLOCK MASONRY MAY BE USED IN LIEU OF CAST-IN-PLACE VAULT WALLS, NO. 4 REBAR IN EVERY OTHER CORE.

CAST-IN-PLACE VAULT SECTION

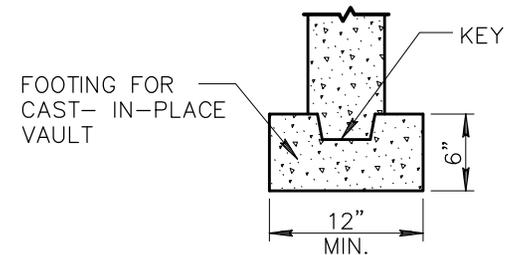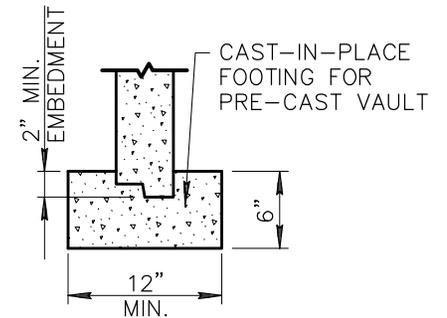

DETAIL NO.

321



STANDARD DETAIL
ENGLISH


STANDARD WATER METER VAULT

REVISED

01-01-1998


DETAIL NO.

321

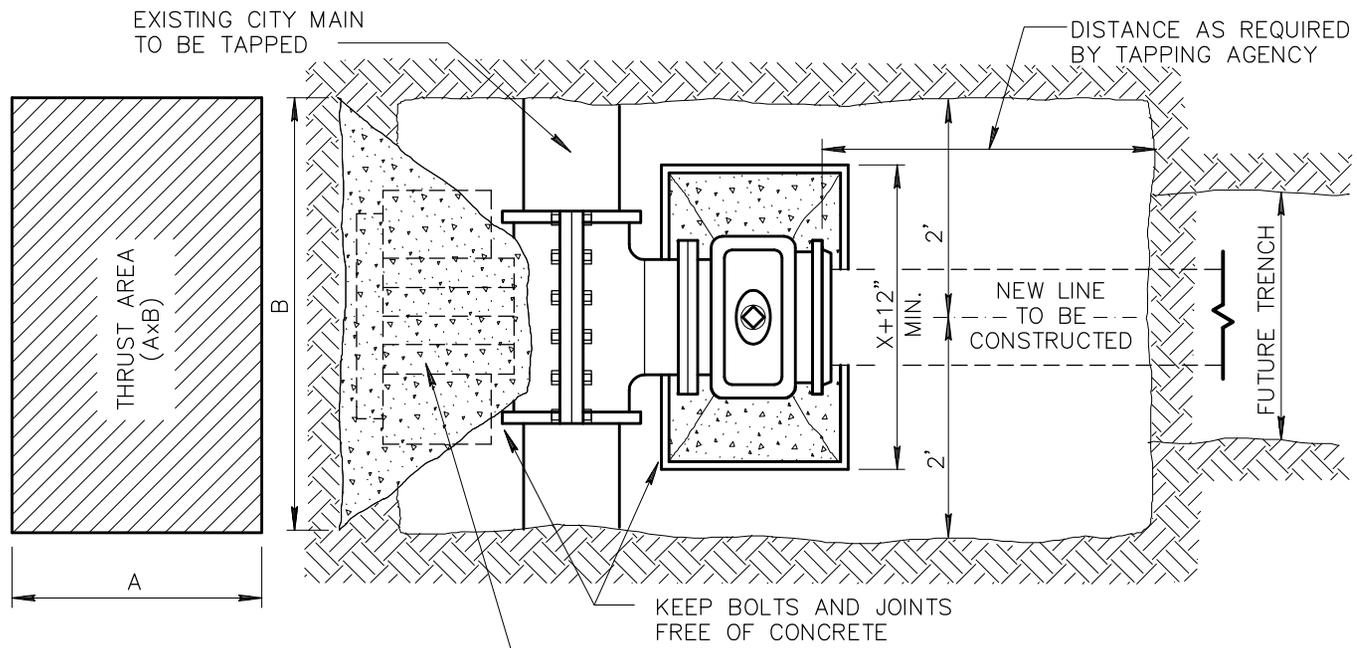

PLAN

OPTIONAL BLOCKING - 2" x 8" x 12" SOLID CONCRETE MASONRY UNITS AS INDICATED.

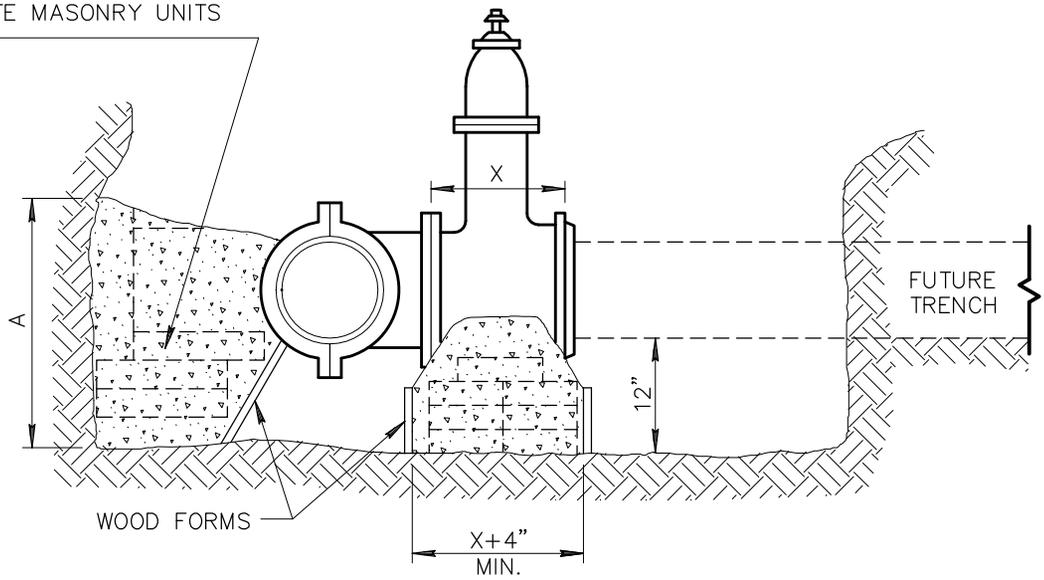


ELEVATION

NOTES:

1. TAPPING SLEEVE TO BE PLACED A MINIMUM OF 18" FROM ANY BELL COUPLING, VALVE, FITTING OR OTHER OBSTRUCTION
2. CONTRACTOR SHALL EXCAVATE AS SHOWN AND SHALL SET TAPPING SLEEVE AND VALVE AND TIGHTEN ALL BOLTS PRIOR TO THE PRESSURE TEST.
3. ALL TAPPING SLEEVES AND VALVES MUST BE PRESSURE TESTED PRIOR TO BLOCKING OR TAPPING. THE TEST MUST BE WITNESSED AND APPROVED BY THE INSPECTOR.
4. BLOCKS ARE TO EXTEND TO UNDISTURBED GROUND AND BE INSTALLED BEFORE THE TAP IS MADE. ALL FLANGE BOLTS SHALL BE FREE AND CLEAR OF CONCRETE.
5. CONCRETE THRUST BLOCKS SHALL BE CLASS 'B' PER SECT. 725. NORMALLY, CURE TIME FOR CONCRETE IS 24 HOURS BEFORE BACKFILLING.
6. TAPS SHALL BE MADE BY CITY CREWS AT PREVAILING RATES OR BY APPROVED CONTRACTORS WHEN ALLOWED BY AGENCY.
7. THIS DETAIL COVERS TAPPING SLEEVES 4" THROUGH 16" IN SIZE ON DUCTILE IRON, CAST IRON AND ASBESTOS CEMENT PIPE. ANY OTHER SIZE OR TYPE OF PIPE WILL REQUIRE A SEPARATE SUBMITTAL AND APPROVAL BY THE ENGINEER.

SIZE OF PIPE BEING CONNECTED	MINIMUM THRUST AREA REQUIRED EQUALS (AxB) (SQUARE FEET)
4" AND LESS	3
6"	4
8"	6
10"	9
12"	13
16"	23

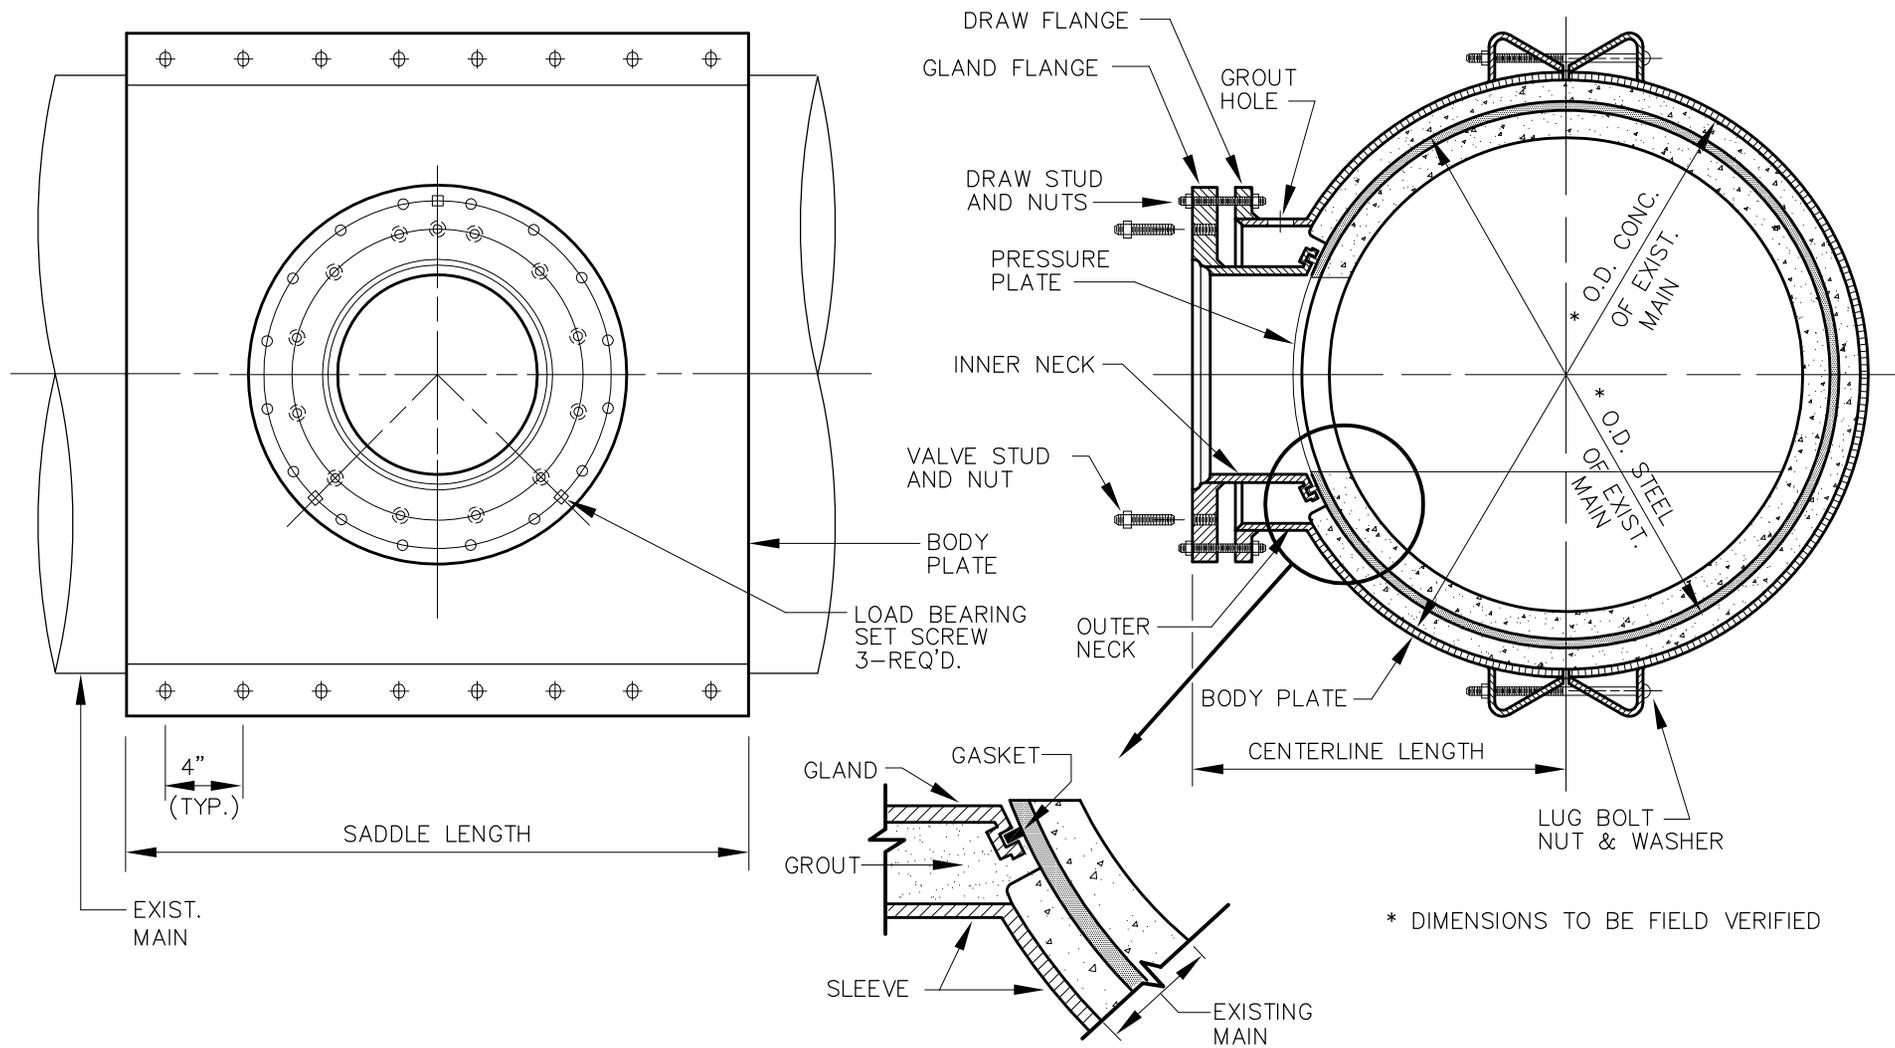

DETAIL NO.

342



STANDARD DETAIL
ENGLISH


CONCRETE PRESSURE PIPE
TAPPING SLEEVE

REVISED


01-01-1998

DETAIL NO.

342

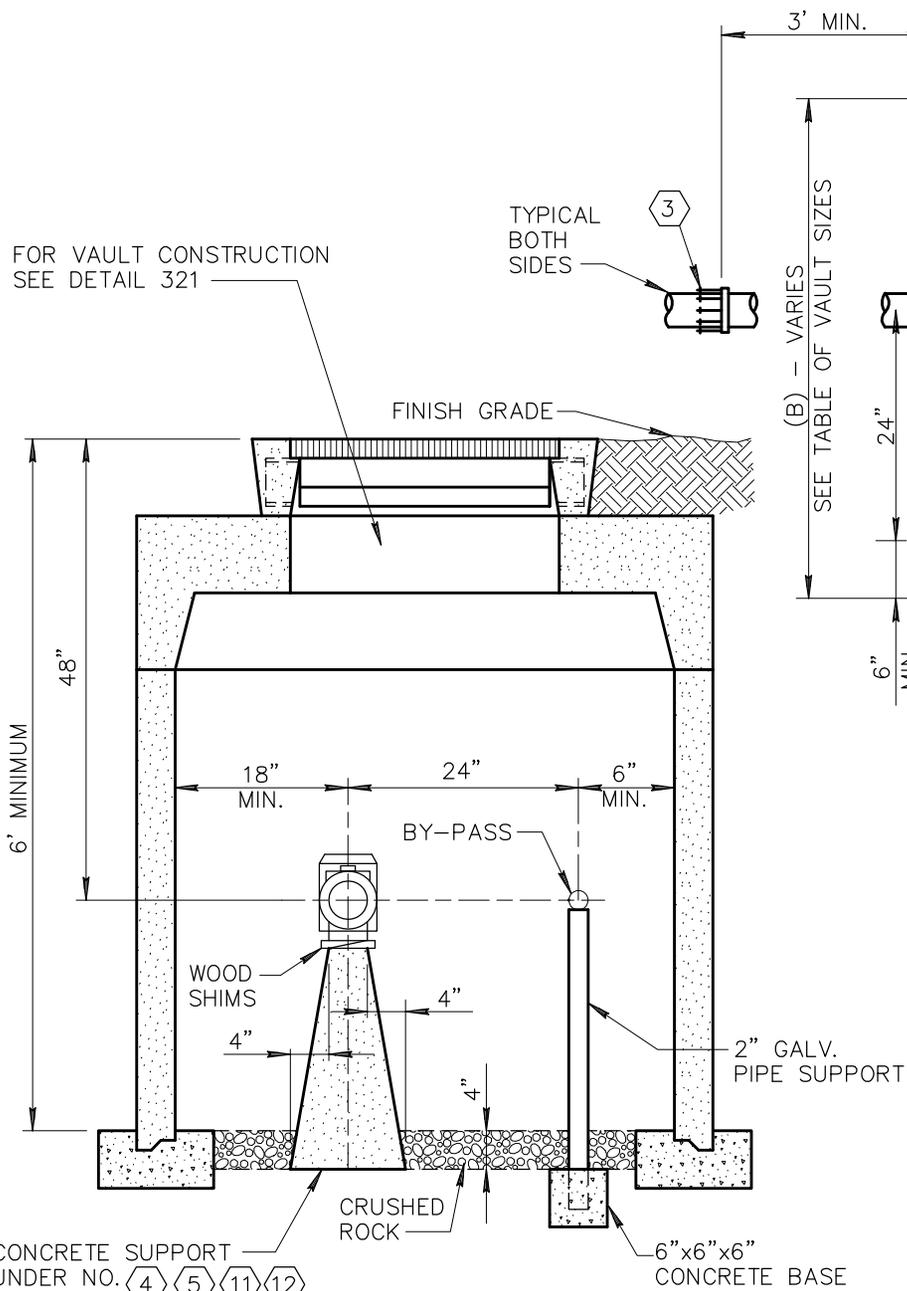

SECTION A-A

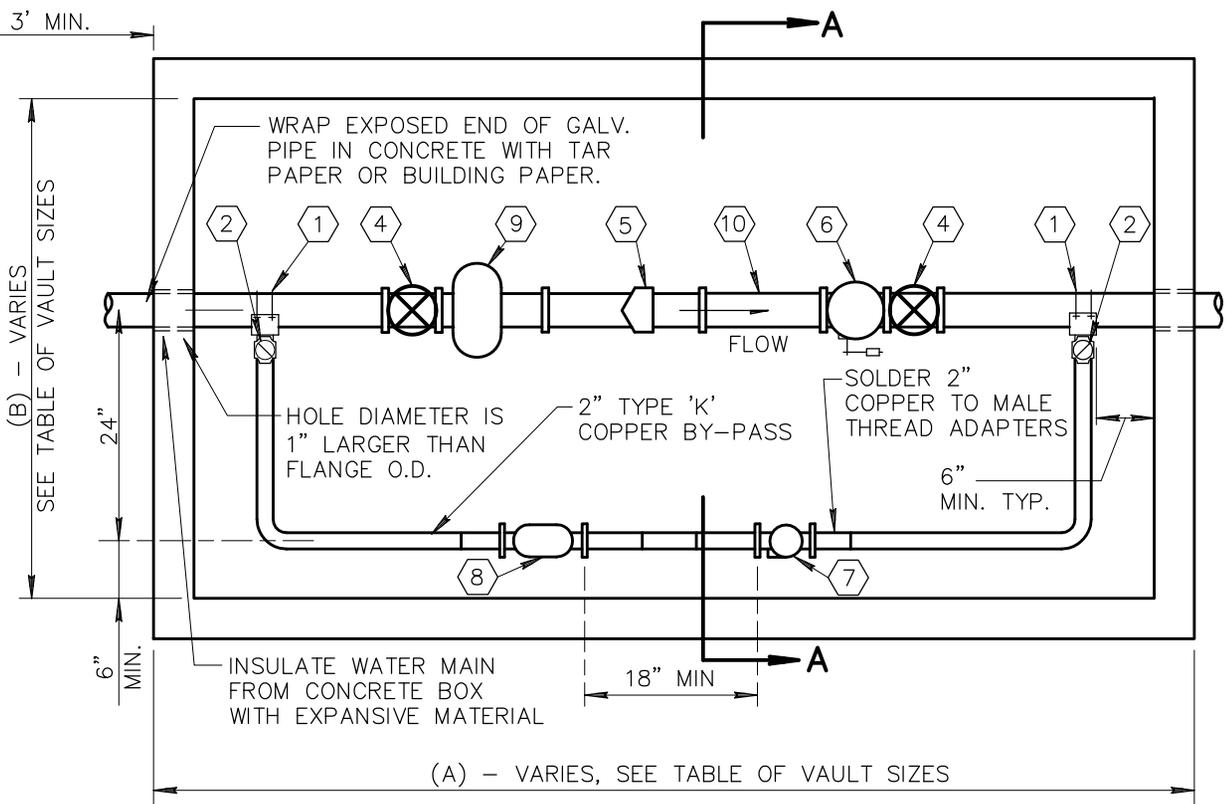

VAULT DIMENSION DETAILS			
A.C.P. SIZE	3"	4"	6"
(A)	8'-4"	10'-6"	12'-0"
(B)	4'-4"	5'-0"	5'-0"

NOTE: METER VAULTS MAY BE EITHER CONCRETE MASONRY UNITS OR CAST-IN-PLACE OR PRE-CAST CONCRETE, SEE DETAIL 321 FOR VAULT CONSTRUCTION.

DETAIL NO.
345-1




STANDARD DETAIL
ENGLISH

3", 4", 6" WATER METER

REVISED
01-01-1998

DETAIL NO.
345-1

FOR VAULT CONSTRUCTION
SEE DETAIL 321

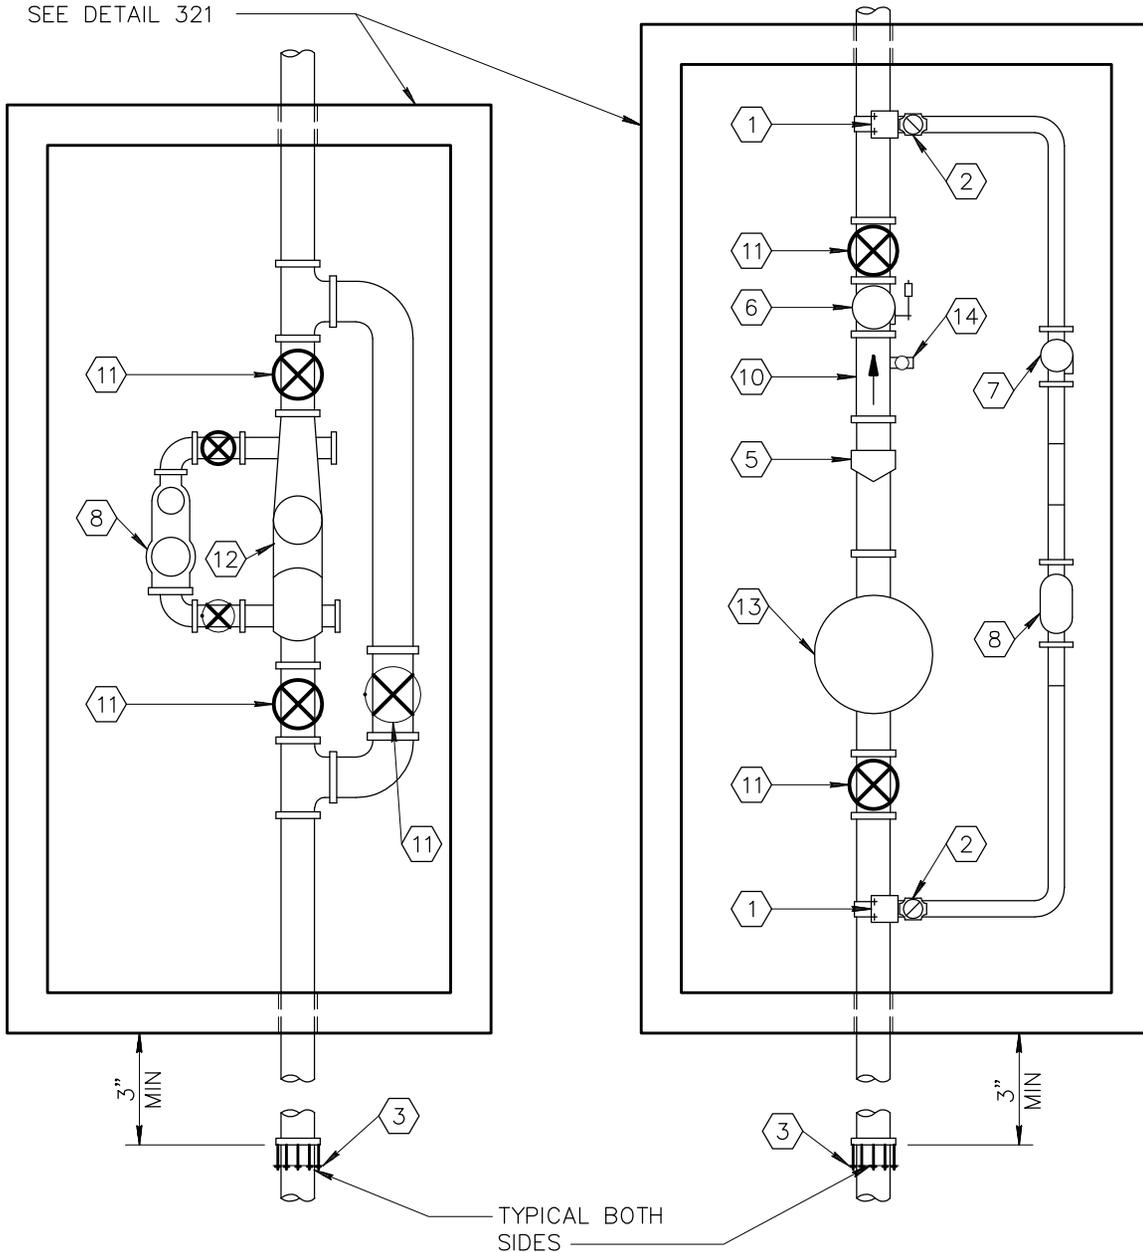

LEGEND

- ① DOUBLE STRAP ALL BRONZE SERVICE SADDLES.
- ② CORP. STOP, 2" (BALL TYPE).
- ③ ADAPTER, FLANGED, TO MECH. JOINT FOR A.C.P.
- ④ GATE VALVE, FLANGED, WITH HAND WHEEL, OPEN LEFT.
- ⑤ TURBOMETER: ROCKWELL SERIES 'W' OR HERSEY SERIES 'M.H.R.' OR NEPTUNE TRIDENT TURBINE.
- ⑥ FLANGED SWING CHECK VALVE WITH EXTERNAL LEVER AND WEIGHT.
- ⑦ 2" BRONZE CHECK VALVE.
- ⑧ 2" TURBOMETER: ROCKWELL 'W-160' OR HERSEY 'M.H.R.' OR NEPTUNE TRIDENT TURBINE.
- ⑨ STRAINER (3", 4", 6") AVAILABLE FROM METER MANUFACTURER, INSTALL ONLY WHEN 'TURBO' IS USED.
- ⑩ FLANGED SPOOL (3 PIPE DIAMETERS IN LENGTH).
- ⑪ O.S.&Y. GATE VALVE, FLANGED WITH HAND WHEEL OPEN LEFT, AND RISING STEM.
- ⑫ TURBOMETER U.L. APPROVED: ROCKWELL W-5000 DR. OR W-2000 DR. OR HERSEY F.M.-C.T. OR NEPTUNE TURBINE-F.S.-U.L.
- ⑬ 6" OR 10" STRAINER, U.L. APPROVED.
- ⑭ 2" THREADED OUTLET AND GATE VALVE.

NOTES

1. FOR LARGER METERS, SPECIAL VAULT DESIGN IS REQUIRED.
2. USE OF REMOTE READING DEVICE AT OPTION OF UTILTY.
3. CERTAIN AGENCIES AND/OR UTILITIES PREFER TO CONSTRUCT VAULT, CONTACT AGENCY INVOLVED PRIOR TO VAULT CONSTRUCTION.

DETAIL NO.
345-2




STANDARD DETAIL
ENGLISH

**4", 6" WATER METER
WITH ON-SITE FIRE HYDRANTS**

REVISED
01-01-1998

DETAIL NO.
345-2

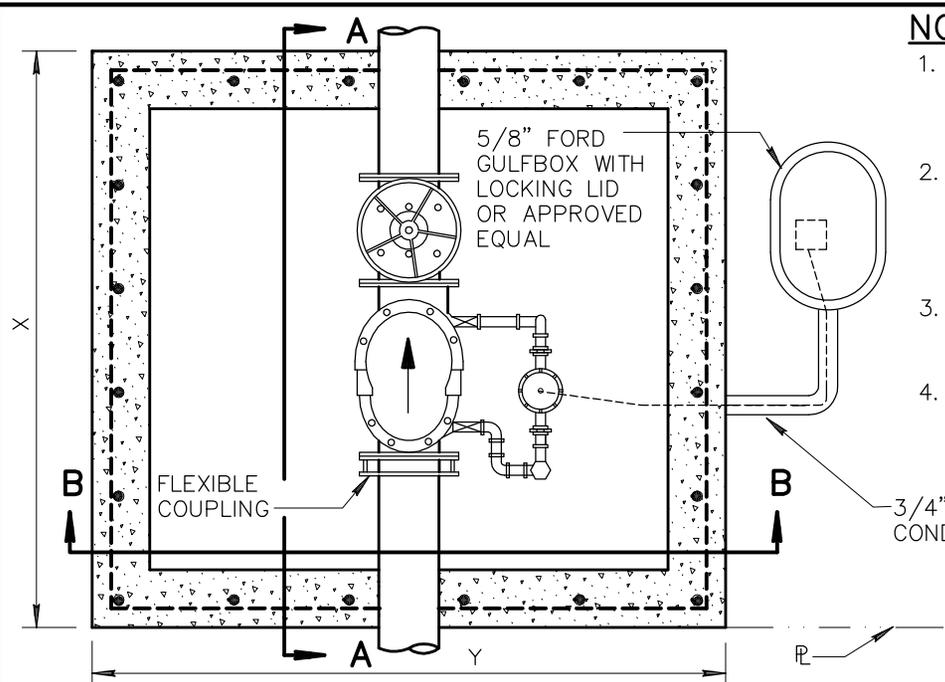


NOTES:


1. FIRELINE FROM CITY MAIN TO PROPERTY LINE SHALL BE CONSTRUCTED OF CAST IRON PIPE.
2. REINFORCING TO BE 1/2" DIAMETER REBAR ON 6" CENTERS EACH WAY ON TOP AND 12" CENTERS EACH WAY ON THE SIDES.
3. COVERS TO CONSIST OF TWO METER BOX COVERS DET. 314.
4. BY-PASS METER TO BE ACCORDING TO GOVERNING AGENCY.
5. CHECK VALVE TO BE GLOBE MODEL "A" GRINNEL, HERSEY MODEL D.C., VIKING MODEL "A" OR APPROVED EQUAL.
6. VAULT SHALL BE CONSTRUCTED IN OWNERS PROPERTY AGAINST THE FRONT PROPERTY LINE OR ANOTHER APPROVED LOCATION. WALLS AND FENCES SHALL NOT OBSTRUCT ACCESS.
7. CITY CONTROL VALVE TO BE REQUIRED AT MAIN.
8. PARTS OF PIPE TO BE EMBEDDED IN CONC. SHALL BE WRAPPED WITH 30 LB ASPHALT ROOFING FELT.
9. REMOTE READING DEVICE SHALL BE OF SELF GENERATING ELECTRICAL TYPE. HYDRAULIC OR MECHANICAL DRIVE REGISTERS WILL NOT BE ACCEPTABLE.
10. CONCRETE TO BE CLASS 'B' PER SECT. 725.

DIA. OF PIPE	X	Y	Z	BY-PASS METER SIZE	A
4"	60"	66"	49"	5/8" x 3/4"	30"
6"	66"	72"	49"	5/8" x 3/4"	30"
8"	72"	72"	58"	1"	36"
10"	78"	72"	69"	1-1/2"	36"

PLAN VIEW-BELOW COVER

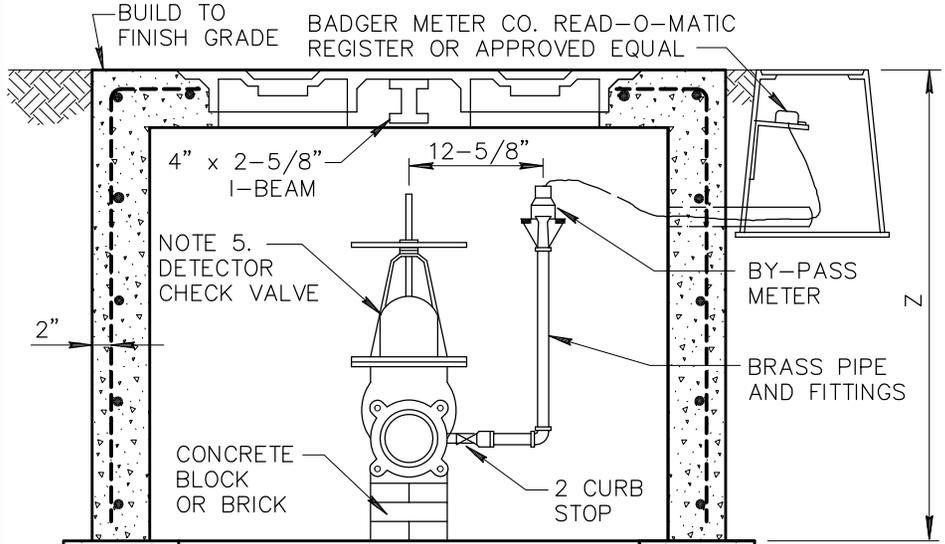

SECTION B-B

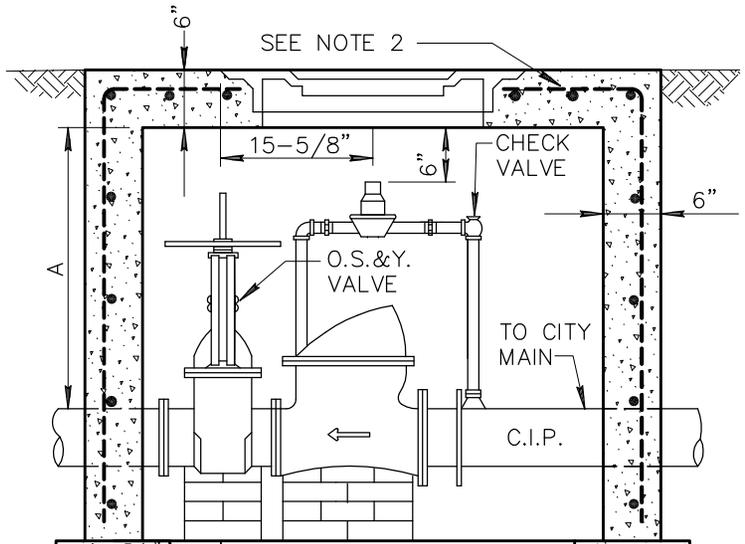

SECTION A-A

DETAIL NO.

346



STANDARD DETAIL
ENGLISH


FIRE LINE DETECTOR CHECK VAULT

REVISED

01-01-1998

DETAIL NO.

346

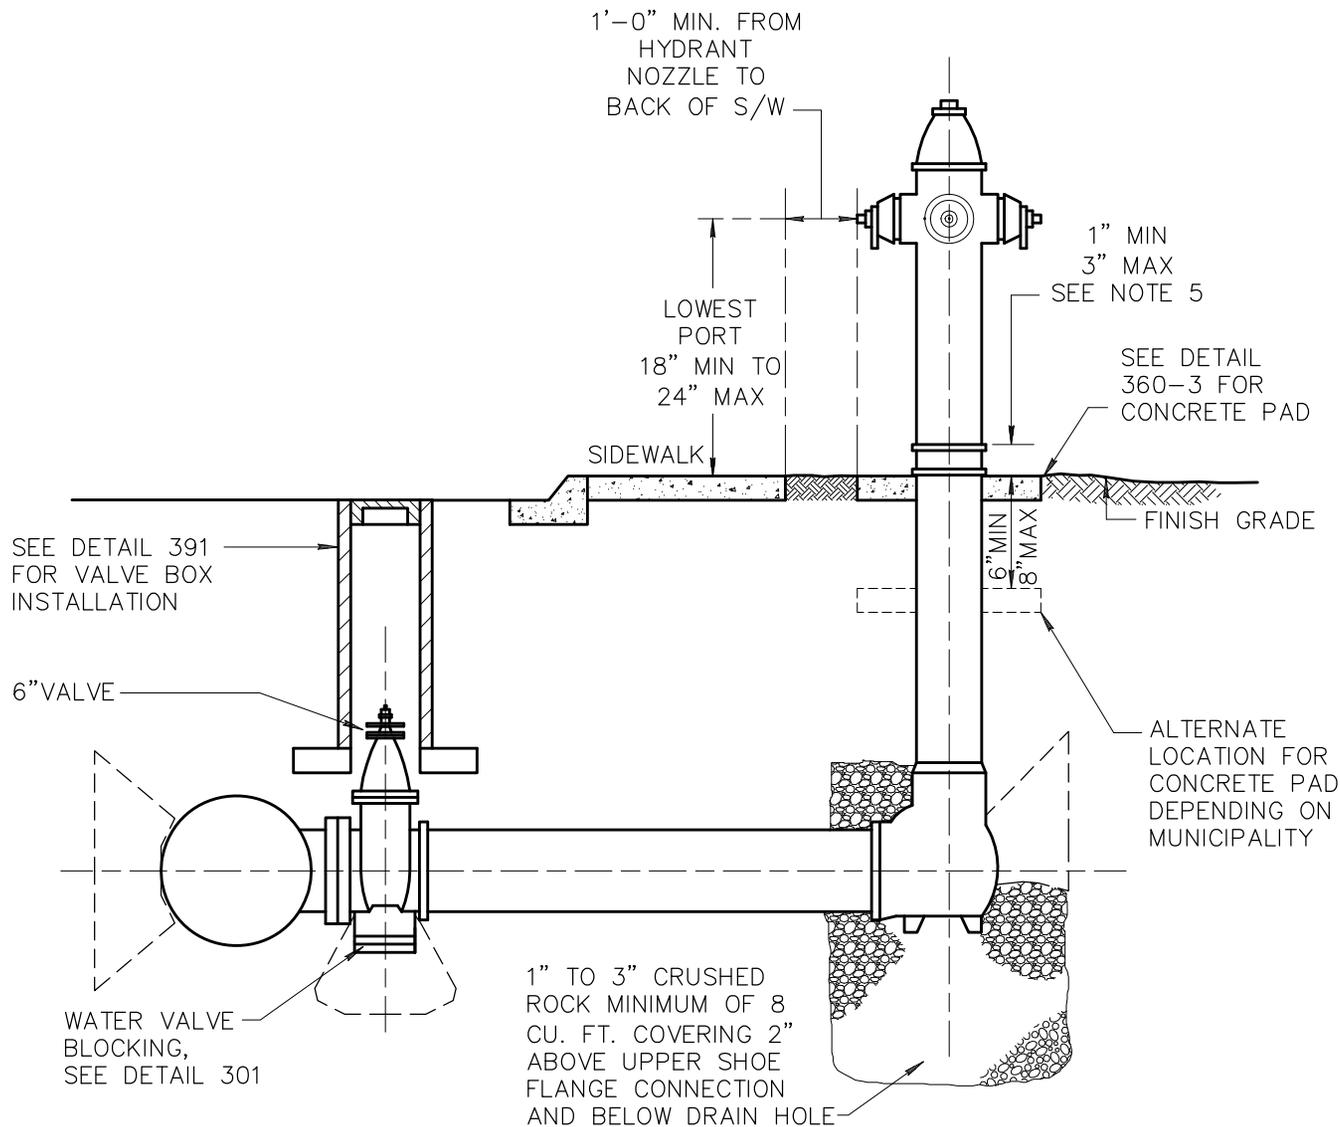

NOTES:

1. JOINTS BETWEEN THE VALVE AND THE MAIN SHALL BE FLANGED TYPE. JOINTS BETWEEN THE VALVE AND HYDRANT SHALL BE RESTRAINT OR MECHANICAL TYPE.
2. RESTRAINTS SHALL BE MECHANICAL RESTRAINT OR THRUST BLOCK PER DETAIL 380.
3. A FLANGE JOINT BY MECHANICAL JOINT VALVE SHALL BE USED AS THE TRANSITION BETWEEN THE JOINT TYPES.
4. PIPING BETWEEN WATER VALVE AND HYDRANT SHALL BE DUCTILE IRON.
5. SEE DETAIL 362 FOR LOCATION OF HYDRANT.
6. PUMPER CONNECTION SHALL FACE THE STREET.
7. NO VALVES ARE TO BE LOCATED IN CURB.
8. NATIONAL STANDARD THREADS REQUIRED ON ALL CONNECTIONS UNLESS OTHERWISE DIRECTED.
9. SEE DETAIL 360-3 FOR CONCRETE PAD.
10. FIRE HYDRANT SHALL BE FRESHLY PAINTED PRIOR TO FINAL ACCEPTANCE.
11. SEE SECTION 756 FOR HYDRANT MATERIAL.

DETAIL NO.

360-1



STANDARD DETAIL
ENGLISH


DRY BARREL FIRE HYDRANT INSTALLATION

REVISED

01-01-2013


DETAIL NO.

360-1

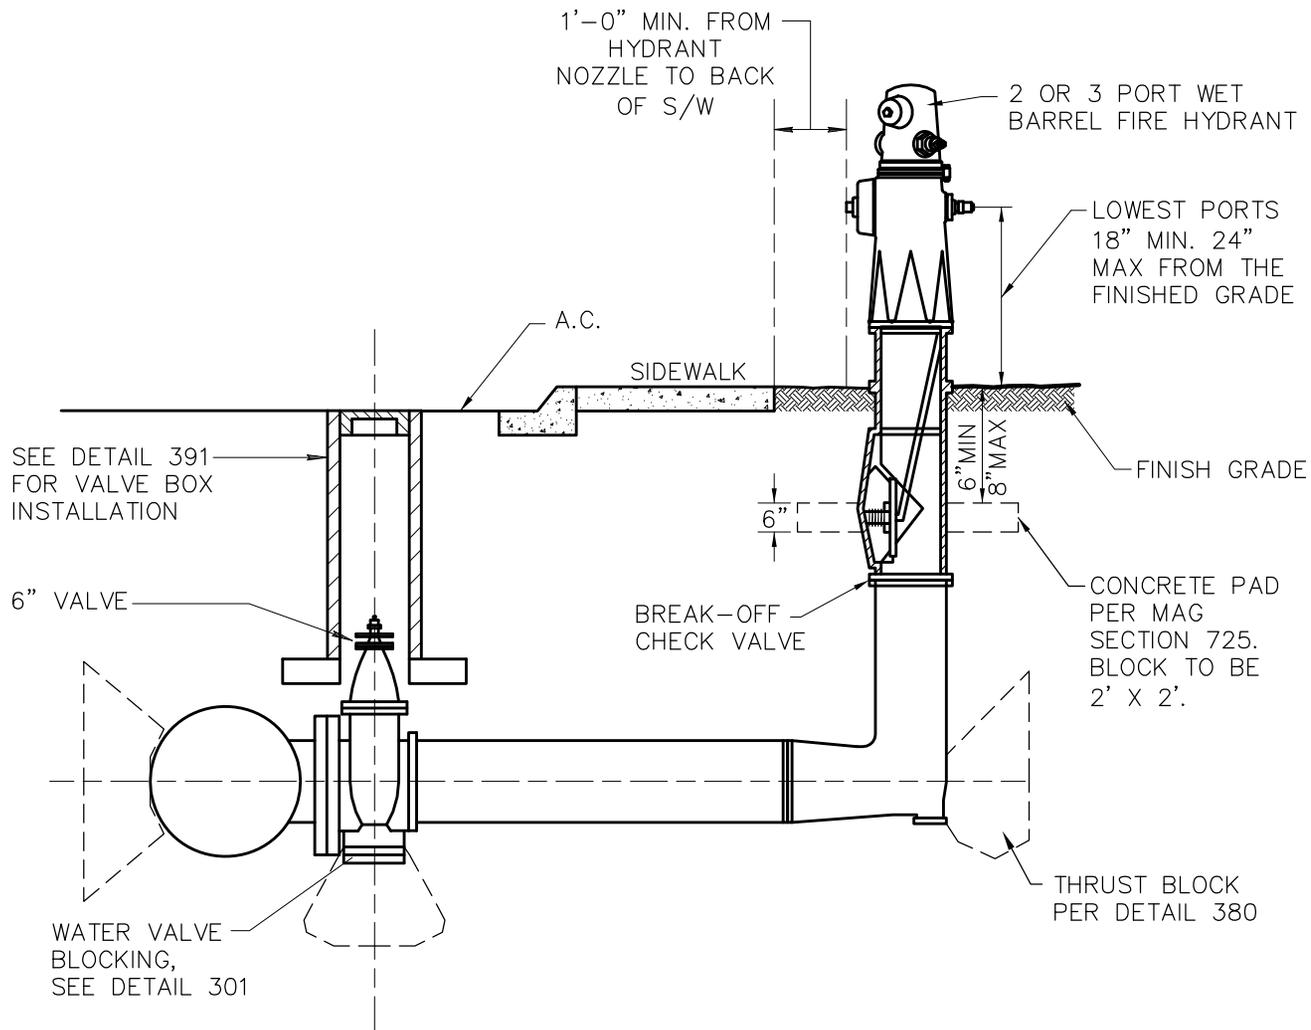


NOTES:

1. JOINTS BETWEEN THE VALVE AND THE MAIN SHALL BE FLANGED TYPE. JOINTS BETWEEN THE VALVE AND HYDRANT SHALL BE MECHANICAL RESTRAINT MECHANICAL TYPE.
2. RESTRAINTS SHALL BE MECHANICAL RESTRAINT OR THRUST BLOCK PER DETAIL 380.
3. A FLANGE JOINT BY MECHANICAL JOINT VALVE SHALL BE USED AS THE TRANSITION BETWEEN THE JOINT TYPES.
4. PIPING BETWEEN WATER VALVE AND HYDRANT SHALL BE DUCTILE IRON.
5. SEE DETAIL 362 FOR LOCATION OF HYDRANT.
6. PUMPER CONNECTION SHALL FACE THE STREET.
7. NO VALVES ARE TO BE LOCATED IN CURB.
8. NATIONAL STANDARD THREADS REQUIRED ON ALL CONNECTIONS UNLESS OTHERWISE DIRECTED.
9. SEE DETAIL 360-3 FOR CONCRETE PAD.
10. FIRE HYDRANT SHALL BE FRESHLY PAINTED PRIOR TO FINAL ACCEPTANCE.
11. THE HYDRANT SHALL HAVE 2- 2½" PORT AND 1- 4½" PORT (INDUSTRIAL OR COMMERCIAL).
12. THE HYDRANT SHALL HAVE 1- 2½" PORT AND 1- 4½" PORT (RESIDENTIAL).


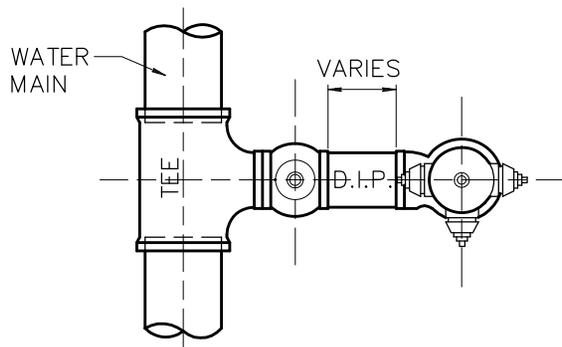


TYP MAIN CONNECTION
(PREFERRED)

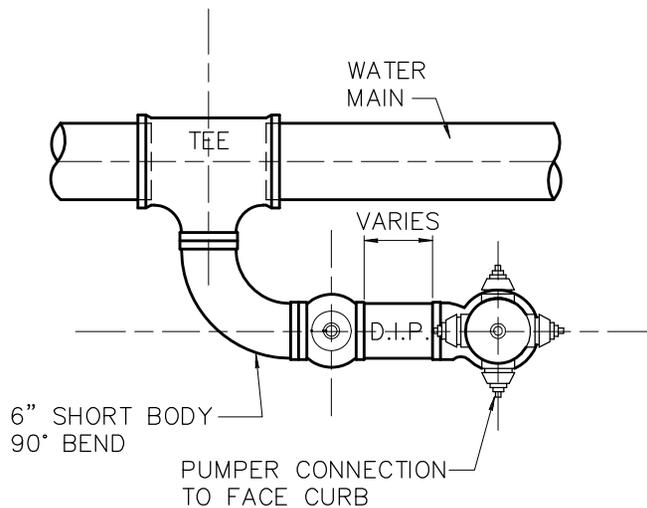


ALT MAIN CONNECTION

SQUARE OR ROUND IS ACCEPTABLE
IF ROUND: 24" DIAMETER MIN. REQUIRED

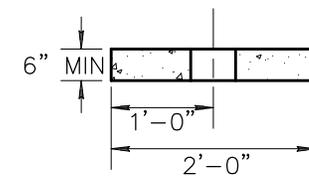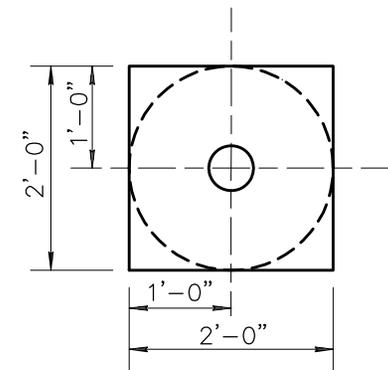

CONCRETE PAD
LOCATION DETAIL

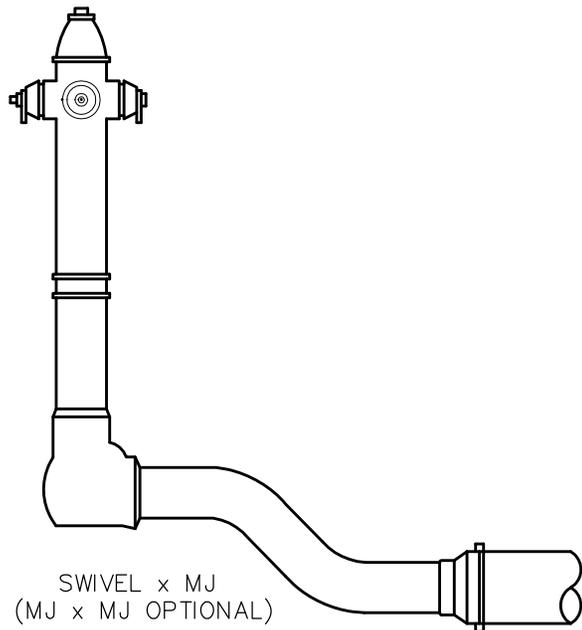

OFFSET FITTINGS

NOTES:

1. CONCRETE FOR PAD SHALL BE CLASS "A".
2. SCORE LINE SHALL BISECT CONCRETE PAD AT MID POINT OF ALL SIDES.
3. CONCRETE COLOR SHALL MATCH ADJACENT CONCRETE. THE FINISHED CONCRETE SURFACE SHALL HAVE A ROUGH BROOM FINISH (SURFACE ONLY).
4. MULTIPLE OFFSET FITTINGS SHALL NOT BE ALLOWED.
5. MINIMUM 36" CLEARANCE PER NFPA-24 AROUND FIRE HYDRANT.
6. 1/2" BITUMINOUS EXPANSION SHALL BE PLACED AROUND THE BARREL OF THE FIRE HYDRANT AT THE CONCRETE PAD.

DETAIL NO.

360-3



STANDARD DETAIL
ENGLISH

FIRE HYDRANT INSTALLATION DETAILS

REVISED


01-01-2013

DETAIL NO.


360-3

NOTES:


1. OBSTRUCTIONS SUCH AS UTILITY POLES, STREET SIGNS, IRRIGATION BOXES, FENCES, ETC., MUST NOT BE PLACED BETWEEN CURB AND HYDRANT AND WITHIN THE RADIUS FOR FIRE DEPT. ACCESS.
2. DIMENSIONS SHOWN ON CONSTRUCTION DRAWINGS SUPERSEDE LOCATIONS SHOWN HERE.
3. ON LOCATIONS IN MIDBLOCK, THE FIRE HYDRANT WILL BE ALIGNED WITH A PROPERTY LINE.

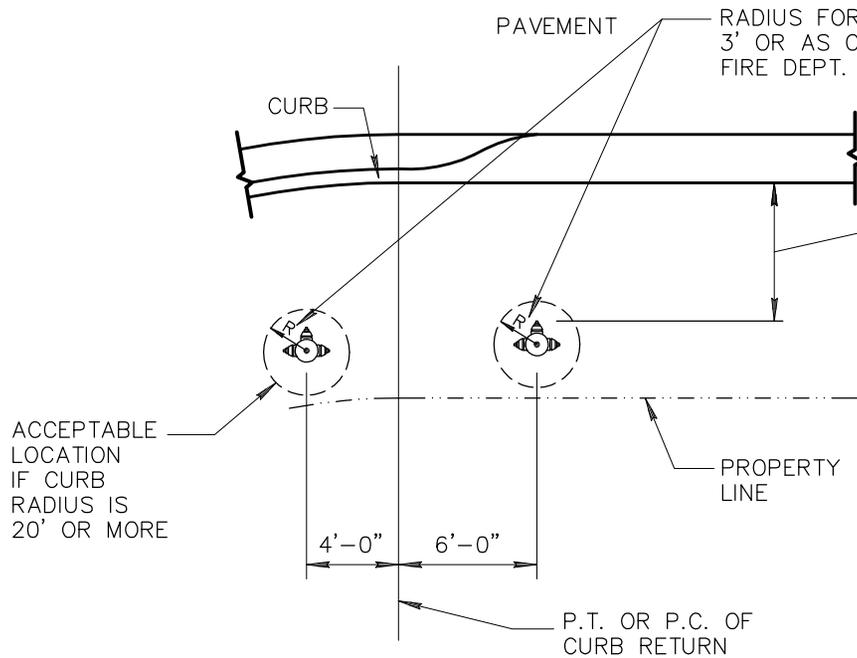


PARKWAY AREA OR NO SIDEWALK

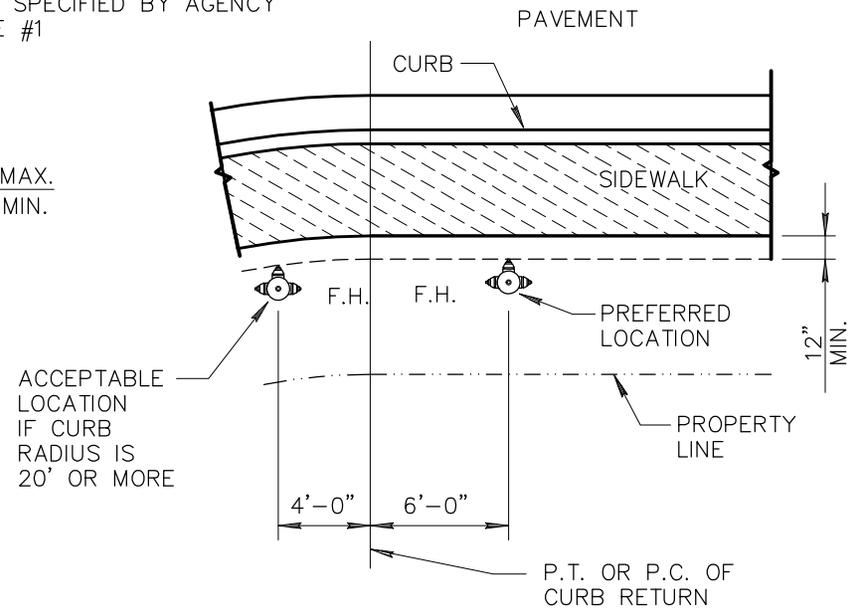


AREA WITH SIDEWALK

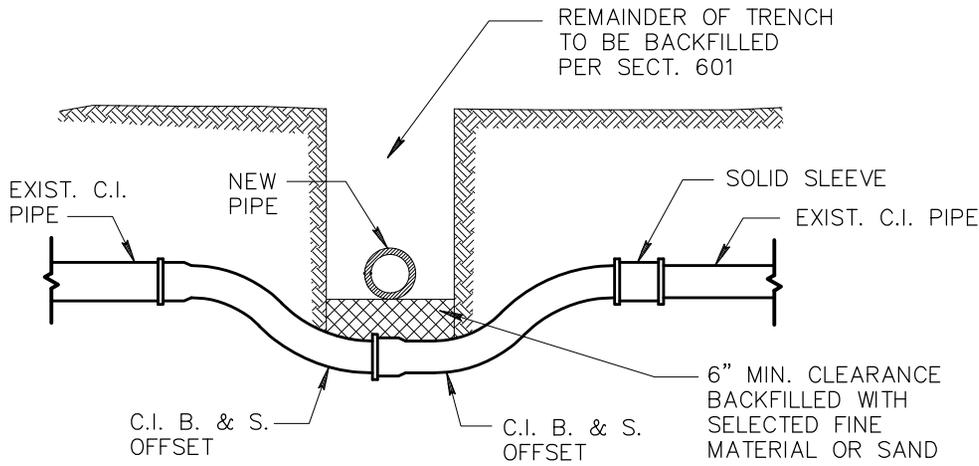

CAST IRON

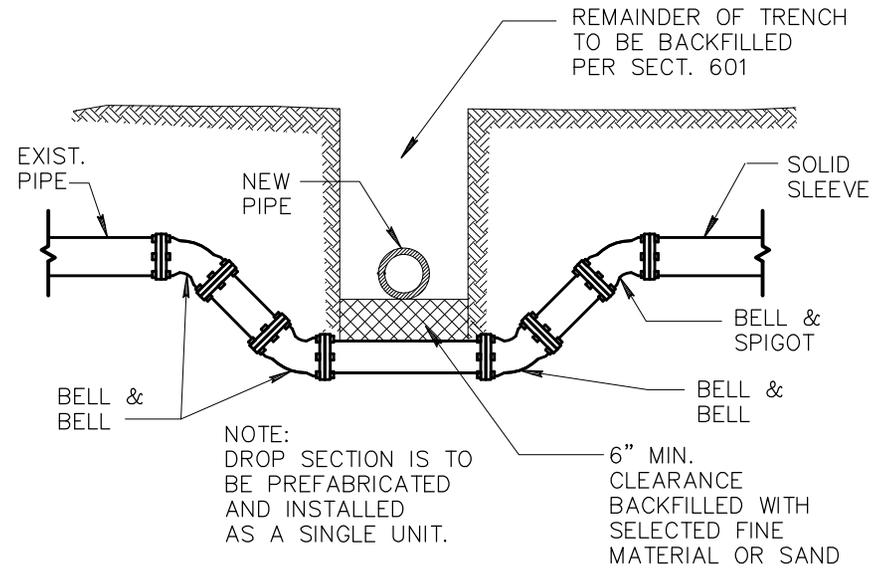

CAST IRON MECHANICAL JOINT




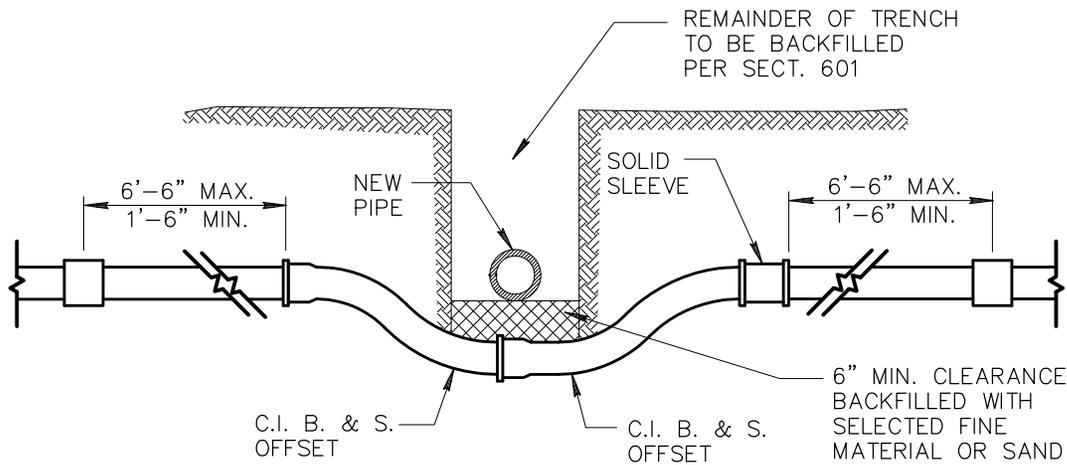


ASBESTOS CEMENT

NOTES:

1. THIS DETAIL COVERS MOVING OF WATER MAINS 2" TO 12" ONLY.
2. THRUST BLOCKING AS PER DET. 380 & 381.
3. IF OFFSET IS TO GO OVER OBSTRUCTION, JOINT RESTRAINTS MUST BE USED.
4. PIPE IS TO BE CAST IRON OR DUCTILE IRON.





TYPICAL LOCATIONS OF THRUST BLOCKS

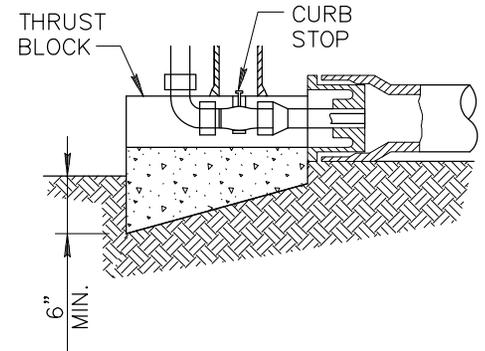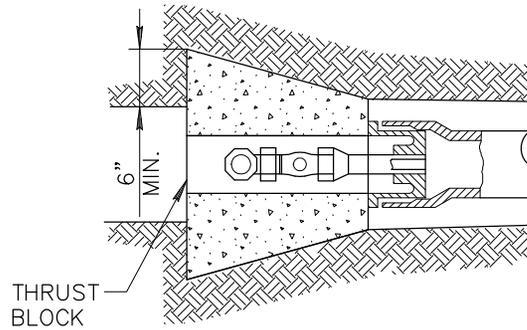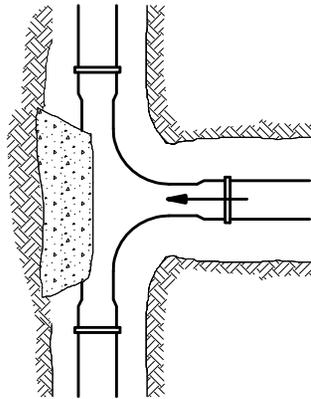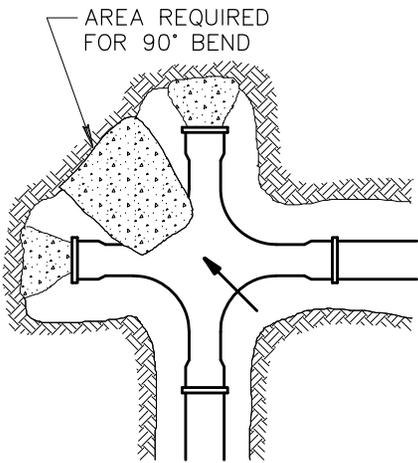

NOTES:

1. TABLE IS BASED ON 200 P.S.I. TEST PRESSURE AND 3,000 LBS/SQ. FT. SOIL. IF CONDITIONS ARE FOUND TO INDICATE SOIL BEARING IS LESS, THE AREAS SHALL BE INCREASED ACCORDINGLY.
2. AREAS FOR PIPES LARGER THAN 16" SHALL BE CALCULATED FOR EACH PROJECT.
3. FORM ALL NON-BEARING VERTICAL SURFACES.
4. THRUST BLOCKS ARE TO EXTEND TO UNDISTURBED GROUND. CONCRETE TO BE CLASS 'C', SECT. 725.

1/2 AREA REQUIRED FOR 90° BEND

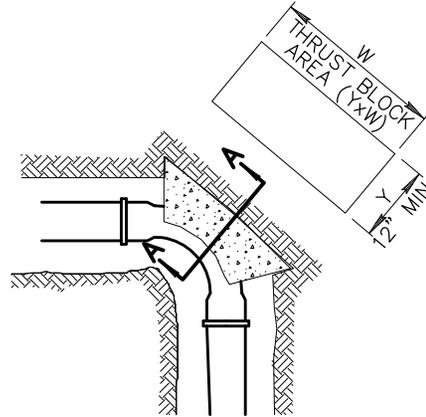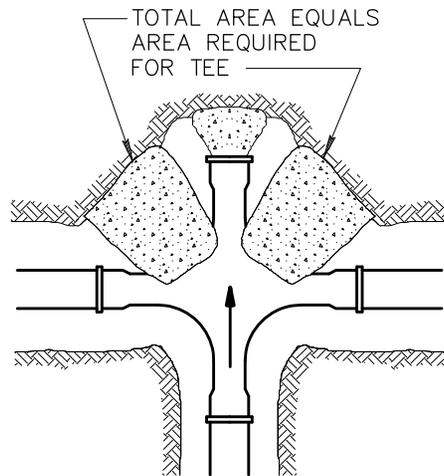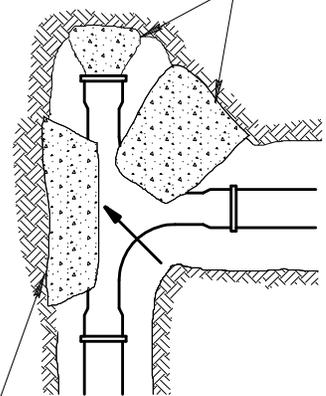

MINIMUM THRUST BLOCK AREA REQUIRED (YxW) (SQ. FT.)

PIPE SIZE	WATER PIPE	
	TEE, DEAD END, 90° BEND	45° & 22 1/2° BENDS
4" OR LESS	3	3
6"	4	3
8"	6	3
10"	10	5
12"	14	7
16"	24	12

DETAIL NO.

380



STANDARD DETAIL
ENGLISH

THRUST BLOCKS FOR WATER LINES

REVISED

01-01-1998

DETAIL NO.


380

PIPE SIZE	MIN BAR SIZE	"A" - DIMENSION HOOK	MIN. * BLOCK DIM.
6"	#6	6"	3' x 3' x 3'
8"	#6	9"	4' x 4' x 2.5'
12"	#8	9"	4' x 4' x 5'

* FOR 125 P.S.I. WORKING PRESSURE.

NOTES:

1. EITHER THIS DETAIL OR RESTRAINT RODS CAN BE USED WHEN IT IS ALLOWED TO RELOCATE A WATER LINE UPWARD OR DOWNWARD TO CROSS A CONFLICT.
2. DUCTILE IRON PIPE MAY BE USED.
3. BARS TO CONCRETE THRUST BLOCK TO BE COATED WITH 2 COATS COAL TAR, EPOXY OR BY OTHER APPROVED METHOD. BARS TO HAVE 90° HOOK ON LOWER END, AS PER TABLE.

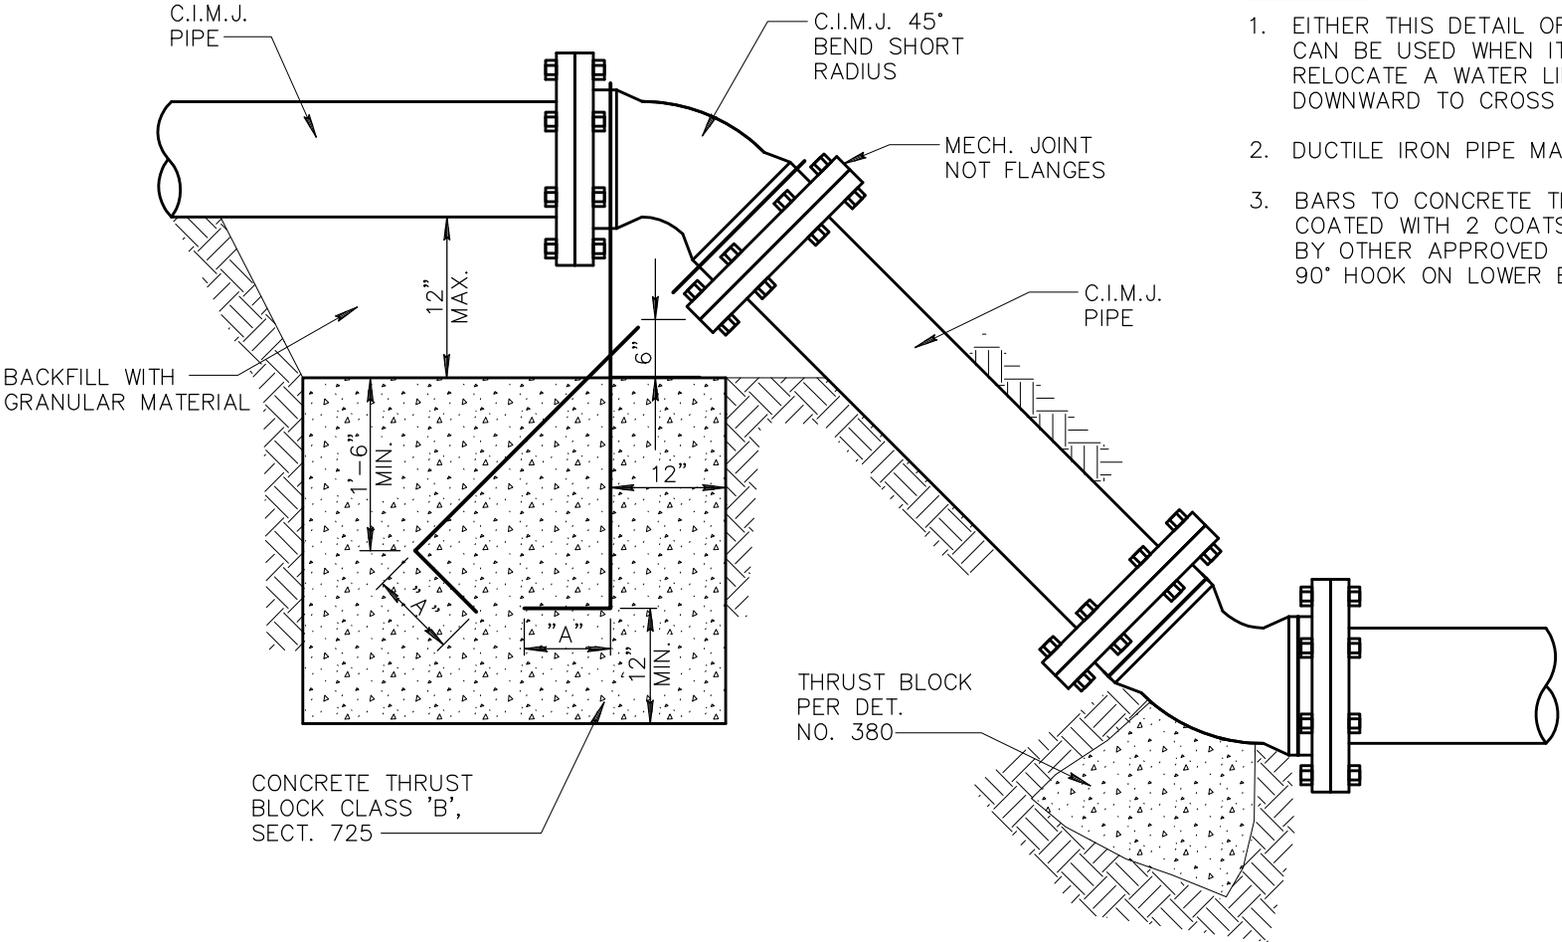




ENLARGED
'A'

FRAME AND
COVER PER
DETAIL 270

POURED CONCRETE COLLAR 8" THICK
AND 40" SQUARE OR ROUND, VALVE BOX
CENTER. CLASS 'AA' CONCRETE AS
PER SECTION 725. RADIALLY SCORE JOINTS (4" MIN)
MEDIUM BROOM FINISH

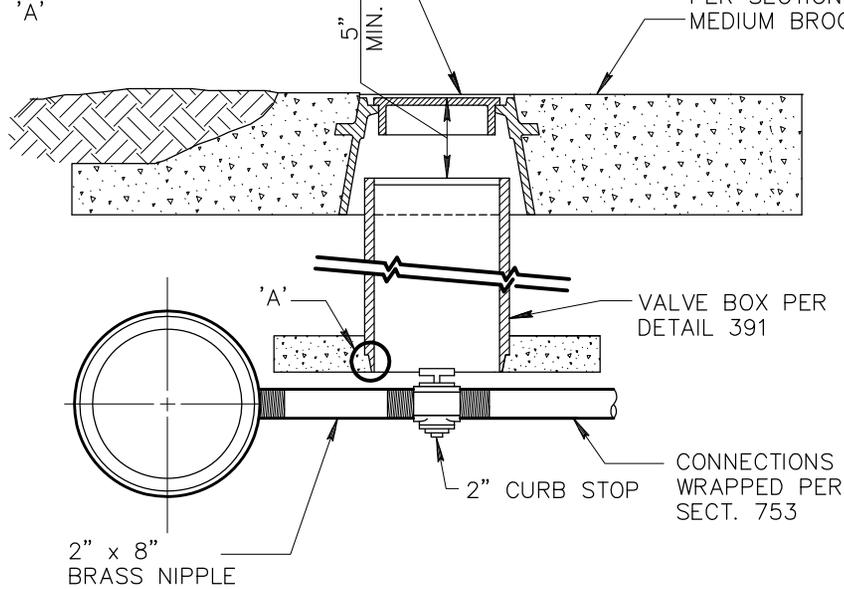

TYPE 'A'


NOTES:

1. CURB STOP TO BE MUELLER ORISEAL (H-10283), FORD BALL VALVE B11-777, HAYES BULLETIN 400, J. JONES (J-1900) OR APPROVED EQUAL.
2. REDUCER MAY BE USED WHEN CONNECTING TO SMALLER GALVANIZED PIPE.
3. THIS DETAIL IS TO BE USED WHEN CONNECTING EXISTING GALVANIZED PIPE TO ASBESTOS CEMENT PIPE OR CAST IRON PIPE.

FINISH
PARKWAY
GRADE

TAPPED TEE
OR CROSS AS
PER PLANS

VALVE BOX
PER DETAIL 391

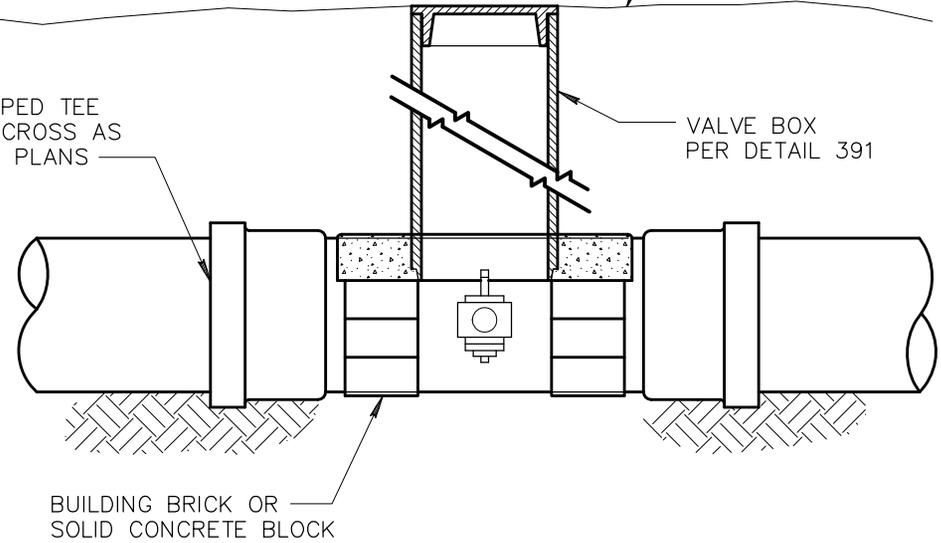

TYPE 'B'

NOTE:

1. VALVE BOX TO BE SUPPORTED ON BRICKS TO PREVENT VERTICAL LOADS FROM BEING TRANSMITTED TO THE SMALL PIPE.

DETAIL NO.

389



STANDARD DETAIL
ENGLISH


**CURB STOP WITH VALVE BOX
AND COVER**

REVISED

01-01-2001

DETAIL NO.

389

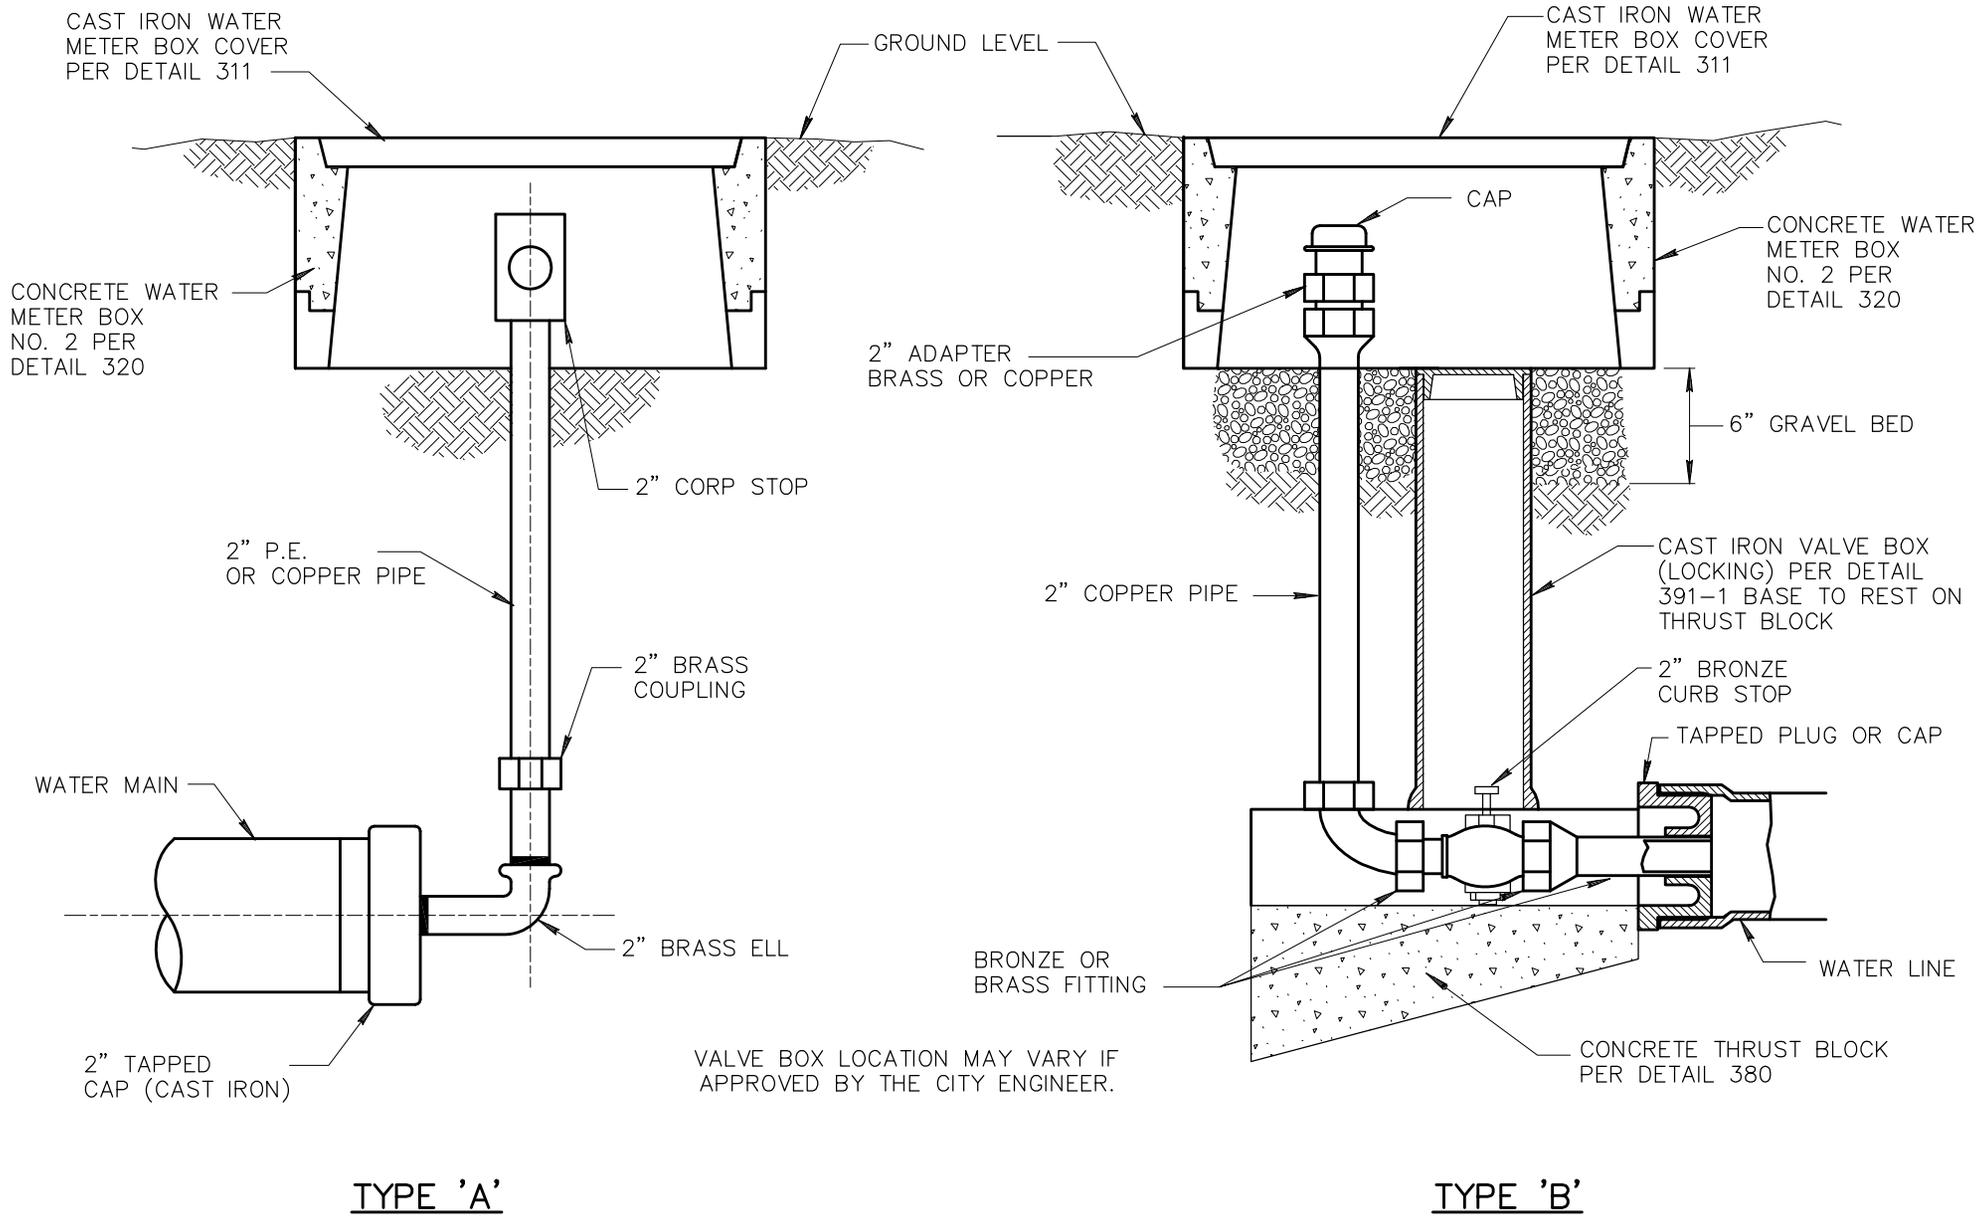

DETAIL NO.
390




STANDARD DETAIL
ENGLISH

CURB STOP WITH FLUSHING PIPE

REVISED
01-01-1998

DETAIL NO.
390

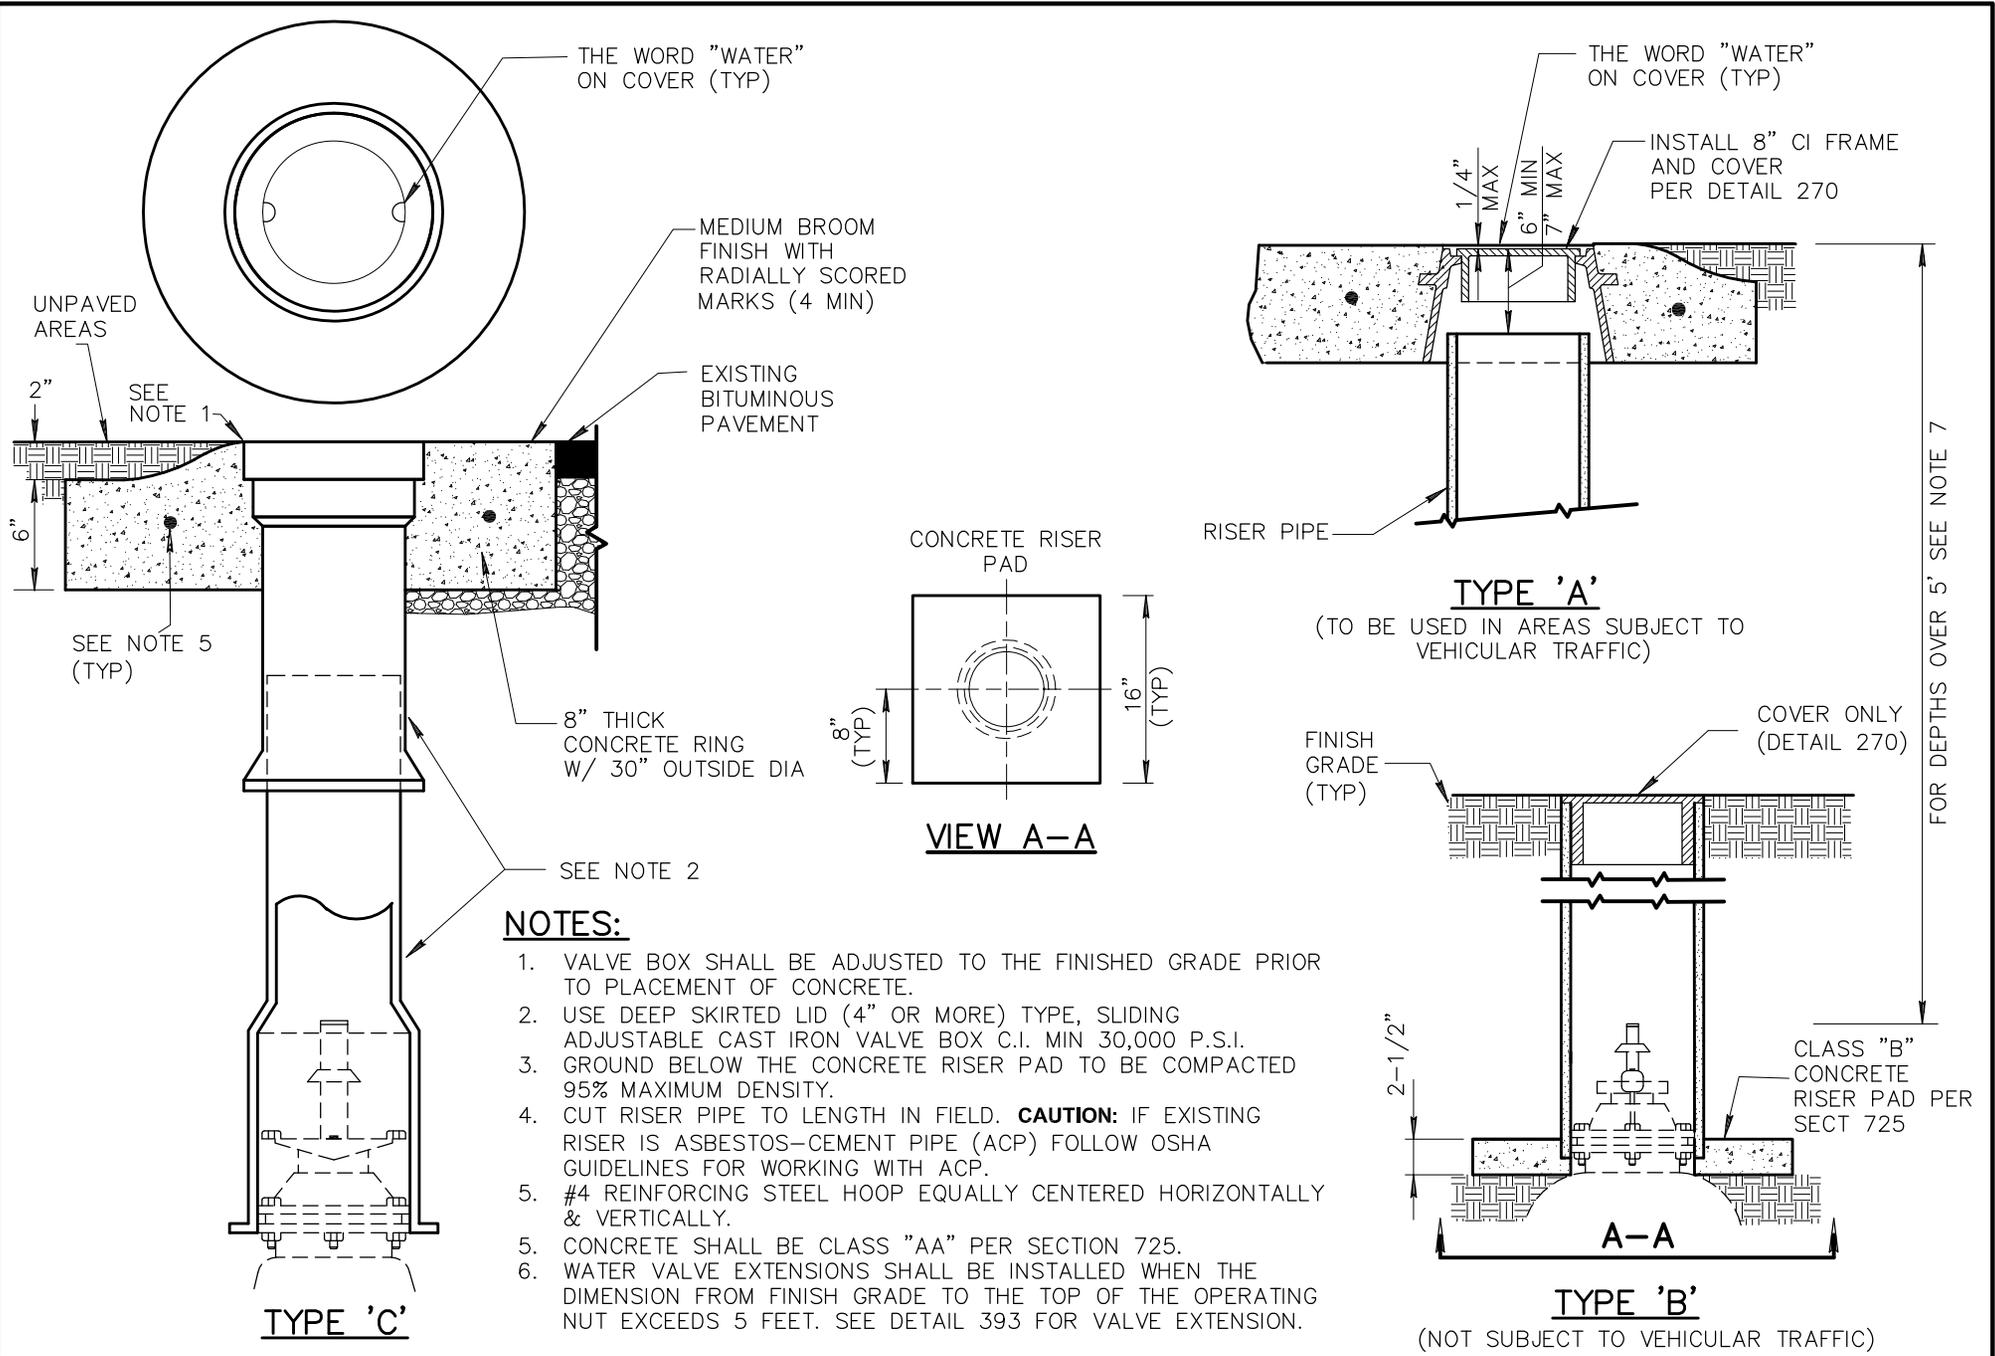

NOTES:

1. VALVE BOX SHALL BE ADJUSTED TO THE FINISHED GRADE PRIOR TO PLACEMENT OF CONCRETE.
2. USE DEEP SKIRTED LID (4" OR MORE) TYPE, SLIDING ADJUSTABLE CAST IRON VALVE BOX C.I. MIN 30,000 P.S.I.
3. GROUND BELOW THE CONCRETE RISER PAD TO BE COMPACTED 95% MAXIMUM DENSITY.
4. CUT RISER PIPE TO LENGTH IN FIELD. **CAUTION:** IF EXISTING RISER IS ASBESTOS-CEMENT PIPE (ACP) FOLLOW OSHA GUIDELINES FOR WORKING WITH ACP.
5. #4 REINFORCING STEEL HOOP EQUALLY CENTERED HORIZONTALLY & VERTICALLY.
5. CONCRETE SHALL BE CLASS "AA" PER SECTION 725.
6. WATER VALVE EXTENSIONS SHALL BE INSTALLED WHEN THE DIMENSION FROM FINISH GRADE TO THE TOP OF THE OPERATING NUT EXCEEDS 5 FEET. SEE DETAIL 393 FOR VALVE EXTENSION.

DETAIL NO.
391-1




STANDARD DETAIL
ENGLISH

VALVE BOX INSTALLATION AND GRADE ADJUSTMENT

REVISED
01-01-2017

DETAIL NO.
391-1

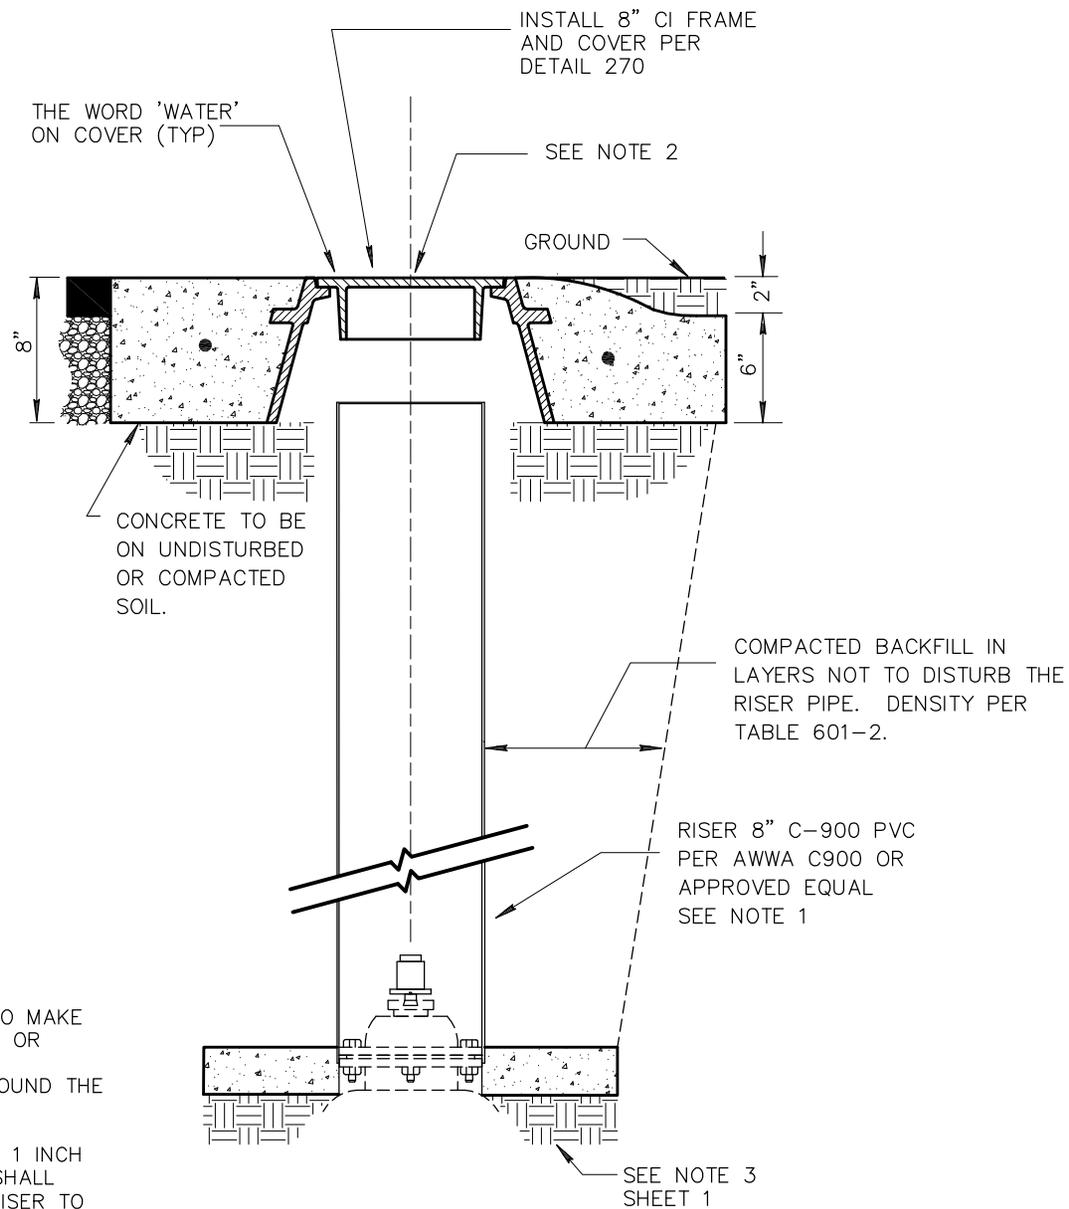

NOTES:

1. IF TWO OR MORE SECTIONS OF PIPE ARE USED TO MAKE THE VALVE BOX RISER, THEY SHALL BE COUPLED OR BONDED TO FORM DEBRIS-TIGHT JOINTS.
2. VALVE BOX SHALL BE PLUMB AND CENTERED AROUND THE OPERATING NUT.
3. THE TOP OF THE VALVE SHALL BE KEPT CLEAN.
4. THE TOP OF THE RISER SHALL BE A MINIMUM OF 1 INCH ABOVE UNDISTURBED OR COMPACTED SOIL AND SHALL HAVE A MINIMUM CLEARANCE OF 2" FROM THE RISER TO THE LID SKIRT.

DRAFT

391-2



STANDARD DETAIL
ENGLISH


**VALVE BOX INSTALLATION
AND GRADE ADJUSTMENT**

REVISED

01-01-2017

DETAIL NO.


391-2

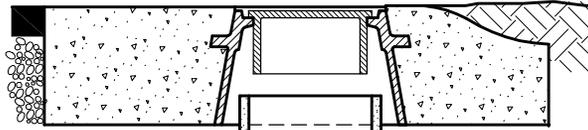

VALVE BOX AND COVER
FOR DETAIL 391-1,
TYPE A

DEBRIS CAP


TYPE 'A'

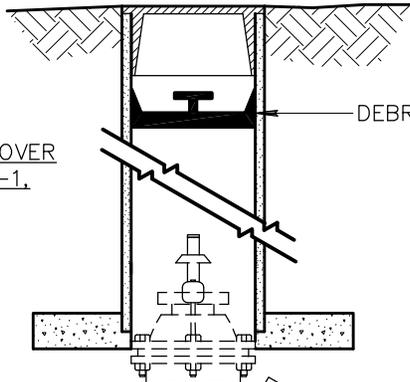

VALVE BOX AND COVER
FOR DETAIL 391-1,
TYPE B

DEBRIS CAP

TYPE 'B'

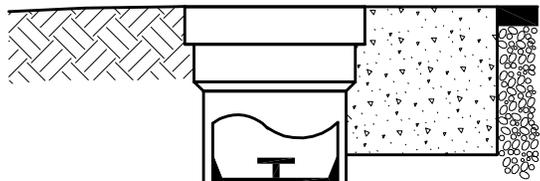

VALVE BOX AND COVER
FOR DETAIL 391-1,
TYPE C

DEBRIS CAP



TYPE 'C'

NOTES:


1. THE DEBRIS CAP SHALL BE DESIGNED AND INSTALLED TO PREVENT DEBRIS SUCH AS DIRT, DUST SAND, ETC., FROM PASSING AROUND THE CAP AND DOWN INTO THE VALVE HOUSING. THE CAP SHALL BE HELD IN PLACE BY A MECHANISM WHICH WILL NOT DAMAGE THE VALVE HOUSING.
2. THE CAP SHALL BE MANUFACTURED OF CORROSIVE RESISTANT MATERIALS.
3. DEBRIS CAP SHALL BE INSTALLED AS CLOSE UNDER THE CAST IRON COVER WITHOUT INTERFERING WITH COVER OPERATION.
4. THE CAP SHALL BE CAPABLE OF SECURELY HOLDING A STANDARD LOCATING COIL, "SCOTCH MARK" 4 DISK MARKER BY 3M OR EQUAL.
5. THE CAP SHALL BE CONSTRUCTED TO ALLOW THE DEVICE TO BE SECURED BY A LOCK. THE LOCK (PAD, BARREL, ETC.) SHALL BE SUPPLIED BY THE AGENCY.
6. THE CAP SHALL BE INSTALLED IN ALL VALVE HOUSINGS AS REQUIRED BY THE CONTRACT DOCUMENTS OR BY THE AGENCY'S POLICIES.

PIPE SLEEVE DETAIL

MATERIAL: STEEL PER ASTM A513

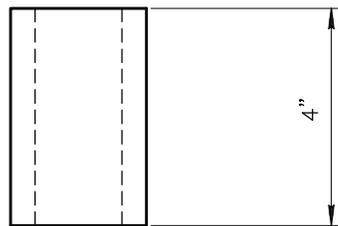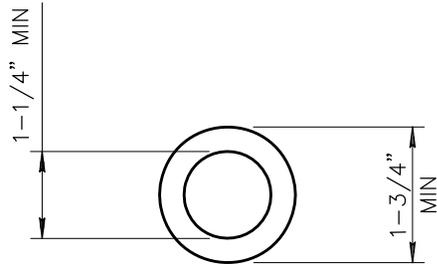

2" SQUARE OPERATING NUT (WITH STAINLESS STEEL FLAT WASHER - 0.43 ID x 1 OD x 0.1 THICK STAINLESS STEEL HEX BOLT - 3/8-16 x 1") NUT TO BE HELD DOWN WITH NUT ON THREADED SHAFT AS STD VALVE STEM ATTACHMENT.

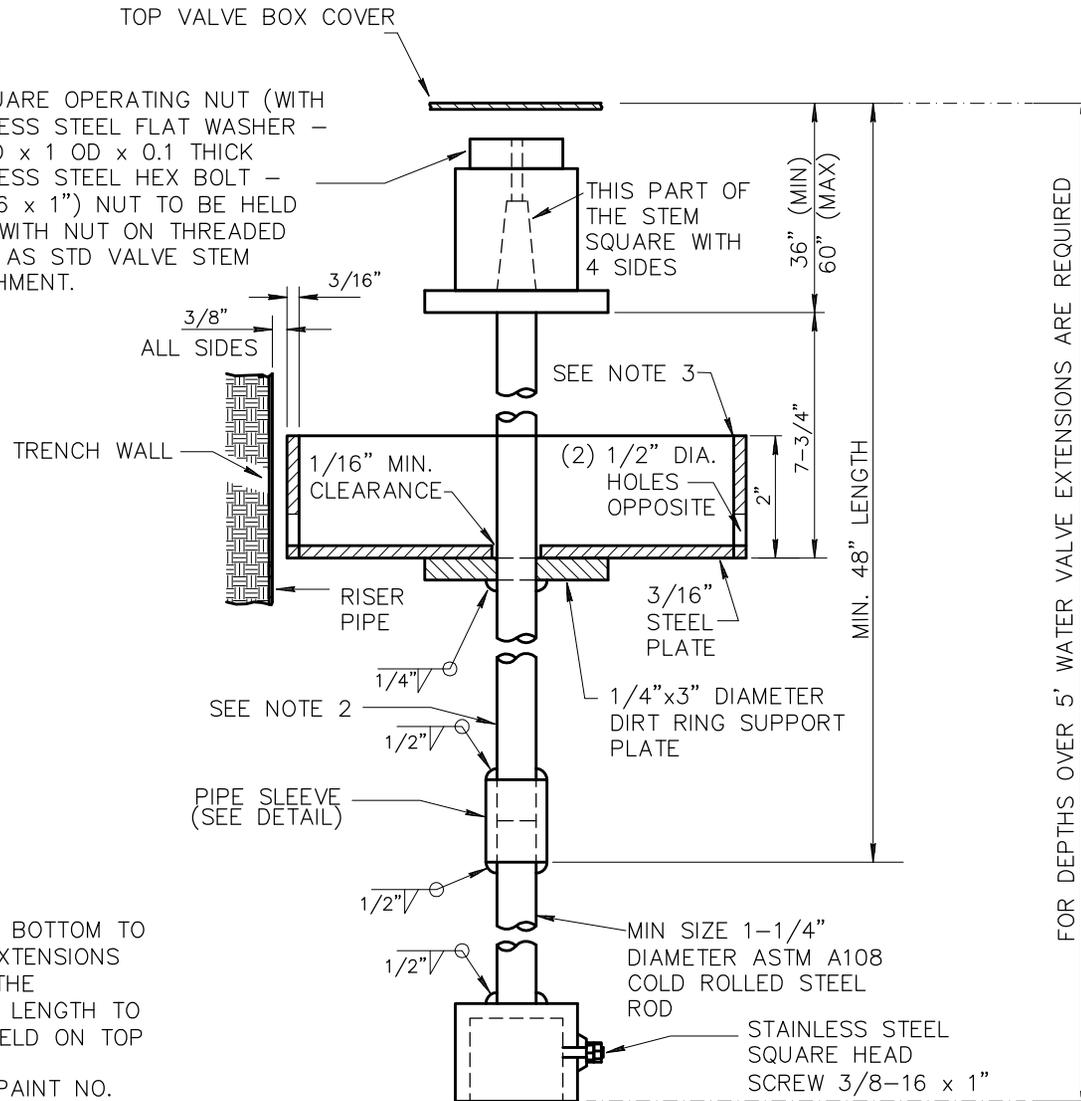


NOTES:


1. EXTENSION STEM: WITH A SQUARE SOCKET ON THE BOTTOM TO FIT A 2" SQUARE VALVE OPERATING NUT. VALVE EXTENSIONS ARE REQUIRED ON ALL VALVES INSTALLED WHERE THE OPERATING NUT IS OVER 5' BELOW THE SURFACE. LENGTH TO FIT EACH INSTALLATION. OPERATING NUT TO BE HELD ON TOP OF EXTENSION WITH STOP NUT.
2. PAINTING: ALL STEEL TO HAVE A PRIME COAT OF PAINT NO. 1-D AND ONE HEAVY APPLICATION (FINISH COAT) OF PAINT NO. 9 AS PER SECT. 790.
3. DIRT RING TO FLOAT FREELY ON THE TOP OF THE SUPPORT PLATE.
4. PIPE SLEEVE SHALL BE SECURELY WELDED TO THE UPPER AND LOWER PORTION OF THE 1-1/4" EXTENSION ROD.

NOTES:

1. THIS DETAIL SHALL BE REQUIRED WHEN NEW OR EXISTING PIPE INSTALLATIONS WILL BE SUBJECT TO DAMAGE ANYTIME IN THE FUTURE DUE TO LACK OF PROPER COVER, AS DETERMINED BY THE ENGINEER.
2. FOR PIPE OVER 18" I.D. WOOD, METAL OR GYPSUM BOARD FORMS MUST BE USED TO FORM THE SIDES OF THE ENCASEMENT. GYPSUM BOARD FORMS MAY BE LEFT IN THE GROUND BELOW THE TOP OF THE ENCASEMENT. THIS SHALL BE OPTIONAL WITH POURING AGAINST TRENCH WALLS FOR ENCASEMENT OF 18" AND SMALLER PIPE.
3. FOR ALL SITUATIONS WHERE SIDE FORMS ARE USED, TRENCH WALLS SHALL BE OVER-EXCAVATED TO ALLOW SUFFICIENT ROOM TO OPERATE PROPER MECHANICAL COMPACTION EQUIPMENT.
4. CONCRETE WHICH SPILLS BEYOND 12" FROM THE SIDES OF THE PIPE FOR ANY REASON SHALL BE REMOVED BACK TO THE PROPER LINE PRIOR TO BACKFILLING.
5. SEE SECTION 601 FOR TRENCH PREPARATION.
6. CONCRETE TO BE CLASS 'A' PER SECT. 725.
7. COVER TO BE APPROVED BY ENGINEER.

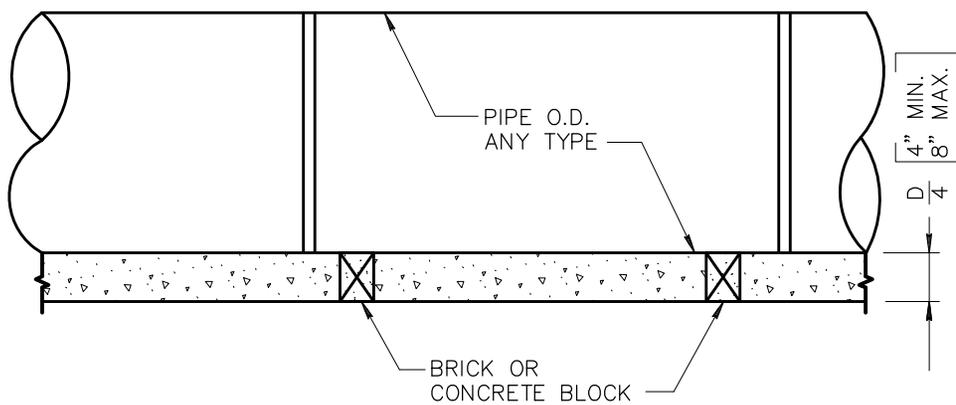

LONGITUDINAL SECTION

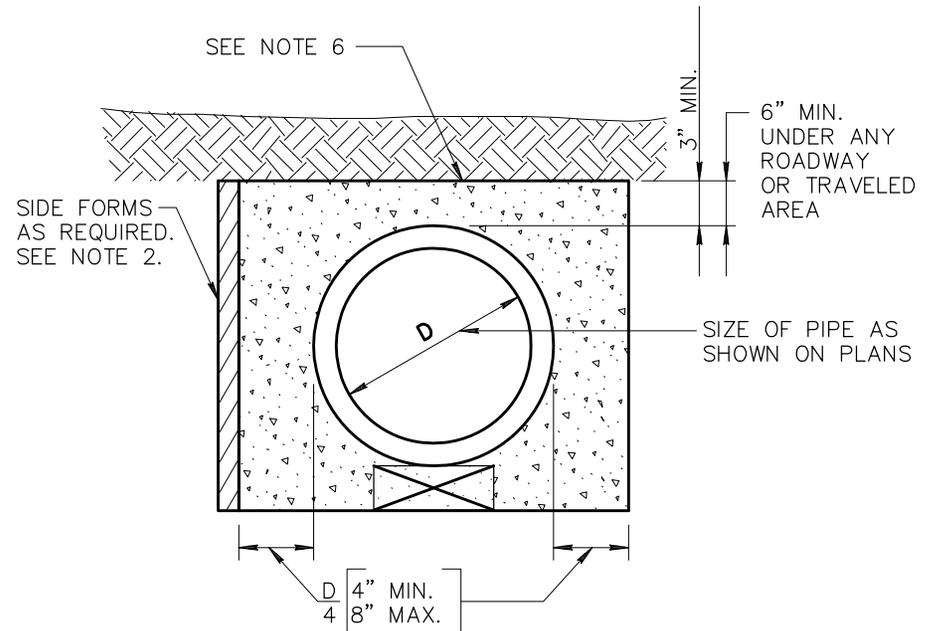

END SECTION

DETAIL NO.

507



STANDARD DETAIL
ENGLISH


**ENCASED CONCRETE PIPE
(FOR SHALLOW INSTALLATION)**

REVISED

01-01-2017


DETAIL NO.

507


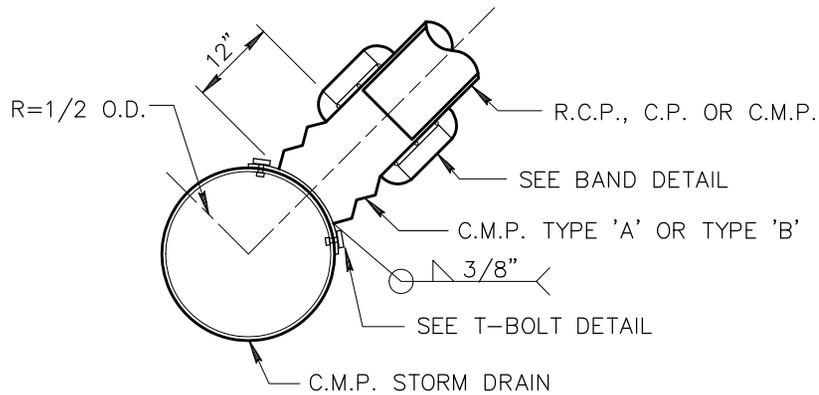


CONNECTOR CROSS SECTION


NOTE:
USE 5/8" WASHER AND NUT, ALL PIECES
(NUTS, WASHERS, AND FABRICATED BOLTS)
TO BE GALVANIZED AS PER A.S.T.M. A-123
LATEST REVISION.

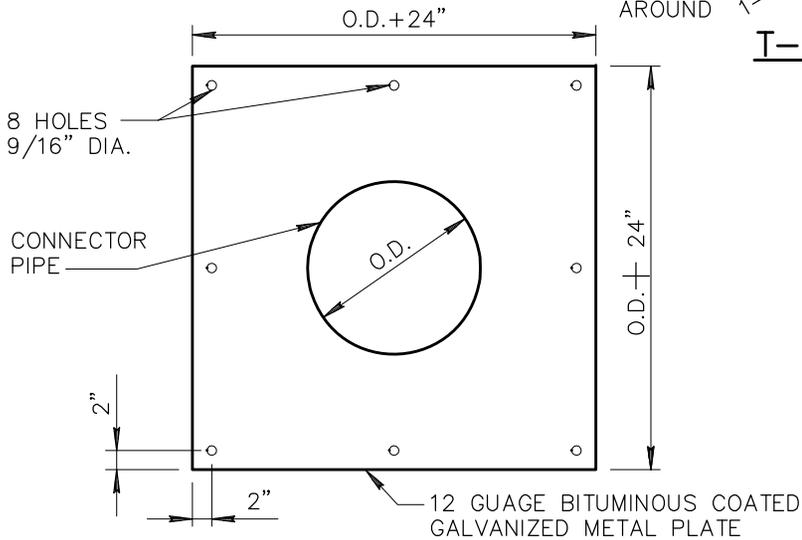


**C.M.P. CONNECTION TO MAIN STORM DRAIN
24" PIPE AND SMALLER**

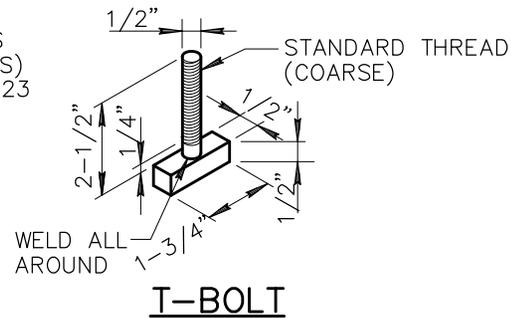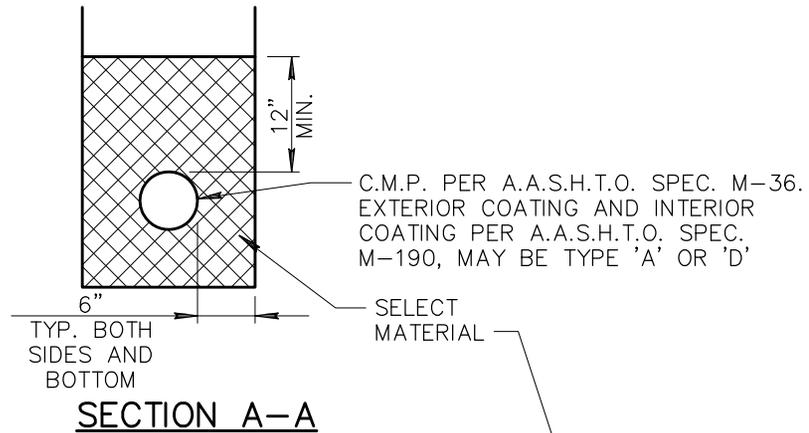

T-BOLT

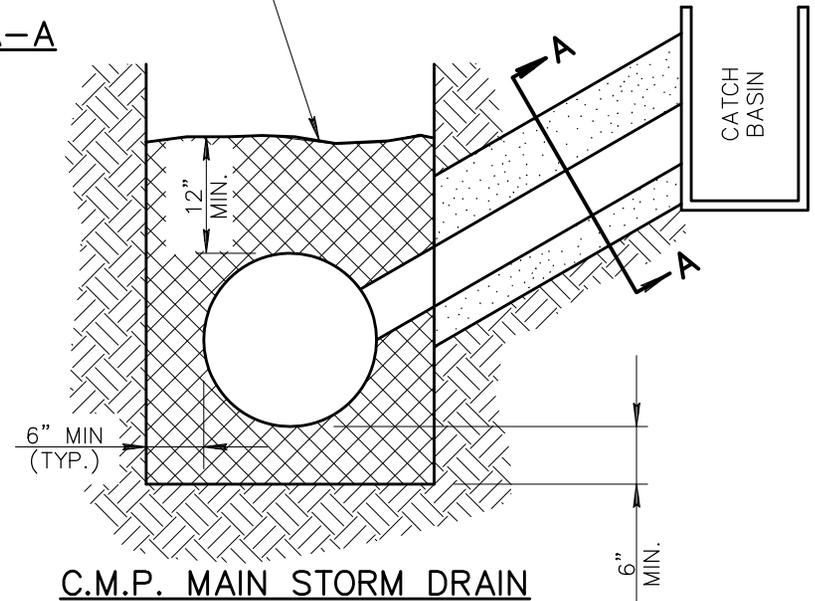

C.M.P. MAIN STORM DRAIN

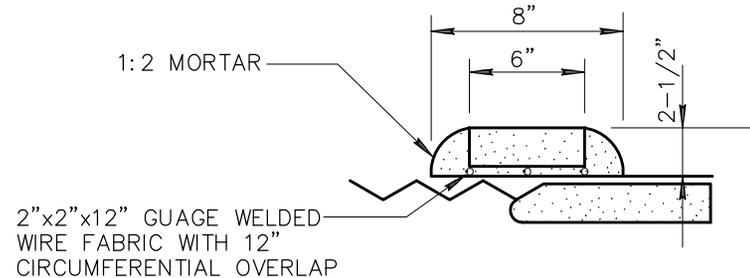

BAND DETAIL

DETAIL NO.

510



STANDARD DETAIL
ENGLISH

**CORRUGATED METAL PIPE
AND INSTALLATION**

REVISED
01-01-1998

DETAIL NO.

510