

MARICOPA COUNTY
Department of Transportation



MEMORANDUM

Date: July 18, 2017
To: MAG Specifications and Details Committee
From: Robert Herz, MCDOT Representative
Subject: Detail 505 Revisions

Case 17-14 Revised 2017-08-23

PURPOSE: Correct rebar callouts and show pipe cut mitered to reduce closure gap. The radial closure currently shown cannot be formed for small diameter pipe. See ADOT Drawing for suggested adjustment. Recommend adding ADOT notes 3 and 7 as notes 8 and 9 to Detail 505. Also delete **A*** references from the MAG Detail.

REVISION:

Drawing Adjustment:

CASE 17-01 B

NOTES:

1. A CONCRETE COLLAR IS REQUIRED WHERE PIPES OF DIFFERENT DIAMETERS OR MATERIALS ARE JOINED, OR WHERE THE CHANGE IN ALIGNMENT OR GRADE EXCEEDS THAT ALLOWED FOR ON ORDINARY JOINTS.
2. WHERE PIPES OF DIFFERENT DIAMETERS ARE JOINED WITH A CONCRETE COLLAR, L AND T SHOULD BE THOSE OF THE LARGER PIPE. D=D-1, OR D-2 WHICHEVER IS GREATER.
3. FOR PIPE SIZES NOT LISTED AND LESS THAN 66" USE NEXT SIZE LARGER.
4. OMIT REINFORCING ON PIPE 24" OR LESS IN DIAMETER.
5. WHERE REINFORCING IS REQUIRED, THE DIAMETER OF THE CIRCULAR TIES SHALL BE THE OUTSIDE DIAMETER OF PIPE+1.
6. FIELD CLOSURES OF PIPE OF THE SAME DIAMETER AND WITHOUT CHANGE IN GRADE OR ALIGNMENT SHALL BE MADE WITH A CONCRETE COLLAR.
7. CONCRETE SHALL BE CLASS B PER SECT. 725.

A*=ANGLE OF DEFLECTION

TABLE		
D	L	T
12"	1.0'	4"
18"	1.0'	5"
24"	1.0'	6"
36"	1.5'	8"
48"	1.5'	10"
57"	1.5'	10"
60"	1.75'	11"
66"	1.75'	11"


DETAIL NO.
505

STANDARD DETAIL
ENGLISH

CONCRETE PIPE COLLAR

REVISED
01-01-1998

DETAIL NO.
505

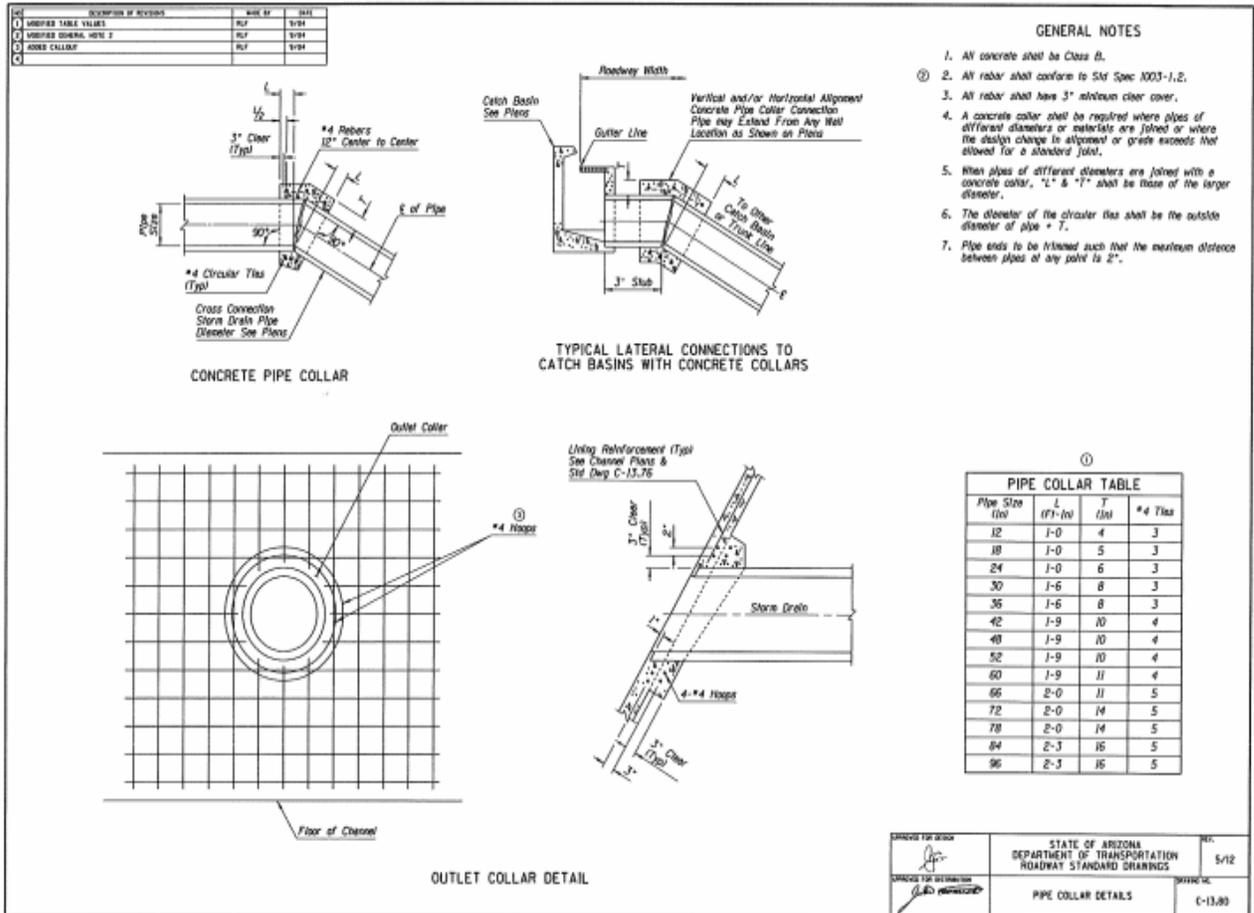

GENERAL NOTES

1. All concrete shall be Class B.
2. All rebar shall conform to Std Spec 1003-1.2.
3. All rebar shall have 3" minimum clear cover.
4. A concrete collar shall be required where pipes of different diameters or materials are joined or where the design change in alignment or grade exceeds that allowed for a standard joint.
5. When pipes of different diameters are joined with a concrete collar, "L" & "T" shall be those of the larger diameter.
6. The diameter of the circular tiles shall be the outside diameter of pipe + T.
7. Pipe ends to be trimmed such that the maximum distance between pipes at any point is 2".

GENERAL NOTES

1. All concrete shall be Class B.
2. All rebar shall conform to Std Spec 1003-1.2.
3. All rebar shall have 3" minimum clear cover.
4. A concrete collar shall be required where pipes of different diameters or materials are joined or where the design change in alignment or grade exceeds that allowed for a standard joint.
5. When pipes of different diameters are joined with a concrete collar, "L" & "T" shall be those of the larger diameter.
6. The diameter of the circular tiles shall be the outside diameter of pipe + T.
7. Pipe ends to be trimmed such that the maximum distance between pipes at any point is 2".

← **ADD NOTE TO DETAIL**

← **ADD NOTE TO DETAIL**

NOTES:

1. A CONCRETE COLLAR IS REQUIRED WHERE PIPES OF DIFFERENT DIAMETERS OR MATERIALS ARE JOINED, OR WHERE THE CHANGE IN ALIGNMENT OR GRADE EXCEEDS THAT ALLOWED FOR ON ORDINARY JOINTS.
2. WHERE PIPES OF DIFFERENT DIAMETERS ARE JOINED WITH A CONCRETE COLLAR, L AND T SHOULD BE THOSE OF THE LARGER PIPE. D=D-1, OR D-2 WHICHEVER IS GREATER.

MOVE INTO TABLE

3. FOR PIPE SIZES NOT LISTED AND LESS THAN 66" USE NEXT SIZE LARGER.

4. OMIT REINFORCING ON PIPE 24" OR LESS IN DIAMETER.

5. WHERE REINFORCING IS REQUIRED, THE DIAMETER OF THE CIRCULAR TIES SHALL BE THE OUTSIDE DIAMETER OF PIPE+T.

6. FIELD CLOSURES OF PIPE OF THE SAME DIAMETER AND WITHOUT CHANGE IN GRADE OR ALIGNMENT SHALL BE MADE WITH A CONCRETE COLLAR.

7. CONCRETE SHALL BE CLASS B PER SECT. 725.

8. ALL REBAR SHALL HAVE 3" MINIMUM CLEAR COVER.

9. PIPE ENDS TO BE TRIMMED SUCH THAT THE MAXIMUM DISTANCE BETWEEN PIPES AT ANY POINT IS 2".

10. ALL PIPE OTHER THAN CONCRETE PIPE SHALL USE WATER STOPS ON EACH PIPE END PER MANUFACTURER'S RECOMMENDATION.

SEE REVISED NOTE


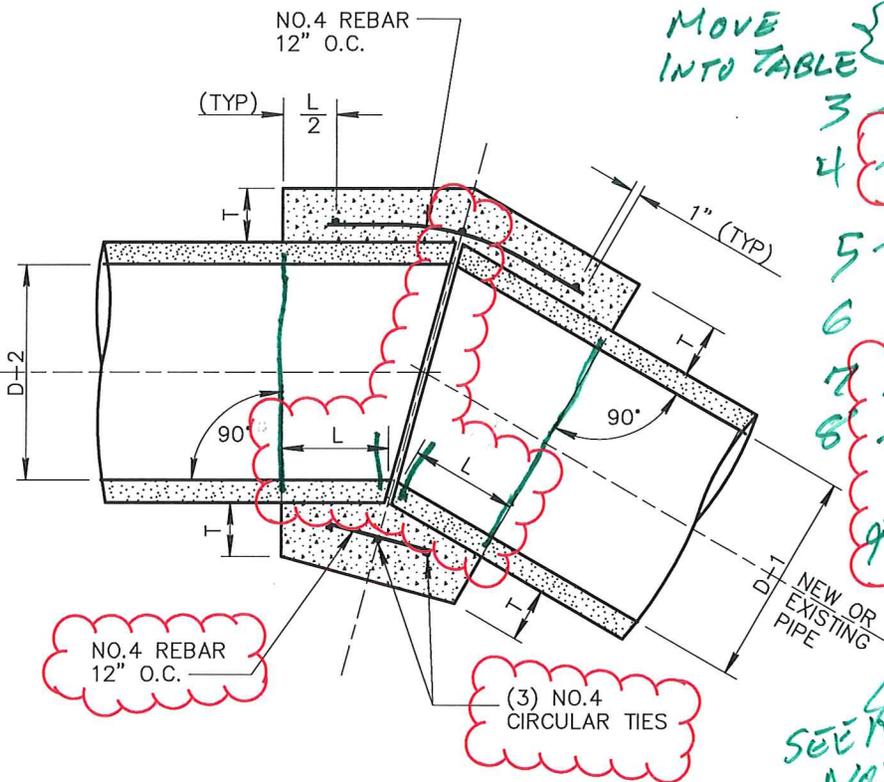


TABLE		
D	L	T
8" - 18"	1.0'	5"
24"	1.0'	6"
36"	1.5'	8"
48" - 57"	1.5'	10"
60" - 66"	1.75'	11"

NOTES:

1. A CONCRETE COLLAR IS REQUIRED WHERE PIPES OF DIFFERENT DIAMETERS OR MATERIALS ARE JOINED, OR WHERE THE CHANGE IN ALIGNMENT OR GRADE EXCEEDS THAT ALLOWED FOR ON ORDINARY JOINTS.
2. WHERE PIPES OF DIFFERENT DIAMETERS ARE JOINED WITH A CONCRETE COLLAR, L AND T SHOULD BE THOSE OF THE LARGER PIPE. $D=D-1$, OR $D-2$ WHICHEVER IS GREATER.
3. OMIT REINFORCING ON PIPE 24" OR LESS IN DIAMETER.
4. WHERE REINFORCING IS REQUIRED, THE DIAMETER OF THE CIRCULAR TIES SHALL BE THE OUTSIDE DIAMETER OF PIPE+T.
5. FIELD CLOSURES OF PIPE OF THE SAME DIAMETER AND WITHOUT CHANGE IN GRADE OR ALIGNMENT SHALL BE MADE WITH A CONCRETE COLLAR.
6. CONCRETE SHALL BE CLASS B PER SECT. 725.
7. ALL REBAR SHALL HAVE 3" MINIMUM CLEAR COVER.
8. PIPE ENDS TO BE TRIMMED SUCH THAT THE MAXIMUM DISTANCE BETWEEN PIPES AT ANY POINT IS 2".
9. AN ENGINEER APPROVED WATER STOP IS REQUIRED ON ALL PIPES EXCEPT CONCRETE PIPE.

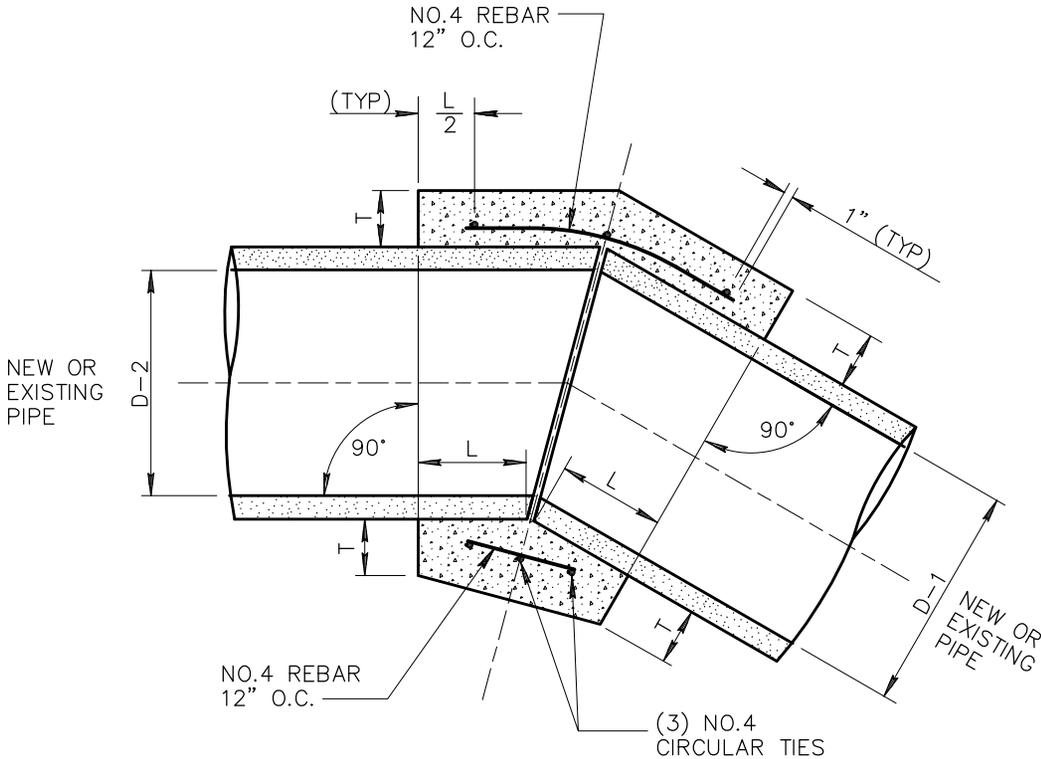

D	L	T
18"	1.0'	5"
24"	1.0'	6"
36"	1.5'	8"
57"	1.5'	10"
66"	1.75'	11"

FOR PIPE SIZES NOT LISTED AND LESS THAN 66" USE THE NEXT SIZE LARGER.